

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906235

Luminaire Tested: DFN2DIP-SQ2F0-040D060US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906235
REPORT IS A COMBINATION OF REPORTS P901330 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D060US835-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9340.0 lumens
Efficiency: N/A
Efficacy: 117.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 79.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLLONL

Luminous Intensity Polar Plot

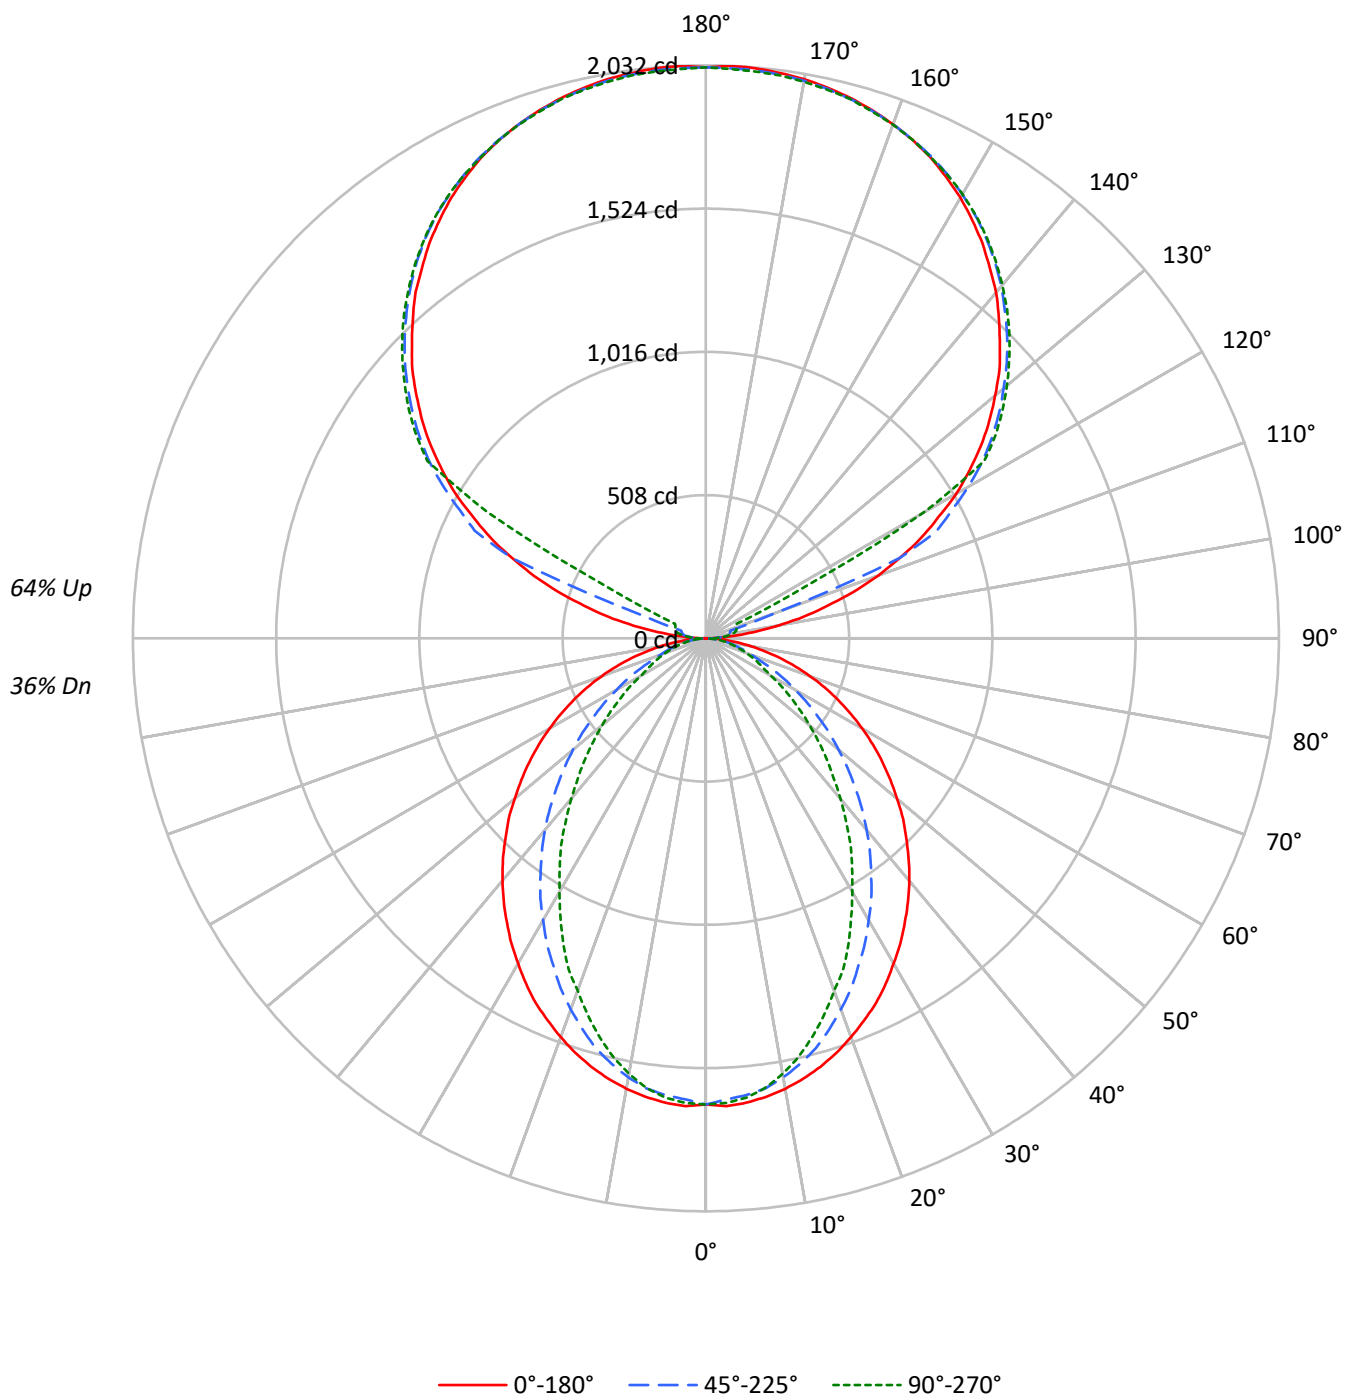

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3635	3635	3635
5°	3635	3570	3595
10°	3593	3492	3473
15°	3537	3369	3288
20°	3465	3202	3062
25°	3391	3017	2844
30°	3295	2828	2569
35°	3200	2626	2328
40°	3103	2417	2052
45°	2991	2187	1803
50°	2875	1955	1559
55°	2753	1708	1326
60°	2611	1451	1087
65°	2448	1191	972
70°	2250	949	872
75°	2001	821	784
80°	1643	666	664
85°	1070	414	472

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2991 cd/sqm

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	154.9	1.7
10°-20°	425.3	4.6
20°-30°	597.2	6.4
30°-40°	650.9	7.0
40°-50°	598.3	6.4
50°-60°	469.9	5.0
60°-70°	305.8	3.3
70°-80°	157.4	1.7
80°-90°	43.8	0.5
90°-100°	66.8	0.7
100°-110°	248.9	2.7
110°-120°	660.2	7.1
120°-130°	1094.9	11.7
130°-140°	1163.0	12.5
140°-150°	1080.9	11.6
150°-160°	869.0	9.3
160°-170°	560.0	6.0
170°-180°	192.7	2.1
0°-30°	1177.4	12.6
0°-40°	1828.4	19.6
0°-60°	2896.5	31.0
0°-90°	3403.6	36.4
90°-120°	975.8	10.4
90°-150°	4314.7	46.2
90°-180°	5936.0	63.6
0°-180°	9340.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1653	1653	1653	1653	1653	
5°	1653	1646	1626	1640	1635	157
15°	1572	1556	1505	1477	1462	443
25°	1427	1379	1281	1219	1197	656
35°	1230	1154	1022	928	895	770
45°	1005	905	748	642	606	776
55°	764	648	486	396	368	683
65°	516	395	260	210	205	512
75°	275	170	120	109	108	291
85°	64	33	28	28	28	74
90°	1	18	29	37	40	9
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1653.2	1653.2	1653.2	1653.2	1653.2
2.5°	1660.7	1653.2	1636.7	1651.8	1648.7
5°	1653.2	1645.7	1626.2	1639.7	1635.3
7.5°	1639.7	1630.8	1609.9	1615.7	1608.3
10°	1621.8	1611.3	1581.4	1576.8	1568.0
12.5°	1599.4	1585.9	1545.4	1536.5	1520.0
15°	1572.4	1555.9	1505.1	1476.7	1461.8
17.5°	1541.0	1517.0	1454.1	1421.3	1397.3
20°	1505.1	1475.1	1400.3	1363.0	1330.0
22.5°	1466.2	1431.8	1344.9	1294.1	1271.8
25°	1427.3	1379.4	1280.6	1219.4	1196.8
27.5°	1381.0	1330.0	1220.8	1150.5	1116.0
30°	1331.6	1274.6	1154.9	1078.7	1038.3
32.5°	1283.7	1214.8	1092.2	1002.4	964.9
35°	1229.9	1153.5	1021.9	927.6	894.6
37.5°	1177.5	1095.1	956.0	852.7	815.4
40°	1122.1	1032.4	887.2	781.0	742.1
42.5°	1065.2	969.5	818.4	707.6	670.3
45°	1005.4	905.1	748.1	641.8	605.9
47.5°	948.6	842.4	680.8	574.5	541.6
50°	885.7	779.5	614.9	511.6	480.3
52.5°	824.3	712.1	552.1	453.3	424.9
55°	764.5	647.8	486.2	396.5	368.1
57.5°	703.2	583.5	427.9	344.1	320.2
60°	640.3	520.6	366.5	290.3	266.4
62.5°	579.1	459.4	314.1	242.4	230.5
65°	516.2	394.9	260.3	209.5	204.9
67.5°	456.4	335.1	209.5	184.0	179.5
70°	393.5	276.8	173.5	158.6	152.5
72.5°	333.7	222.9	145.1	133.2	130.2
75°	275.2	170.5	119.7	109.2	107.8
77.5°	217.0	121.1	94.3	88.3	85.2
80°	163.0	86.8	71.7	65.9	65.9
82.5°	113.7	58.4	49.4	46.3	46.3
85°	64.3	32.9	28.4	28.4	28.4
87.5°	24.0	11.9	11.9	10.5	10.5
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P906235

CATALOG NUMBER: DFN2DIP-SQ2F0-040D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.10	10.83	11.17	11.90	13.36	6.06	6.79	7.13	7.86	9.32
	3H	11.75	12.40	12.83	13.48	14.96	7.22	7.88	8.30	8.96	10.43
	4H	12.34	12.96	13.43	14.04	15.52	7.66	8.28	8.75	9.36	10.83
	6H	12.74	13.31	13.84	14.40	15.89	7.96	8.53	9.06	9.61	11.10
	8H	12.86	13.40	13.96	14.50	15.98	8.04	8.58	9.14	9.68	11.16
	12H	12.91	13.42	14.02	14.51	16.02	8.07	8.58	9.18	9.67	11.18
4H	2H	10.10	10.72	11.20	11.80	13.28	6.63	7.25	7.73	8.33	9.81
	3H	11.90	12.41	13.00	13.52	15.01	7.95	8.47	9.06	9.58	11.07
	4H	12.57	13.05	13.68	14.14	15.65	8.48	8.96	9.59	10.05	11.56
	6H	13.06	13.47	14.18	14.59	16.09	8.88	9.28	9.99	10.40	11.91
	8H	13.23	13.60	14.34	14.71	16.24	8.99	9.37	10.11	10.48	12.00
	12H	13.31	13.65	14.44	14.77	16.30	9.04	9.38	10.18	10.51	12.03
8H	4H	12.53	12.91	13.65	14.02	15.54	8.74	9.12	9.86	10.23	11.75
	6H	13.07	13.38	14.21	14.53	16.05	9.23	9.55	10.37	10.70	12.22
	8H	13.27	13.54	14.42	14.68	16.22	9.41	9.68	10.55	10.82	12.35
	12H	13.39	13.63	14.54	14.76	16.34	9.51	9.75	10.66	10.88	12.45
12H	4H	12.48	12.82	13.61	13.94	15.47	8.74	9.08	9.87	10.21	11.73
	6H	13.04	13.32	14.19	14.45	15.99	9.28	9.55	10.42	10.68	12.22
	8H	13.25	13.48	14.39	14.61	16.19	9.47	9.71	10.61	10.84	12.41