

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906262

Luminaire Tested: DFN2DIP-SQ2F0-050D070US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906262
REPORT IS A COMBINATION OF REPORTS P899824 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D070US835-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10445.0 lumens
Efficiency: N/A
Efficacy: 105.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLLFLL

Luminous Intensity Polar Plot

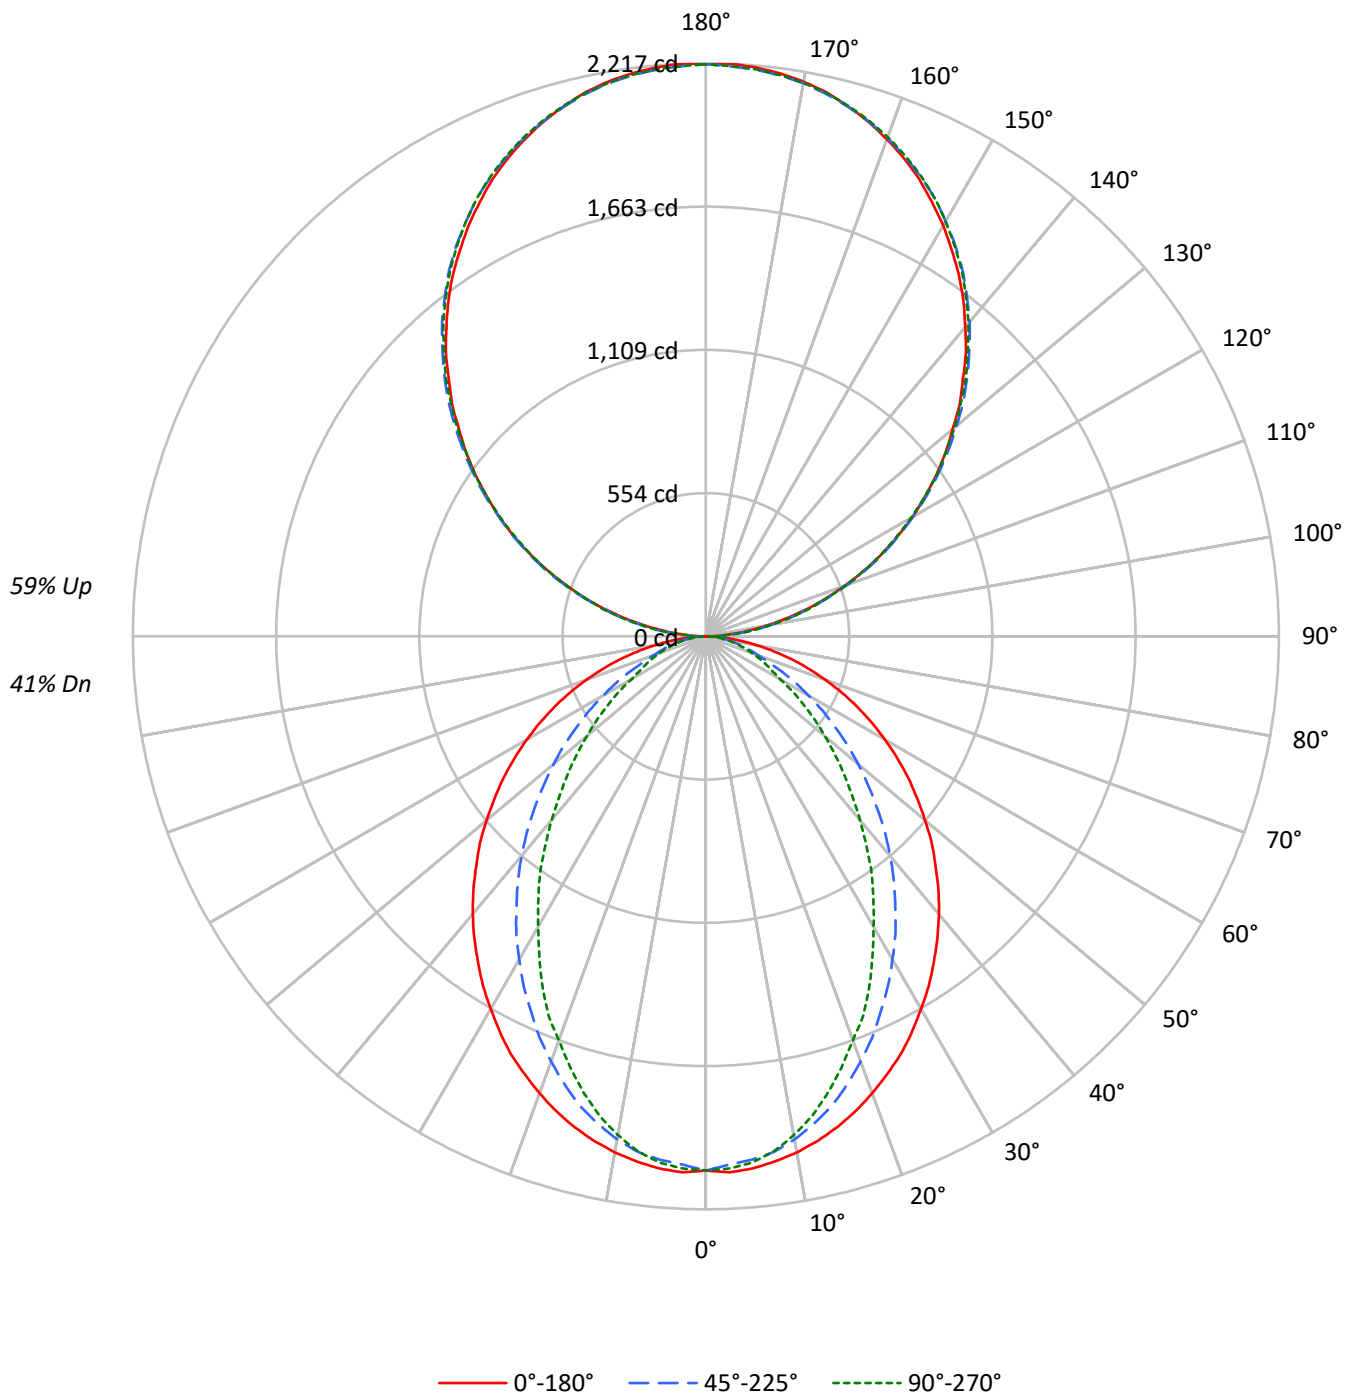

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	32	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	27	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4544	4544	4544
5°	4543	4462	4494
10°	4491	4365	4341
15°	4421	4211	4110
20°	4331	4003	3827
25°	4239	3771	3555
30°	4119	3535	3211
35°	4000	3282	2910
40°	3879	3021	2565
45°	3739	2733	2253
50°	3594	2443	1949
55°	3441	2135	1657
60°	3264	1814	1358
65°	3060	1489	1215
70°	2813	1186	1091
75°	2501	1026	979
80°	2054	834	830
85°	1337	518	591

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3739 cd/sqm

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	193.7	1.9
10°-20°	531.7	5.1
20°-30°	746.5	7.1
30°-40°	813.7	7.8
40°-50°	747.9	7.2
50°-60°	587.3	5.6
60°-70°	382.3	3.7
70°-80°	196.8	1.9
80°-90°	56.5	0.5
90°-100°	137.0	1.3
100°-110°	435.3	4.2
110°-120°	744.9	7.1
120°-130°	979.6	9.4
130°-140°	1099.6	10.5
140°-150°	1078.3	10.3
150°-160°	904.5	8.7
160°-170°	599.9	5.7
170°-180°	209.7	2.0
0°-30°	1471.8	14.1
0°-40°	2285.5	21.9
0°-60°	3620.7	34.7
0°-90°	4256.3	40.7
90°-120°	1317.2	12.6
90°-150°	4474.7	42.8
90°-180°	6189.0	59.3
0°-180°	10445.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2066	2066	2066	2066	2066	
5°	2066	2057	2033	2050	2044	196
15°	1966	1945	1881	1846	1827	554
25°	1784	1724	1601	1524	1496	821
35°	1537	1442	1277	1160	1118	962
45°	1257	1131	935	802	757	971
55°	956	810	608	496	460	854
65°	645	494	325	262	256	640
75°	344	213	150	136	135	364
85°	80	41	36	36	36	92
90°	2	24	65	61	63	10
95°	97	116	120	120	116	108
105°	402	407	411	414	414	424
115°	748	758	755	753	748	739
125°	1087	1104	1099	1093	1091	972
135°	1406	1427	1431	1429	1424	1087
145°	1707	1721	1731	1733	1726	1067
155°	1952	1958	1964	1973	1967	899
165°	2124	2122	2122	2135	2126	599
175°	2210	2204	2200	2214	2202	210
180°	2214	2214	2214	2214	2214	

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2066.5	2066.5	2066.5	2066.5	2066.5
2.5°	2075.8	2066.5	2045.9	2064.7	2060.9
5°	2066.5	2057.2	2032.8	2049.6	2044.1
7.5°	2049.6	2038.5	2012.3	2019.7	2010.3
10°	2027.2	2014.1	1976.8	1971.1	1959.9
12.5°	1999.2	1982.4	1931.8	1920.7	1900.0
15°	1965.5	1944.9	1881.4	1845.9	1827.2
17.5°	1926.2	1896.3	1817.7	1776.6	1746.6
20°	1881.4	1843.9	1750.4	1703.8	1662.5
22.5°	1832.8	1789.7	1681.2	1617.7	1589.7
25°	1784.1	1724.2	1600.8	1524.2	1496.0
27.5°	1726.2	1662.5	1526.0	1438.1	1395.1
30°	1664.5	1593.3	1443.7	1348.4	1297.8
32.5°	1604.6	1518.5	1365.3	1253.0	1206.2
35°	1537.3	1441.9	1277.4	1159.5	1118.3
37.5°	1471.8	1368.9	1195.1	1065.9	1019.3
40°	1402.6	1290.5	1108.9	976.2	927.6
42.5°	1331.6	1211.9	1023.0	884.5	837.9
45°	1256.8	1131.4	935.1	802.2	757.3
47.5°	1185.7	1053.0	851.0	718.1	677.0
50°	1107.2	974.4	768.7	639.5	600.4
52.5°	1030.4	890.1	690.1	566.7	531.2
55°	955.6	809.7	607.7	495.6	460.1
57.5°	879.0	729.4	534.9	430.2	400.2
60°	800.4	650.8	458.1	362.9	332.9
62.5°	723.8	574.2	392.7	303.0	288.1
65°	645.2	493.7	325.4	261.9	256.2
67.5°	570.4	418.9	261.9	230.0	224.4
70°	491.9	346.0	216.9	198.2	190.7
72.5°	417.1	278.6	181.4	166.5	162.7
75°	344.1	213.1	149.6	136.5	134.7
77.5°	271.2	151.4	117.9	110.3	106.5
80°	203.8	108.5	89.7	82.3	82.3
82.5°	142.1	73.0	61.7	57.9	57.9
85°	80.4	41.1	35.5	35.5	35.5
87.5°	30.0	14.9	14.9	13.1	13.1
90°	2.0	24.0	65.4	61.4	63.4
92.5°	41.4	56.1	58.1	60.1	60.1
95°	97.4	116.1	119.5	119.5	116.1
97.5°	162.2	179.5	186.9	186.9	186.9
100°	236.9	252.3	257.6	257.6	255.6
102.5°	315.7	327.0	334.4	336.4	334.4
105°	401.8	407.1	411.1	414.5	414.5
107.5°	487.2	495.2	495.2	496.6	487.2
110°	570.0	580.7	580.7	580.7	575.3

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	659.4	670.8	668.8	663.4	659.4
115°	747.5	758.2	754.9	752.9	747.5
117.5°	834.9	849.6	840.3	834.9	829.6
120°	923.0	937.7	923.0	923.0	917.0
122.5°	1003.1	1021.8	1012.5	1007.1	1003.1
125°	1087.2	1103.9	1098.6	1092.6	1090.6
127.5°	1169.3	1190.0	1182.7	1174.7	1169.3
130°	1246.1	1270.1	1266.8	1262.8	1255.4
132.5°	1332.2	1350.9	1352.2	1342.9	1337.5
135°	1406.3	1426.9	1431.0	1428.9	1423.6
137.5°	1489.0	1505.7	1509.0	1507.7	1499.7
140°	1561.8	1578.5	1587.8	1587.8	1580.5
142.5°	1636.5	1653.2	1658.5	1660.5	1653.2
145°	1707.3	1720.6	1731.3	1733.3	1726.0
147.5°	1770.7	1787.4	1795.4	1798.7	1791.4
150°	1836.1	1847.4	1854.8	1860.8	1854.8
152.5°	1894.1	1905.5	1914.8	1922.2	1914.8
155°	1952.2	1957.5	1963.6	1972.9	1966.9
157.5°	2002.3	2006.3	2009.6	2023.0	2013.6
160°	2047.0	2051.0	2053.0	2064.3	2056.3
162.5°	2088.4	2088.4	2090.4	2103.0	2093.7
165°	2123.7	2121.7	2121.7	2135.1	2125.7
167.5°	2155.8	2149.8	2149.8	2163.1	2153.8
170°	2179.8	2174.5	2172.5	2185.8	2174.5
172.5°	2196.5	2191.1	2189.1	2202.5	2191.1
175°	2209.8	2204.5	2200.5	2213.8	2202.5
177.5°	2217.2	2211.8	2207.8	2219.2	2207.8
180°	2213.8	2213.8	2213.8	2213.8	2213.8

TEST NUMBER: P906262

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US835-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.36	12.12	12.40	13.16	14.56	7.32	8.08	8.36	9.12	10.52
	3H	13.01	13.69	14.06	14.74	16.16	8.49	9.17	9.53	10.22	11.63
	4H	13.60	14.25	14.67	15.30	16.73	8.92	9.56	9.98	10.62	12.04
	6H	14.01	14.60	15.08	15.66	17.09	9.22	9.81	10.29	10.87	12.31
	8H	14.12	14.69	15.20	15.76	17.19	9.30	9.86	10.38	10.94	12.37
	12H	14.17	14.71	15.25	15.77	17.23	9.33	9.87	10.41	10.93	12.39
4H	2H	11.36	12.01	12.43	13.06	14.49	7.90	8.54	8.96	9.59	11.02
	3H	13.17	13.70	14.24	14.78	16.22	9.22	9.76	10.29	10.83	12.27
	4H	13.84	14.33	14.92	15.40	16.86	9.75	10.24	10.83	11.31	12.77
	6H	14.33	14.75	15.42	15.85	17.30	10.14	10.57	11.23	11.66	13.11
	8H	14.49	14.89	15.58	15.97	17.44	10.26	10.65	11.35	11.74	13.21
	12H	14.58	14.93	15.68	16.03	17.50	10.31	10.67	11.42	11.77	13.24
8H	4H	13.80	14.19	14.89	15.28	16.75	10.01	10.41	11.10	11.49	12.96
	6H	14.34	14.66	15.45	15.79	17.26	10.50	10.83	11.61	11.96	13.42
	8H	14.54	14.83	15.66	15.94	17.42	10.68	10.96	11.80	12.07	13.56
	12H	14.66	14.91	15.78	16.02	17.54	10.78	11.03	11.90	12.14	13.66
12H	4H	13.75	14.10	14.85	15.20	16.67	10.01	10.37	11.12	11.46	12.94
	6H	14.31	14.60	15.43	15.71	17.19	10.55	10.83	11.66	11.94	13.43
	8H	14.52	14.77	15.64	15.87	17.40	10.74	10.99	11.86	12.09	13.62

END OF REPORT