

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906264

Luminaire Tested: DFN2DIP-SQ2F0-050D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906264
REPORT IS A COMBINATION OF REPORTS P899835 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D080US835-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12030.0 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFLL

Luminous Intensity Polar Plot

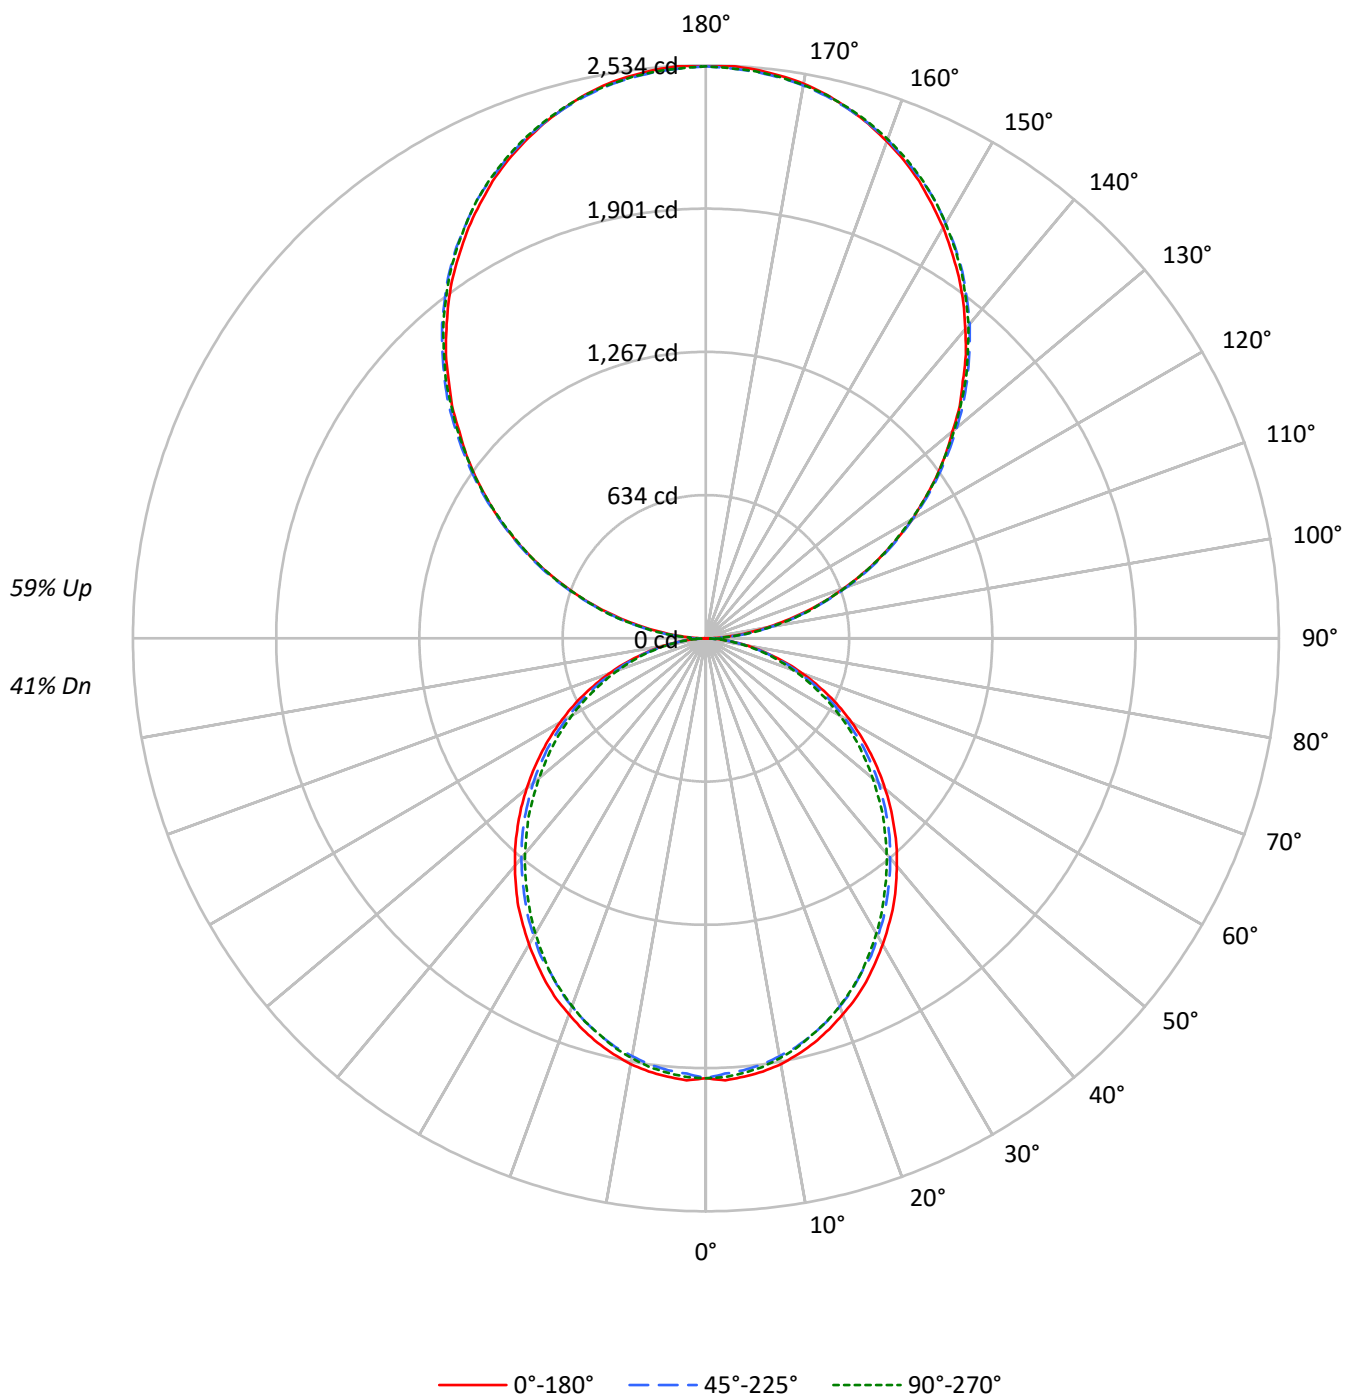

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	84	87	84	80	77	69	66	64	55	53	52	42	41	41
2	87	80	74	69	79	73	68	63	60	56	53	48	46	43	37	36	34
3	80	70	63	57	72	64	58	53	53	48	45	43	39	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	30	27	25
5	67	55	47	41	61	51	44	38	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	38	33	38	33	29	31	27	24	24	21	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	40	33	28	48	37	31	26	31	26	22	26	22	19	20	17	15
9	49	37	30	25	45	34	27	23	29	23	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4278	4278	4278
5°	4277	4209	4241
10°	4235	4143	4177
15°	4166	4066	4082
20°	4074	3962	3984
25°	3983	3839	3872
30°	3870	3724	3731
35°	3763	3591	3583
40°	3632	3455	3441
45°	3501	3319	3295
50°	3358	3176	3127
55°	3207	3010	2971
60°	3036	2815	2793
65°	2849	2611	2582
70°	2611	2363	2354
75°	2284	2065	2136
80°	1887	1686	1735
85°	1274	1064	1090

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3527 cd/sqm

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	1.5
10°-20°	515.2	4.3
20°-30°	757.2	6.3
30°-40°	879.4	7.3
40°-50°	878.3	7.3
50°-60°	765.8	6.4
60°-70°	566.1	4.7
70°-80°	320.3	2.7
80°-90°	91.7	0.8
90°-100°	156.6	1.3
100°-110°	497.5	4.1
110°-120°	851.3	7.1
120°-130°	1119.6	9.3
130°-140°	1256.7	10.4
140°-150°	1232.3	10.2
150°-160°	1033.7	8.6
160°-170°	685.6	5.7
170°-180°	239.6	2.0
0°-30°	1455.5	12.1
0°-40°	2334.9	19.4
0°-60°	3979.0	33.1
0°-90°	4957.2	41.2
90°-120°	1505.3	12.5
90°-150°	5113.9	42.5
90°-180°	7073.0	58.8
0°-180°	12030.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	2	28	75	70	72	12
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P906264

CATALOG NUMBER: DFN2DIP-SQ2F0-050D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.33	12.12	12.36	13.16	14.55	10.89	11.68	11.92	12.71	14.10
	3H	12.97	13.67	14.01	14.72	16.13	12.48	13.18	13.52	14.23	15.64
	4H	13.54	14.21	14.59	15.26	16.67	13.05	13.72	14.10	14.76	16.18
	6H	13.92	14.54	14.98	15.59	17.02	13.42	14.04	14.48	15.09	16.52
	8H	14.02	14.60	15.08	15.67	17.10	13.51	14.10	14.58	15.17	16.59
	12H	14.05	14.61	15.13	15.67	17.12	13.55	14.10	14.62	15.17	16.61
4H	2H	11.77	12.44	12.83	13.49	14.91	11.42	12.09	12.48	13.14	14.55
	3H	13.61	14.17	14.68	15.24	16.68	13.20	13.76	14.27	14.84	16.27
	4H	14.31	14.82	15.38	15.88	17.34	13.88	14.39	14.95	15.46	16.91
	6H	14.80	15.24	15.88	16.33	17.78	14.37	14.81	15.45	15.90	17.34
	8H	14.94	15.35	16.02	16.43	17.89	14.50	14.91	15.58	15.99	17.46
	12H	15.00	15.37	16.10	16.46	17.93	14.55	14.92	15.65	16.02	17.48
8H	4H	14.49	14.90	15.57	15.98	17.44	14.11	14.52	15.19	15.60	17.06
	6H	15.09	15.43	16.19	16.55	18.01	14.71	15.04	15.81	16.17	17.63
	8H	15.30	15.59	16.41	16.70	18.18	14.90	15.20	16.01	16.31	17.79
	12H	15.41	15.67	16.53	16.78	18.29	15.00	15.26	16.12	16.37	17.88
12H	4H	14.46	14.84	15.56	15.93	17.40	14.10	14.47	15.19	15.56	17.03
	6H	15.11	15.41	16.22	16.52	18.00	14.74	15.04	15.85	16.14	17.62
	8H	15.34	15.60	16.45	16.70	18.22	14.96	15.22	16.07	16.32	17.84