

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906277

Luminaire Tested: DFN2DIP-SQ2F0-060D050US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906277
REPORT IS A COMBINATION OF REPORTS P901321 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D050US835-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10890.0 lumens
Efficiency: N/A
Efficacy: 117.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

Luminous Intensity Polar Plot

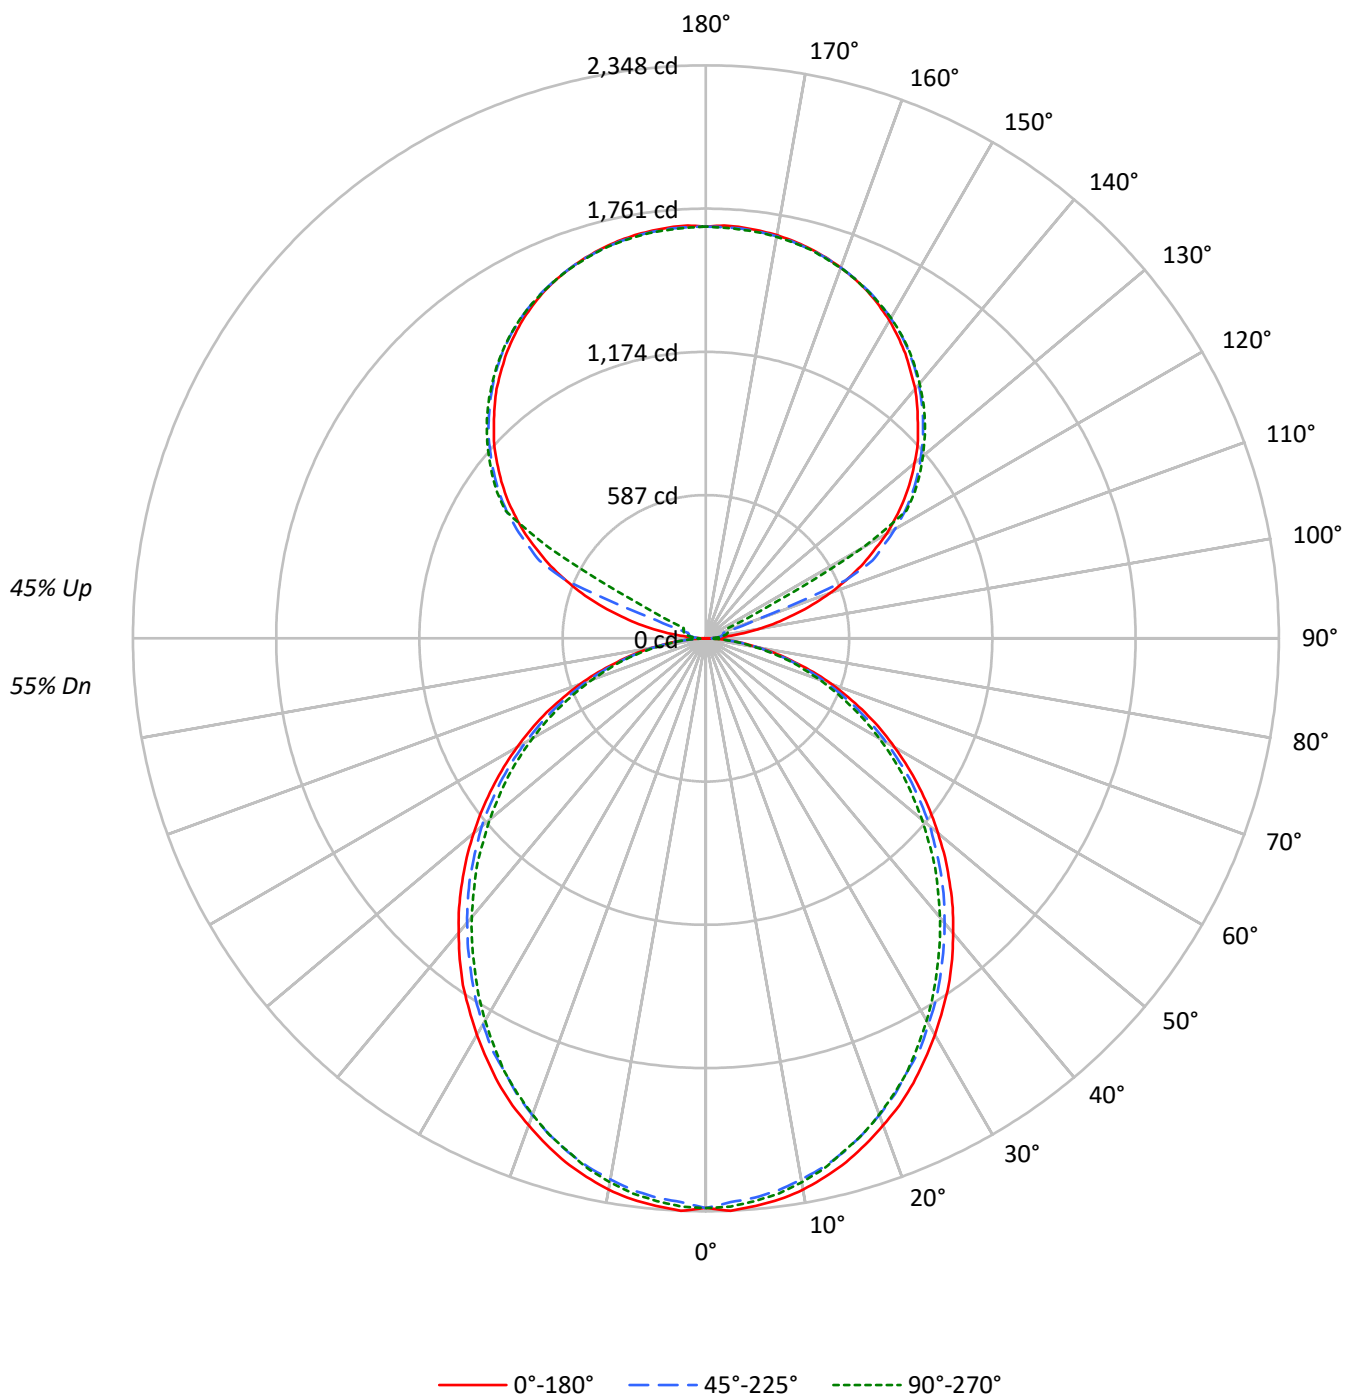

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5134	5134	5134
5°	5133	5051	5089
10°	5082	4972	5013
15°	4999	4879	4898
20°	4889	4754	4781
25°	4779	4607	4646
30°	4644	4469	4477
35°	4516	4309	4299
40°	4359	4146	4129
45°	4202	3983	3954
50°	4030	3811	3753
55°	3849	3612	3566
60°	3644	3378	3351
65°	3418	3134	3099
70°	3133	2836	2825
75°	2741	2478	2563
80°	2264	2023	2081
85°	1529	1277	1308

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4202 cd/sqm

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	2.0
10°-20°	618.3	5.7
20°-30°	908.6	8.3
30°-40°	1055.3	9.7
40°-50°	1054.0	9.7
50°-60°	919.0	8.4
60°-70°	679.4	6.2
70°-80°	384.4	3.5
80°-90°	104.4	1.0
90°-100°	55.7	0.5
100°-110°	207.4	1.9
110°-120°	550.1	5.1
120°-130°	912.4	8.4
130°-140°	969.2	8.9
140°-150°	900.8	8.3
150°-160°	724.2	6.7
160°-170°	466.6	4.3
170°-180°	160.6	1.5
0°-30°	1746.6	16.0
0°-40°	2801.8	25.7
0°-60°	4774.8	43.8
0°-90°	5943.0	54.6
90°-120°	813.2	7.5
90°-150°	3595.6	33.0
90°-180°	4947.0	45.4
0°-180°	10890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	1	15	24	31	33	10
95°	79	39	48	54	52	94
105°	371	408	74	88	93	397
115°	702	723	753	188	100	691
125°	993	1009	1032	1040	1044	885
135°	1228	1248	1259	1271	1269	949
145°	1425	1424	1444	1453	1447	891
155°	1569	1558	1573	1580	1570	723
165°	1653	1646	1650	1658	1650	467
175°	1691	1682	1685	1694	1681	161
180°	1687	1687	1687	1687	1687	

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	1.2	14.6	24.4	30.6	32.9
92.5°	30.6	25.7	29.3	31.8	32.9
95°	79.3	39.0	47.6	53.8	52.5
97.5°	142.8	42.8	62.2	66.0	67.1
100°	216.2	48.9	69.6	79.3	81.8
102.5°	296.7	294.3	72.1	85.4	89.2
105°	371.2	407.9	74.5	87.9	92.8
107.5°	457.9	488.3	77.0	90.3	95.3
110°	541.0	566.5	213.7	91.6	96.4

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	619.1	641.0	620.3	94.0	97.7
115°	702.1	722.8	753.4	188.1	100.2
117.5°	774.1	798.5	819.4	644.6	324.8
120°	854.7	873.0	895.0	909.7	744.8
122.5°	923.0	942.6	967.1	974.4	975.7
125°	992.6	1008.6	1031.8	1040.3	1044.0
127.5°	1056.1	1073.2	1091.7	1103.8	1105.0
130°	1116.0	1135.6	1148.9	1162.4	1161.3
132.5°	1177.1	1193.0	1206.3	1217.4	1216.2
135°	1228.4	1248.0	1258.8	1271.2	1268.7
137.5°	1282.0	1296.7	1309.0	1321.2	1317.6
140°	1334.5	1344.4	1357.7	1368.7	1362.7
142.5°	1378.6	1387.2	1403.0	1412.7	1406.6
145°	1425.0	1423.7	1444.4	1453.0	1446.9
147.5°	1465.2	1461.5	1482.3	1488.4	1483.6
150°	1504.3	1495.8	1515.3	1522.6	1516.5
152.5°	1537.2	1527.5	1545.8	1553.2	1544.6
155°	1569.0	1558.1	1572.7	1580.0	1570.3
157.5°	1594.6	1584.9	1595.9	1604.5	1594.6
160°	1616.7	1609.3	1616.7	1623.9	1615.4
162.5°	1636.1	1628.9	1634.9	1643.5	1632.5
165°	1653.2	1646.0	1649.6	1658.1	1649.6
167.5°	1666.7	1659.3	1663.1	1671.6	1660.6
170°	1677.7	1670.3	1672.8	1681.3	1670.3
172.5°	1685.0	1677.7	1680.2	1688.7	1677.7
175°	1691.1	1682.5	1685.0	1693.5	1681.3
177.5°	1693.5	1685.0	1686.3	1694.8	1683.8
180°	1687.4	1687.4	1687.4	1687.4	1687.4

TEST NUMBER: P906277

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.25	14.16	14.17	15.09	16.30	12.81	13.71	13.73	14.65	15.85
	3H	14.90	15.71	15.83	16.65	17.88	14.41	15.22	15.34	16.16	17.39
	4H	15.47	16.24	16.42	17.19	18.43	14.98	15.75	15.92	16.70	17.93
	6H	15.86	16.57	16.82	17.52	18.77	15.36	16.07	16.32	17.02	18.27
	8H	15.96	16.63	16.92	17.61	18.85	15.46	16.13	16.42	17.10	18.35
	12H	16.00	16.64	16.97	17.61	18.88	15.49	16.13	16.46	17.10	18.37
4H	2H	13.71	14.48	14.66	15.43	16.66	13.35	14.12	14.30	15.07	16.31
	3H	15.56	16.20	16.51	17.18	18.43	15.15	15.79	16.11	16.77	18.02
	4H	16.26	16.84	17.22	17.81	19.09	15.83	16.42	16.80	17.39	18.67
	6H	16.75	17.26	17.74	18.26	19.53	16.32	16.83	17.30	17.82	19.10
	8H	16.90	17.37	17.88	18.36	19.65	16.46	16.93	17.44	17.92	19.21
	12H	16.96	17.39	17.96	18.39	19.69	16.51	16.94	17.52	17.95	19.24
8H	4H	16.44	16.92	17.43	17.91	19.20	16.07	16.54	17.05	17.53	18.82
	6H	17.05	17.44	18.06	18.48	19.76	16.67	17.06	17.68	18.09	19.38
	8H	17.26	17.61	18.28	18.62	19.93	16.87	17.21	17.88	18.23	19.54
	12H	17.38	17.68	18.40	18.70	20.05	16.97	17.27	17.99	18.29	19.64
12H	4H	16.43	16.85	17.43	17.86	19.16	16.06	16.48	17.06	17.49	18.79
	6H	17.08	17.42	18.09	18.44	19.75	16.70	17.05	17.72	18.07	19.37
	8H	17.31	17.61	18.33	18.62	19.97	16.93	17.23	17.95	18.24	19.59