

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906330

Luminaire Tested: DFN2DIP-SQ2F0-080D060US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906330
REPORT IS A COMBINATION OF REPORTS P899818 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D060US835-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12110.0 lumens
Efficiency: N/A
Efficacy: 97.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 124.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLLFLL

Luminous Intensity Polar Plot

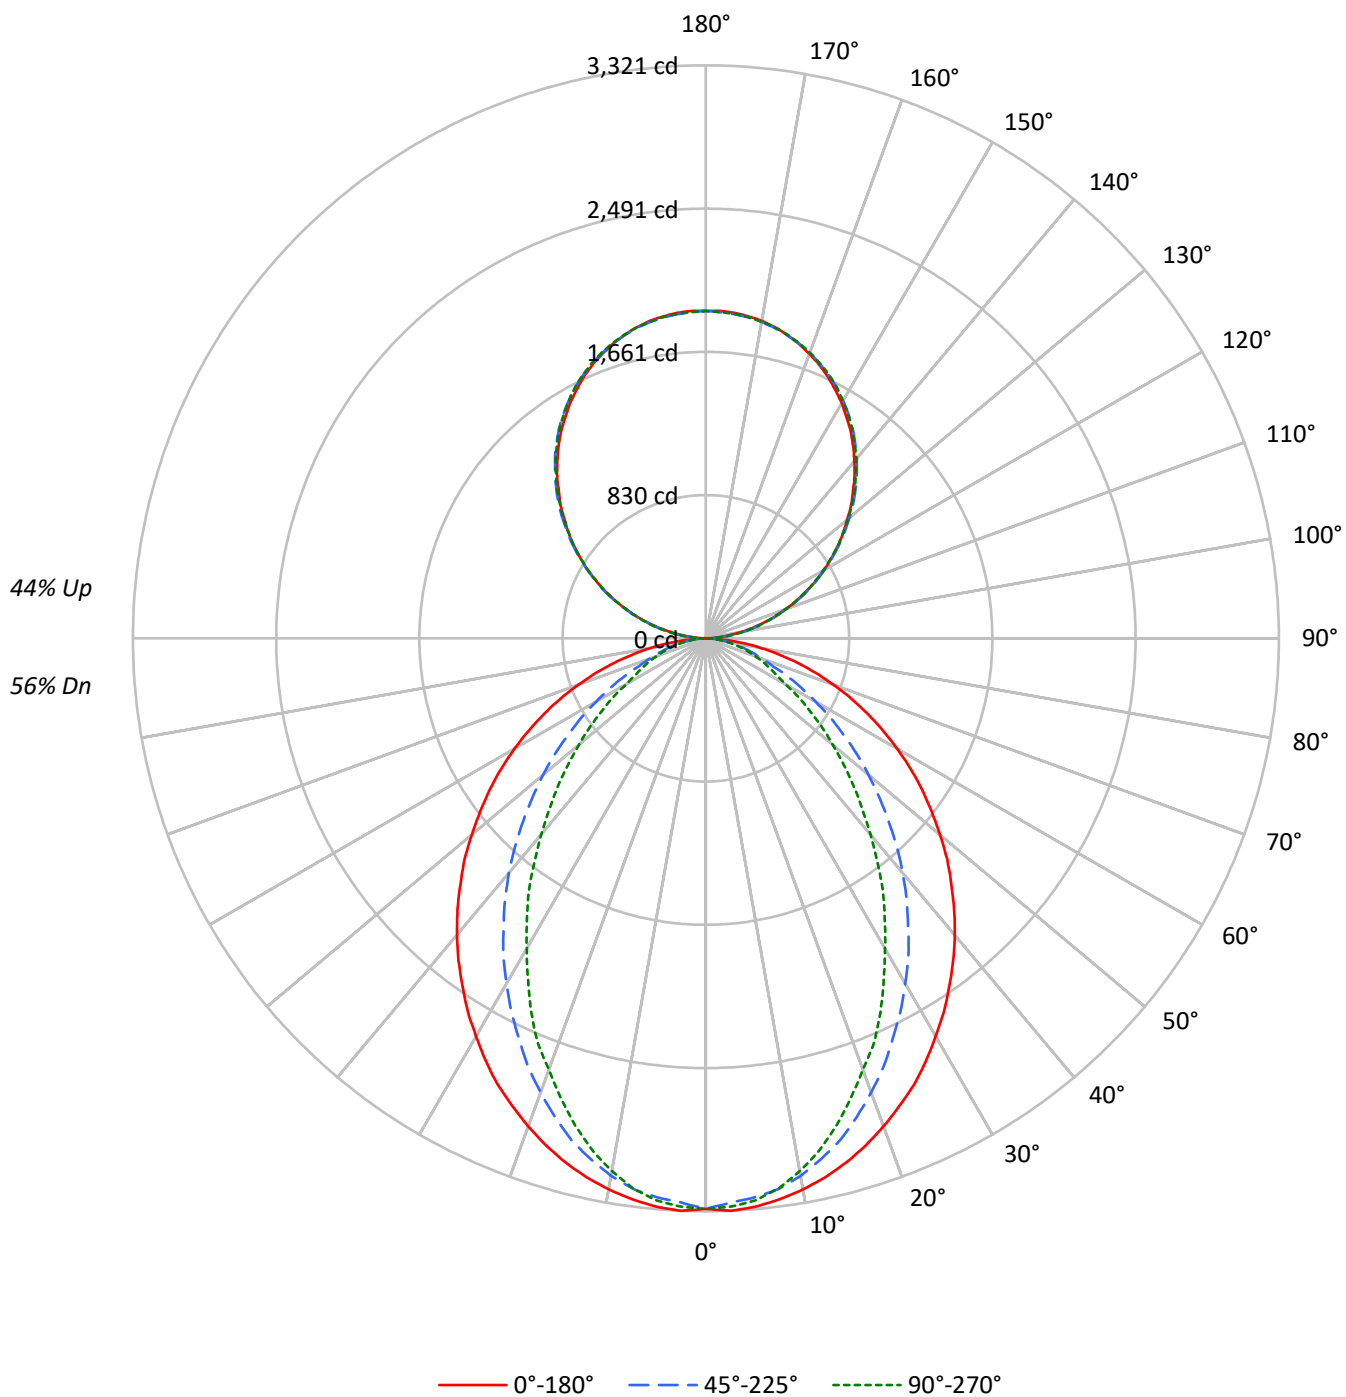

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	55	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	49	47	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	30
6	65	53	46	40	61	50	43	38	44	38	34	38	34	31	33	30	27
7	61	48	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	7270	7270	7270
5°	7269	7139	7191
10°	7185	6983	6947
15°	7073	6737	6576
20°	6930	6405	6124
25°	6783	6034	5688
30°	6590	5656	5138
35°	6400	5251	4656
40°	6206	4834	4104
45°	5983	4373	3605
50°	5750	3910	3118
55°	5506	3416	2651
60°	5223	2902	2173
65°	4897	2382	1944
70°	4501	1898	1745
75°	4002	1642	1567
80°	3286	1334	1327
85°	2139	828	945

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5983 cd/sqm

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.9	2.6
10°-20°	850.7	7.0
20°-30°	1194.3	9.9
30°-40°	1301.9	10.8
40°-50°	1196.6	9.9
50°-60°	939.7	7.8
60°-70°	611.7	5.1
70°-80°	314.9	2.6
80°-90°	85.8	0.7
90°-100°	117.4	1.0
100°-110°	373.1	3.1
110°-120°	638.5	5.3
120°-130°	839.7	6.9
130°-140°	942.5	7.8
140°-150°	924.2	7.6
150°-160°	775.3	6.4
160°-170°	514.2	4.2
170°-180°	179.7	1.5
0°-30°	2354.9	19.4
0°-40°	3656.8	30.2
0°-60°	5793.1	47.8
0°-90°	6805.4	56.2
90°-120°	1129.0	9.3
90°-150°	3835.4	31.7
90°-180°	5305.0	43.8
0°-180°	12110.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3306	3306	3306	3306	3306	
5°	3306	3292	3252	3279	3270	314
15°	3145	3112	3010	2953	2924	886
25°	2855	2759	2561	2439	2394	1313
35°	2460	2307	2044	1855	1789	1540
45°	2011	1810	1496	1284	1212	1553
55°	1529	1296	972	793	736	1366
65°	1032	790	521	419	410	1024
75°	550	341	239	218	216	582
85°	129	66	57	57	57	148
90°	2	21	56	53	54	12
95°	84	100	102	102	100	93
105°	344	349	352	355	355	363
115°	641	650	647	645	641	634
125°	932	946	942	936	935	833
135°	1205	1223	1226	1225	1220	932
145°	1463	1475	1484	1486	1479	914
155°	1673	1678	1683	1691	1686	770
165°	1820	1819	1819	1830	1822	514
175°	1894	1890	1886	1898	1888	180
180°	1898	1898	1898	1898	1898	

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3306.4	3306.4	3306.4	3306.4	3306.4
2.5°	3321.3	3306.4	3273.4	3303.5	3297.5
5°	3306.4	3291.5	3252.4	3279.4	3270.5
7.5°	3279.4	3261.6	3219.7	3231.5	3216.5
10°	3243.5	3222.6	3162.9	3153.7	3135.9
12.5°	3198.8	3171.8	3090.8	3073.0	3040.0
15°	3144.8	3111.8	3010.2	2953.4	2923.5
17.5°	3081.9	3034.0	2908.3	2842.6	2794.6
20°	3010.2	2950.2	2800.7	2726.1	2660.0
22.5°	2932.4	2863.5	2689.9	2588.3	2543.5
25°	2854.6	2758.8	2561.3	2438.8	2393.7
27.5°	2761.9	2660.0	2441.6	2301.0	2232.1
30°	2663.2	2549.2	2309.9	2157.5	2076.5
32.5°	2567.3	2429.6	2184.5	2004.8	1929.9
35°	2459.7	2307.0	2043.8	1855.3	1789.2
37.5°	2354.9	2190.2	1912.1	1705.4	1630.8
40°	2244.2	2064.8	1774.3	1561.9	1484.1
42.5°	2130.5	1939.1	1636.8	1415.3	1340.6
45°	2010.8	1810.2	1496.2	1283.5	1211.8
47.5°	1897.2	1684.8	1361.6	1148.9	1083.2
50°	1771.4	1559.1	1229.9	1023.2	960.6
52.5°	1648.6	1424.1	1104.1	906.7	849.9
55°	1528.9	1295.6	972.4	793.0	736.2
57.5°	1406.4	1167.0	855.9	688.3	640.3
60°	1280.6	1041.3	733.0	580.6	532.7
62.5°	1158.1	918.7	628.3	484.8	461.0
65°	1032.4	789.8	520.6	419.1	409.8
67.5°	912.7	670.2	419.1	367.9	359.1
70°	787.0	553.7	347.0	317.1	305.1
72.5°	667.3	445.7	290.2	266.4	260.3
75°	550.5	341.0	239.4	218.4	215.6
77.5°	434.0	242.2	188.6	176.5	170.5
80°	326.0	173.7	143.5	131.7	131.7
82.5°	227.3	116.8	98.7	92.7	92.7
85°	128.6	65.7	56.8	56.8	56.8
87.5°	47.9	23.8	23.8	21.0	21.0
90°	1.7	20.6	56.1	52.6	54.3
92.5°	35.5	48.1	49.8	51.5	51.5
95°	83.5	99.5	102.4	102.4	99.5
97.5°	139.0	153.9	160.2	160.2	160.2
100°	203.1	216.2	220.8	220.8	219.1
102.5°	270.6	280.3	286.6	288.3	286.6
105°	344.4	349.0	352.4	355.3	355.3
107.5°	417.6	424.5	424.5	425.6	417.6
110°	488.6	497.7	497.7	497.7	493.1

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	565.2	574.9	573.2	568.6	565.2
115°	640.7	649.9	647.0	645.3	640.7
117.5°	715.7	728.3	720.2	715.7	711.1
120°	791.2	803.8	791.2	791.2	786.0
122.5°	859.8	875.8	867.8	863.3	859.8
125°	931.9	946.2	941.6	936.5	934.8
127.5°	1002.3	1020.0	1013.7	1006.9	1002.3
130°	1068.1	1088.7	1085.8	1082.4	1076.1
132.5°	1141.9	1157.9	1159.0	1151.0	1146.4
135°	1205.4	1223.1	1226.5	1224.8	1220.2
137.5°	1276.3	1290.6	1293.5	1292.3	1285.5
140°	1338.7	1353.0	1361.0	1361.0	1354.7
142.5°	1402.7	1417.0	1421.6	1423.3	1417.0
145°	1463.4	1474.8	1484.0	1485.7	1479.4
147.5°	1517.7	1532.0	1538.9	1541.7	1535.4
150°	1573.8	1583.5	1589.8	1594.9	1589.8
152.5°	1623.5	1633.3	1641.3	1647.6	1641.3
155°	1673.3	1677.9	1683.0	1691.1	1685.9
157.5°	1716.2	1719.7	1722.5	1734.0	1726.0
160°	1754.6	1758.0	1759.7	1769.4	1762.6
162.5°	1790.0	1790.0	1791.7	1802.6	1794.6
165°	1820.3	1818.6	1818.6	1830.1	1822.1
167.5°	1847.8	1842.7	1842.7	1854.1	1846.1
170°	1868.4	1863.8	1862.1	1873.5	1863.8
172.5°	1882.7	1878.1	1876.4	1887.8	1878.1
175°	1894.1	1889.6	1886.1	1897.6	1887.8
177.5°	1900.4	1895.9	1892.4	1902.1	1892.4
180°	1897.6	1897.6	1897.6	1897.6	1897.6

TEST NUMBER: P906330

CATALOG NUMBER: DFN2DIP-SQ2F0-080D060US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.48	15.37	15.39	16.29	17.47	10.44	11.33	11.35	12.25	13.43
	3H	16.15	16.94	17.07	17.87	19.08	11.62	12.41	12.54	13.34	14.55
	4H	16.74	17.49	17.68	18.43	19.64	12.06	12.80	12.99	13.74	14.96
	6H	17.15	17.84	18.10	18.78	20.01	12.37	13.05	13.31	14.00	15.23
	8H	17.27	17.92	18.23	18.89	20.11	12.45	13.10	13.40	14.06	15.29
	12H	17.33	17.95	18.29	18.90	20.15	12.49	13.11	13.45	14.06	15.31
4H	2H	14.50	15.25	15.44	16.19	17.40	11.04	11.78	11.98	12.72	13.94
	3H	16.31	16.93	17.27	17.90	19.13	12.37	12.99	13.32	13.96	15.19
	4H	16.99	17.56	17.95	18.52	19.78	12.90	13.47	13.86	14.43	15.69
	6H	17.49	17.98	18.47	18.97	20.22	13.31	13.79	14.28	14.78	16.03
	8H	17.66	18.11	18.63	19.09	20.36	13.43	13.88	14.40	14.86	16.13
	12H	17.74	18.15	18.74	19.15	20.42	13.48	13.89	14.48	14.89	16.16
8H	4H	16.96	17.42	17.94	18.39	19.66	13.18	13.63	14.15	14.61	15.88
	6H	17.51	17.88	18.51	18.90	20.17	13.67	14.05	14.67	15.07	16.34
	8H	17.71	18.04	18.72	19.05	20.34	13.85	14.18	14.86	15.19	16.47
	12H	17.84	18.13	18.85	19.13	20.46	13.96	14.25	14.97	15.25	16.58
12H	4H	16.91	17.32	17.91	18.32	19.59	13.18	13.59	14.17	14.59	15.86
	6H	17.48	17.81	18.49	18.82	20.11	13.72	14.05	14.72	15.06	16.34
	8H	17.69	17.98	18.70	18.98	20.32	13.91	14.20	14.92	15.21	16.54

END OF REPORT