

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908926

Luminaire Tested: DFN2DIP-SQ2F0-030D030US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908926
REPORT IS A COMBINATION OF REPORTS P899772 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D030US840-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5256.3 lumens
Efficiency: N/A
Efficacy: 114.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 45.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLLFLL

Luminous Intensity Polar Plot

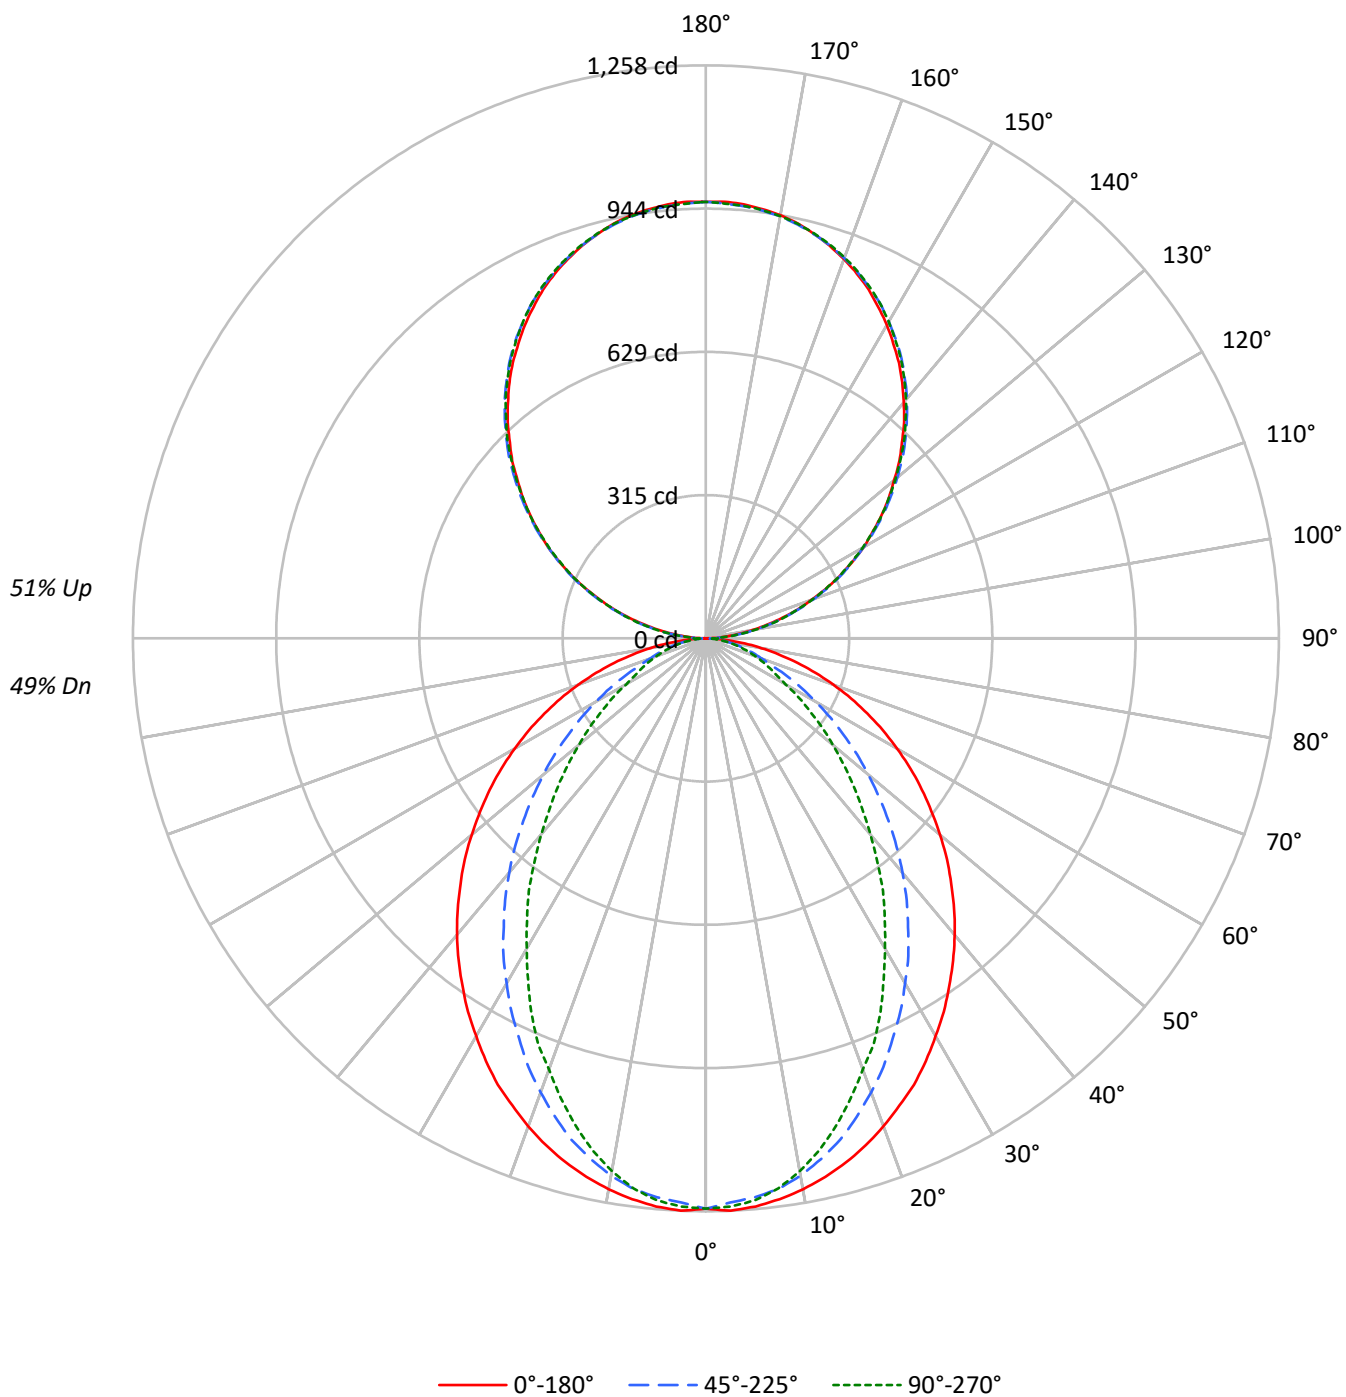

TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2753	2753	2753
5°	2753	2704	2723
10°	2721	2645	2631
15°	2679	2551	2490
20°	2624	2425	2319
25°	2569	2285	2154
30°	2496	2142	1946
35°	2424	1989	1763
40°	2350	1831	1555
45°	2266	1656	1365
50°	2178	1480	1181
55°	2085	1293	1004
60°	1978	1099	823
65°	1854	902	736
70°	1704	719	661
75°	1515	622	593
80°	1245	505	503
85°	810	313	358

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2266 cd/sqm

TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	117.4	2.2
10°-20°	322.1	6.1
20°-30°	452.3	8.6
30°-40°	493.0	9.4
40°-50°	453.1	8.6
50°-60°	355.9	6.8
60°-70°	231.6	4.4
70°-80°	119.2	2.3
80°-90°	33.2	0.6
90°-100°	59.3	1.1
100°-110°	188.4	3.6
110°-120°	322.4	6.1
120°-130°	424.0	8.1
130°-140°	475.9	9.1
140°-150°	466.7	8.9
150°-160°	391.5	7.4
160°-170°	259.6	4.9
170°-180°	90.7	1.7
0°-30°	891.8	17.0
0°-40°	1384.8	26.3
0°-60°	2193.8	41.7
0°-90°	2577.8	49.0
90°-120°	570.1	10.8
90°-150°	1936.6	36.8
90°-180°	2678.0	50.9
0°-180°	5256.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1252	1252	1252	1252	1252	
5°	1252	1246	1232	1242	1238	119
15°	1191	1178	1140	1118	1107	336
25°	1081	1045	970	924	906	497
35°	932	874	774	703	678	583
45°	762	686	567	486	459	588
55°	579	491	368	300	279	517
65°	391	299	197	159	155	388
75°	208	129	91	83	82	220
85°	49	25	22	22	22	56
90°	1	10	28	27	28	5
95°	42	50	52	52	50	47
105°	174	176	178	179	179	184
115°	324	328	327	326	324	320
125°	471	478	475	473	472	420
135°	609	618	619	618	616	470
145°	739	745	749	750	747	462
155°	845	847	850	854	851	389
165°	919	918	918	924	920	259
175°	956	954	952	958	953	91
180°	958	958	958	958	958	

TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1252.1	1252.1	1252.1	1252.1	1252.1
2.5°	1257.8	1252.1	1239.6	1251.0	1248.8
5°	1252.1	1246.5	1231.7	1241.9	1238.5
7.5°	1241.9	1235.2	1219.3	1223.8	1218.1
10°	1228.3	1220.4	1197.8	1194.3	1187.6
12.5°	1211.3	1201.1	1170.5	1163.8	1151.2
15°	1190.9	1178.4	1139.9	1118.4	1107.1
17.5°	1167.1	1149.0	1101.4	1076.5	1058.3
20°	1139.9	1117.2	1060.6	1032.4	1007.3
22.5°	1110.5	1084.4	1018.7	980.2	963.2
25°	1081.1	1044.7	970.0	923.5	906.5
27.5°	1045.9	1007.3	924.6	871.4	845.3
30°	1008.6	965.4	874.7	817.1	786.4
32.5°	972.2	920.1	827.3	759.2	730.8
35°	931.5	873.6	774.0	702.6	677.6
37.5°	891.8	829.4	724.1	645.8	617.6
40°	849.9	781.9	672.0	591.5	562.1
42.5°	806.8	734.4	619.9	535.9	507.7
45°	761.5	685.5	566.6	486.0	458.9
47.5°	718.4	638.0	515.6	435.1	410.2
50°	670.9	590.4	465.7	387.5	363.8
52.5°	624.3	539.4	418.2	343.4	321.8
55°	579.0	490.6	368.2	300.3	278.8
57.5°	532.6	441.9	324.2	260.6	242.5
60°	484.9	394.4	277.6	219.8	201.8
62.5°	438.6	347.9	237.9	183.6	174.6
65°	390.9	299.1	197.1	158.6	155.2
67.5°	345.7	253.8	158.6	139.4	135.9
70°	298.0	209.6	131.4	120.1	115.5
72.5°	252.7	168.7	109.9	100.9	98.6
75°	208.4	129.2	90.7	82.7	81.6
77.5°	164.3	91.7	71.4	66.9	64.5
80°	123.5	65.7	54.3	49.9	49.9
82.5°	86.0	44.2	37.4	35.1	35.1
85°	48.7	24.8	21.5	21.5	21.5
87.5°	18.2	9.0	9.0	8.0	8.0
90°	0.9	10.4	28.3	26.6	27.5
92.5°	17.9	24.2	25.1	26.0	26.0
95°	42.2	50.3	51.7	51.7	50.3
97.5°	70.2	77.7	80.9	80.9	80.9
100°	102.5	109.2	111.5	111.5	110.7
102.5°	136.6	141.6	144.7	145.6	144.7
105°	173.9	176.2	177.9	179.4	179.4
107.5°	210.9	214.3	214.3	214.9	210.9
110°	246.7	251.4	251.4	251.4	249.0



TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	285.4	290.3	289.4	287.1	285.4
115°	323.6	328.1	326.7	325.9	323.6
117.5°	361.3	367.7	363.7	361.3	359.0
120°	399.5	405.9	399.5	399.5	396.9
122.5°	434.1	442.2	438.2	435.9	434.1
125°	470.6	477.8	475.4	472.8	472.0
127.5°	506.0	515.0	511.9	508.4	506.0
130°	539.3	549.7	548.3	546.5	543.3
132.5°	576.5	584.6	585.2	581.2	578.9
135°	608.6	617.5	619.4	618.4	616.1
137.5°	644.4	651.7	653.1	652.6	649.0
140°	675.9	683.2	687.2	687.2	684.0
142.5°	708.3	715.5	717.8	718.7	715.5
145°	738.9	744.7	749.3	750.1	747.0
147.5°	766.4	773.6	777.0	778.5	775.3
150°	794.7	799.6	802.7	805.4	802.7
152.5°	819.8	824.7	828.7	831.9	828.7
155°	845.0	847.2	849.8	853.8	851.3
157.5°	866.6	868.3	869.8	875.6	871.5
160°	886.0	887.7	888.6	893.4	890.0
162.5°	903.8	903.8	904.7	910.2	906.2
165°	919.2	918.3	918.3	924.0	920.0
167.5°	933.0	930.4	930.4	936.1	932.1
170°	943.4	941.1	940.3	946.0	941.1
172.5°	950.6	948.4	947.5	953.2	948.4
175°	956.4	954.1	952.4	958.2	953.2
177.5°	959.6	957.3	955.5	960.5	955.5
180°	958.2	958.2	958.2	958.2	958.2

TEST NUMBER: P908926

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US840-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.46	11.28	11.43	12.26	13.55	6.42	7.24	7.39	8.22	9.51
	3H	12.12	12.85	13.10	13.84	15.15	7.59	8.32	8.57	9.31	10.62
	4H	12.71	13.41	13.71	14.40	15.72	8.03	8.72	9.02	9.72	11.03
	6H	13.12	13.76	14.12	14.76	16.09	8.33	8.97	9.34	9.97	11.30
	8H	13.23	13.84	14.25	14.86	16.18	8.41	9.02	9.42	10.04	11.36
	12H	13.29	13.87	14.30	14.87	16.23	8.45	9.03	9.46	10.03	11.38
4H	2H	10.47	11.17	11.47	12.16	13.48	7.00	7.70	8.00	8.69	10.01
	3H	12.28	12.85	13.29	13.88	15.21	8.33	8.91	9.34	9.93	11.26
	4H	12.95	13.48	13.97	14.50	15.85	8.86	9.39	9.88	10.41	11.76
	6H	13.45	13.90	14.48	14.94	16.29	9.26	9.72	10.29	10.76	12.11
	8H	13.61	14.04	14.64	15.07	16.43	9.38	9.80	10.41	10.84	12.20
	12H	13.70	14.08	14.75	15.13	16.50	9.43	9.82	10.48	10.86	12.23
8H	4H	12.92	13.34	13.95	14.37	15.74	9.13	9.55	10.16	10.59	11.95
	6H	13.46	13.81	14.51	14.88	16.25	9.62	9.97	10.68	11.05	12.41
	8H	13.66	13.97	14.73	15.03	16.41	9.80	10.11	10.86	11.17	12.55
	12H	13.79	14.06	14.85	15.11	16.54	9.91	10.18	10.97	11.23	12.65
12H	4H	12.87	13.25	13.92	14.30	15.67	9.13	9.51	10.18	10.56	11.93
	6H	13.43	13.74	14.50	14.80	16.18	9.67	9.98	10.73	11.04	12.42
	8H	13.64	13.91	14.70	14.96	16.39	9.86	10.13	10.93	11.19	12.61

END OF REPORT