

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908933

Luminaire Tested: DFN2DIP-SQ2F0-030D050US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908933
REPORT IS A COMBINATION OF REPORTS P901315 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D050US840-FLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7998.2 lumens
Efficiency: N/A
Efficacy: 132.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 60.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLLONL

Luminous Intensity Polar Plot

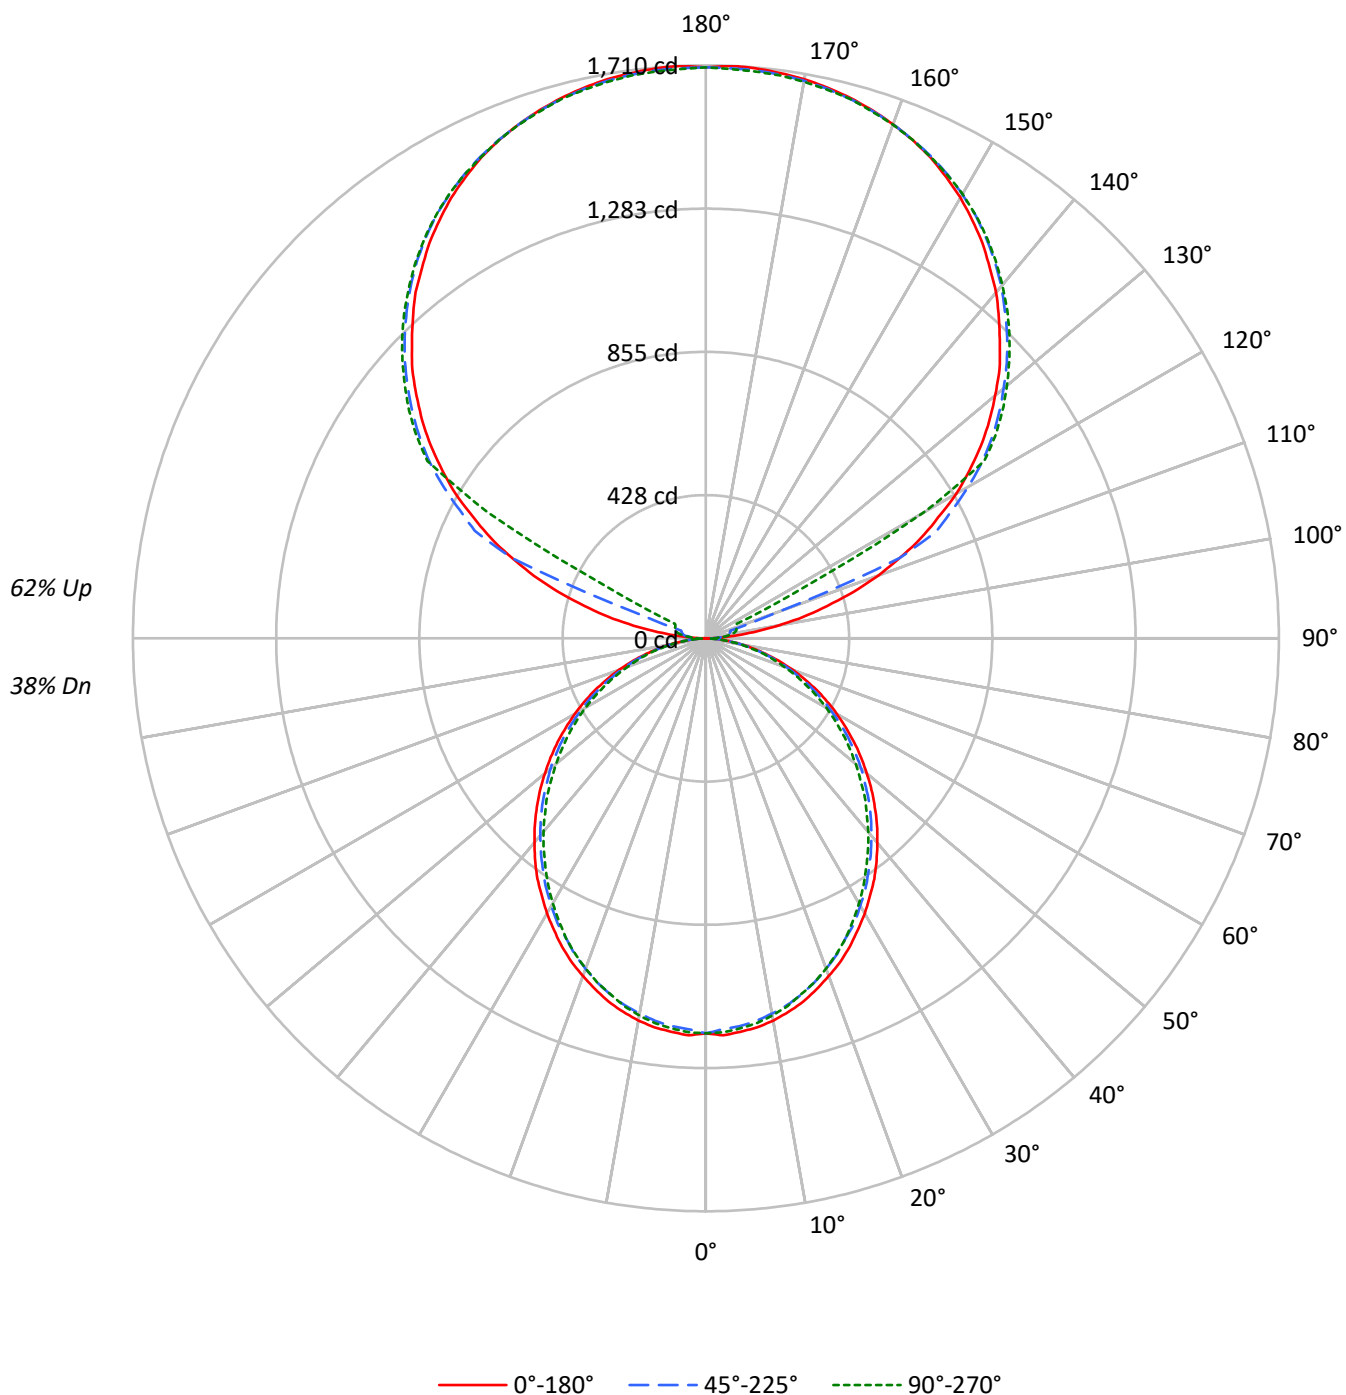

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2592	2592	2592
5°	2592	2550	2569
10°	2566	2510	2531
15°	2524	2464	2473
20°	2469	2400	2414
25°	2413	2326	2346
30°	2345	2257	2261
35°	2280	2176	2171
40°	2201	2094	2085
45°	2122	2011	1997
50°	2035	1924	1895
55°	1944	1824	1801
60°	1840	1706	1693
65°	1727	1582	1565
70°	1582	1432	1426
75°	1384	1252	1294
80°	1143	1021	1051
85°	774	644	660

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2122 cd/sqm

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.4
10°-20°	312.2	3.9
20°-30°	458.8	5.7
30°-40°	532.8	6.7
40°-50°	532.2	6.7
50°-60°	464.1	5.8
60°-70°	343.1	4.3
70°-80°	194.1	2.4
80°-90°	54.2	0.7
90°-100°	56.2	0.7
100°-110°	209.5	2.6
110°-120°	555.6	6.9
120°-130°	921.4	11.5
130°-140°	978.8	12.2
140°-150°	909.7	11.4
150°-160°	731.3	9.1
160°-170°	471.2	5.9
170°-180°	162.2	2.0
0°-30°	881.9	11.0
0°-40°	1414.7	17.7
0°-60°	2411.0	30.1
0°-90°	3002.3	37.5
90°-120°	821.2	10.3
90°-150°	3631.1	45.4
90°-180°	4996.0	62.5
0°-180°	7998.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	1	15	25	31	33	7
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P908933

CATALOG NUMBER: DFN2DIP-SQ2F0-030D050US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.19	9.95	10.25	11.01	12.45	8.75	9.51	9.80	10.57	12.00
	3H	10.82	11.50	11.89	12.57	14.03	10.33	11.01	11.40	12.08	13.54
	4H	11.39	12.04	12.47	13.11	14.57	10.90	11.55	11.98	12.62	14.08
	6H	11.77	12.37	12.86	13.44	14.92	11.27	11.87	12.36	12.94	14.42
	8H	11.87	12.43	12.96	13.52	14.99	11.37	11.93	12.46	13.02	14.49
	12H	11.91	12.44	13.00	13.53	15.02	11.40	11.93	12.49	13.02	14.51
4H	2H	9.63	10.27	10.71	11.35	12.81	9.27	9.92	10.36	10.99	12.45
	3H	11.46	12.00	12.55	13.10	14.58	11.05	11.59	12.15	12.69	14.17
	4H	12.16	12.65	13.25	13.74	15.24	11.73	12.23	12.83	13.32	14.81
	6H	12.65	13.07	13.75	14.18	15.67	12.22	12.64	13.32	13.75	15.24
	8H	12.79	13.18	13.89	14.29	15.79	12.35	12.74	13.45	13.85	15.36
	12H	12.84	13.20	13.97	14.32	15.83	12.40	12.75	13.52	13.87	15.38
8H	4H	12.33	12.73	13.44	13.83	15.34	11.96	12.35	13.06	13.46	14.96
	6H	12.94	13.26	14.06	14.41	15.91	12.55	12.88	13.68	14.02	15.53
	8H	13.14	13.43	14.28	14.56	16.08	12.75	13.04	13.88	14.16	15.69
	12H	13.26	13.51	14.39	14.63	16.19	12.85	13.10	13.98	14.22	15.78
12H	4H	12.31	12.67	13.43	13.79	15.30	11.94	12.30	13.06	13.42	14.93
	6H	12.96	13.25	14.09	14.37	15.90	12.59	12.87	13.72	14.00	15.52
	8H	13.18	13.43	14.32	14.56	16.12	12.80	13.05	13.94	14.18	15.74

END OF REPORT