

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908944

Luminaire Tested: DFN2DIP-SQ2F0-030D080US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908944
REPORT IS A COMBINATION OF REPORTS P899831 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D080US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10149.2 lumens
Efficiency: N/A
Efficacy: 115.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 88
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFLL

Luminous Intensity Polar Plot

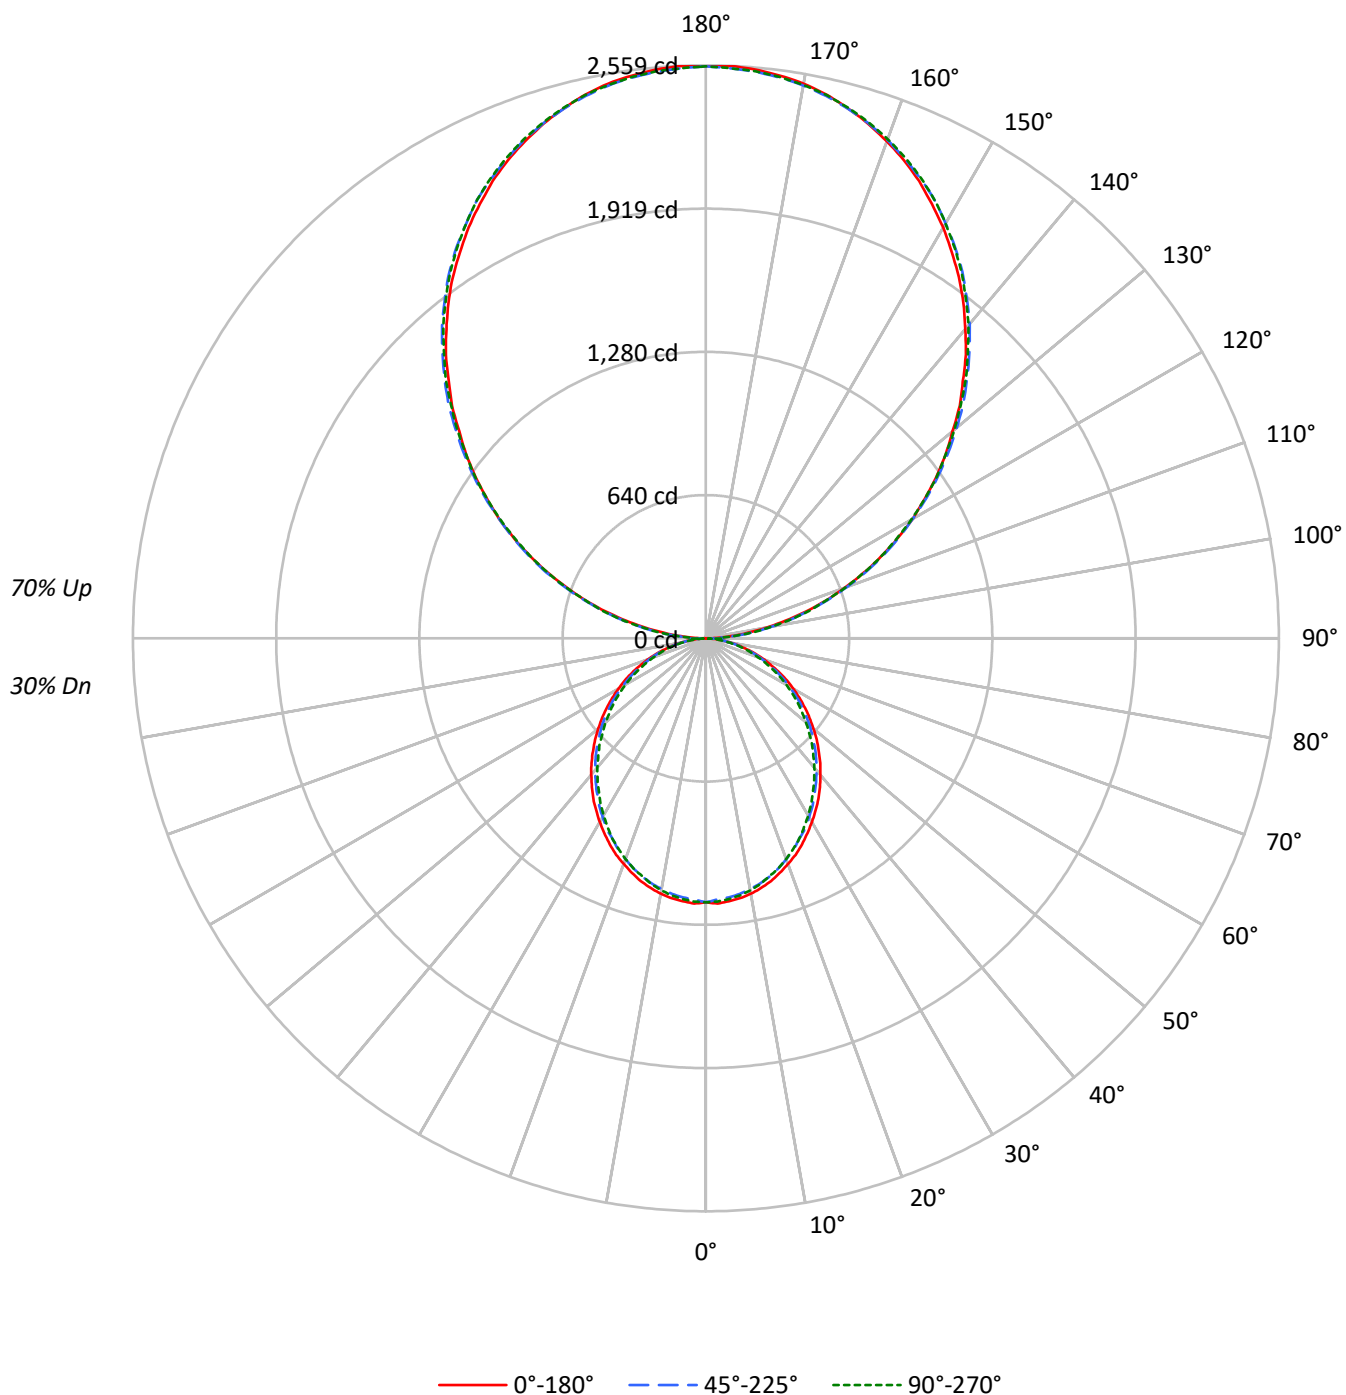

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	37	37	37
1	93	89	85	82	83	80	77	74	63	61	59	47	46	45	33	32	32
2	85	78	72	67	76	70	65	61	55	52	49	42	39	37	29	28	27
3	77	68	61	56	69	61	55	51	49	44	41	37	34	32	26	24	23
4	71	60	53	47	63	54	48	43	43	38	35	33	30	27	23	21	19
5	65	54	46	40	58	48	42	37	38	34	30	29	26	23	21	19	17
6	60	48	40	34	53	43	37	32	35	30	26	26	23	20	19	17	15
7	55	43	35	30	49	39	32	28	31	26	23	24	20	18	17	15	13
8	51	39	32	26	46	35	29	24	28	24	20	22	18	16	16	13	12
9	47	35	28	23	42	32	26	22	26	21	18	20	17	14	14	12	11
10	44	32	25	21	40	29	23	19	24	19	16	18	15	13	13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2592	2592	2592
5°	2592	2550	2569
10°	2566	2510	2531
15°	2524	2464	2473
20°	2469	2400	2414
25°	2413	2326	2346
30°	2345	2257	2261
35°	2280	2176	2171
40°	2201	2094	2085
45°	2122	2011	1997
50°	2035	1924	1895
55°	1944	1824	1801
60°	1840	1706	1693
65°	1727	1582	1565
70°	1582	1432	1426
75°	1384	1252	1294
80°	1143	1021	1051
85°	774	644	660

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3561 cd/sqm

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.1
10°-20°	312.2	3.1
20°-30°	458.8	4.5
30°-40°	532.8	5.3
40°-50°	532.2	5.2
50°-60°	464.1	4.6
60°-70°	343.1	3.4
70°-80°	194.1	1.9
80°-90°	58.5	0.6
90°-100°	158.1	1.6
100°-110°	502.4	4.9
110°-120°	859.7	8.5
120°-130°	1130.6	11.1
130°-140°	1269.1	12.5
140°-150°	1244.5	12.3
150°-160°	1043.9	10.3
160°-170°	692.3	6.8
170°-180°	242.0	2.4
0°-30°	881.9	8.7
0°-40°	1414.7	13.9
0°-60°	2411.0	23.8
0°-90°	3006.6	29.6
90°-120°	1520.1	15.0
90°-150°	5164.3	50.9
90°-180°	7143.0	70.4
0°-180°	10149.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	2	28	76	71	73	10
95°	112	134	138	138	134	125
105°	464	470	474	478	478	489
115°	863	875	871	869	863	853
125°	1255	1274	1268	1261	1259	1121
135°	1623	1647	1652	1649	1643	1254
145°	1970	1986	1998	2000	1992	1231
155°	2253	2259	2266	2277	2270	1037
165°	2451	2449	2449	2464	2453	691
175°	2550	2544	2540	2555	2542	242
180°	2555	2555	2555	2555	2555	

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	2.3	27.8	75.5	70.9	73.2
92.5°	47.8	64.7	67.1	69.3	69.3
95°	112.5	134.0	137.8	137.8	134.0
97.5°	187.2	207.2	215.7	215.7	215.7
100°	273.5	291.1	297.3	297.3	295.0
102.5°	364.4	377.5	385.9	388.2	385.9
105°	463.7	469.9	474.5	478.4	478.4
107.5°	562.3	571.6	571.6	573.1	562.3
110°	657.8	670.1	670.1	670.1	664.0

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	761.0	774.2	771.8	765.7	761.0
115°	862.7	875.0	871.2	868.9	862.7
117.5°	963.6	980.6	969.8	963.6	957.5
120°	1065.3	1082.3	1065.3	1065.3	1058.3
122.5°	1157.7	1179.3	1168.5	1162.4	1157.7
125°	1254.8	1274.0	1267.9	1260.9	1258.7
127.5°	1349.6	1373.4	1364.9	1355.7	1349.6
130°	1438.1	1465.8	1462.0	1457.4	1449.0
132.5°	1537.5	1559.0	1560.6	1549.8	1543.7
135°	1623.0	1646.9	1651.5	1649.2	1643.1
137.5°	1718.5	1737.8	1741.6	1740.1	1730.8
140°	1802.5	1821.7	1832.5	1832.5	1824.0
142.5°	1888.8	1908.0	1914.2	1916.5	1908.0
145°	1970.4	1985.8	1998.1	2000.4	1992.0
147.5°	2043.6	2062.9	2072.0	2076.0	2067.5
150°	2119.1	2132.1	2140.6	2147.6	2140.6
152.5°	2186.1	2199.2	2210.0	2218.5	2210.0
155°	2253.1	2259.3	2266.2	2276.9	2270.1
157.5°	2310.9	2315.5	2319.4	2334.7	2324.0
160°	2362.5	2367.1	2369.4	2382.5	2373.3
162.5°	2410.2	2410.2	2412.6	2427.2	2416.4
165°	2451.0	2448.7	2448.7	2464.2	2453.4
167.5°	2488.0	2481.1	2481.1	2496.5	2485.7
170°	2515.8	2509.6	2507.3	2522.7	2509.6
172.5°	2535.1	2528.9	2526.6	2541.9	2528.9
175°	2550.4	2544.3	2539.6	2555.1	2541.9
177.5°	2558.9	2552.7	2548.1	2561.2	2548.1
180°	2555.1	2555.1	2555.1	2555.1	2555.1

TEST NUMBER: P908944

CATALOG NUMBER: DFN2DIP-SQ2F0-030D080US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.20	8.90	9.31	10.01	11.55	7.75	8.46	8.87	9.57	11.10
	3H	9.83	10.46	10.95	11.57	13.13	9.34	9.97	10.46	11.08	12.64
	4H	10.39	10.99	11.53	12.11	13.67	9.90	10.50	11.03	11.62	13.17
	6H	10.77	11.32	11.91	12.44	14.01	10.27	10.82	11.41	11.94	13.51
	8H	10.86	11.39	12.01	12.52	14.08	10.36	10.89	11.51	12.02	13.58
	12H	10.90	11.40	12.05	12.53	14.11	10.39	10.89	11.54	12.02	13.60
4H	2H	8.63	9.23	9.77	10.34	11.90	8.27	8.87	9.41	9.99	11.55
	3H	10.46	10.96	11.60	12.10	13.67	10.05	10.55	11.19	11.69	13.26
	4H	11.15	11.61	12.30	12.74	14.33	10.72	11.18	11.87	12.32	13.91
	6H	11.64	12.03	12.79	13.19	14.77	11.20	11.60	12.36	12.75	14.33
	8H	11.77	12.14	12.93	13.29	14.88	11.34	11.70	12.49	12.85	14.45
	12H	11.83	12.16	13.00	13.32	14.92	11.38	11.71	12.55	12.87	14.47
8H	4H	11.32	11.69	12.47	12.84	14.43	10.94	11.31	12.10	12.46	14.05
	6H	11.92	12.23	13.10	13.41	15.01	11.54	11.84	12.71	13.03	14.62
	8H	12.13	12.39	13.31	13.56	15.17	11.73	12.00	12.91	13.17	14.78
	12H	12.24	12.47	13.42	13.64	15.28	11.83	12.06	13.01	13.23	14.87
12H	4H	11.30	11.63	12.47	12.79	14.39	10.93	11.26	12.10	12.42	14.02
	6H	11.95	12.21	13.12	13.38	14.99	11.57	11.84	12.75	13.00	14.62
	8H	12.16	12.40	13.35	13.56	15.21	11.78	12.02	12.97	13.18	14.83