

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908955

Luminaire Tested: DFN2DIP-SQ2F0-040D040US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908955
REPORT IS A COMBINATION OF REPORTS P901306 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D040US840-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7432.6 lumens
Efficiency: N/A
Efficacy: 117.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLLONL

Luminous Intensity Polar Plot

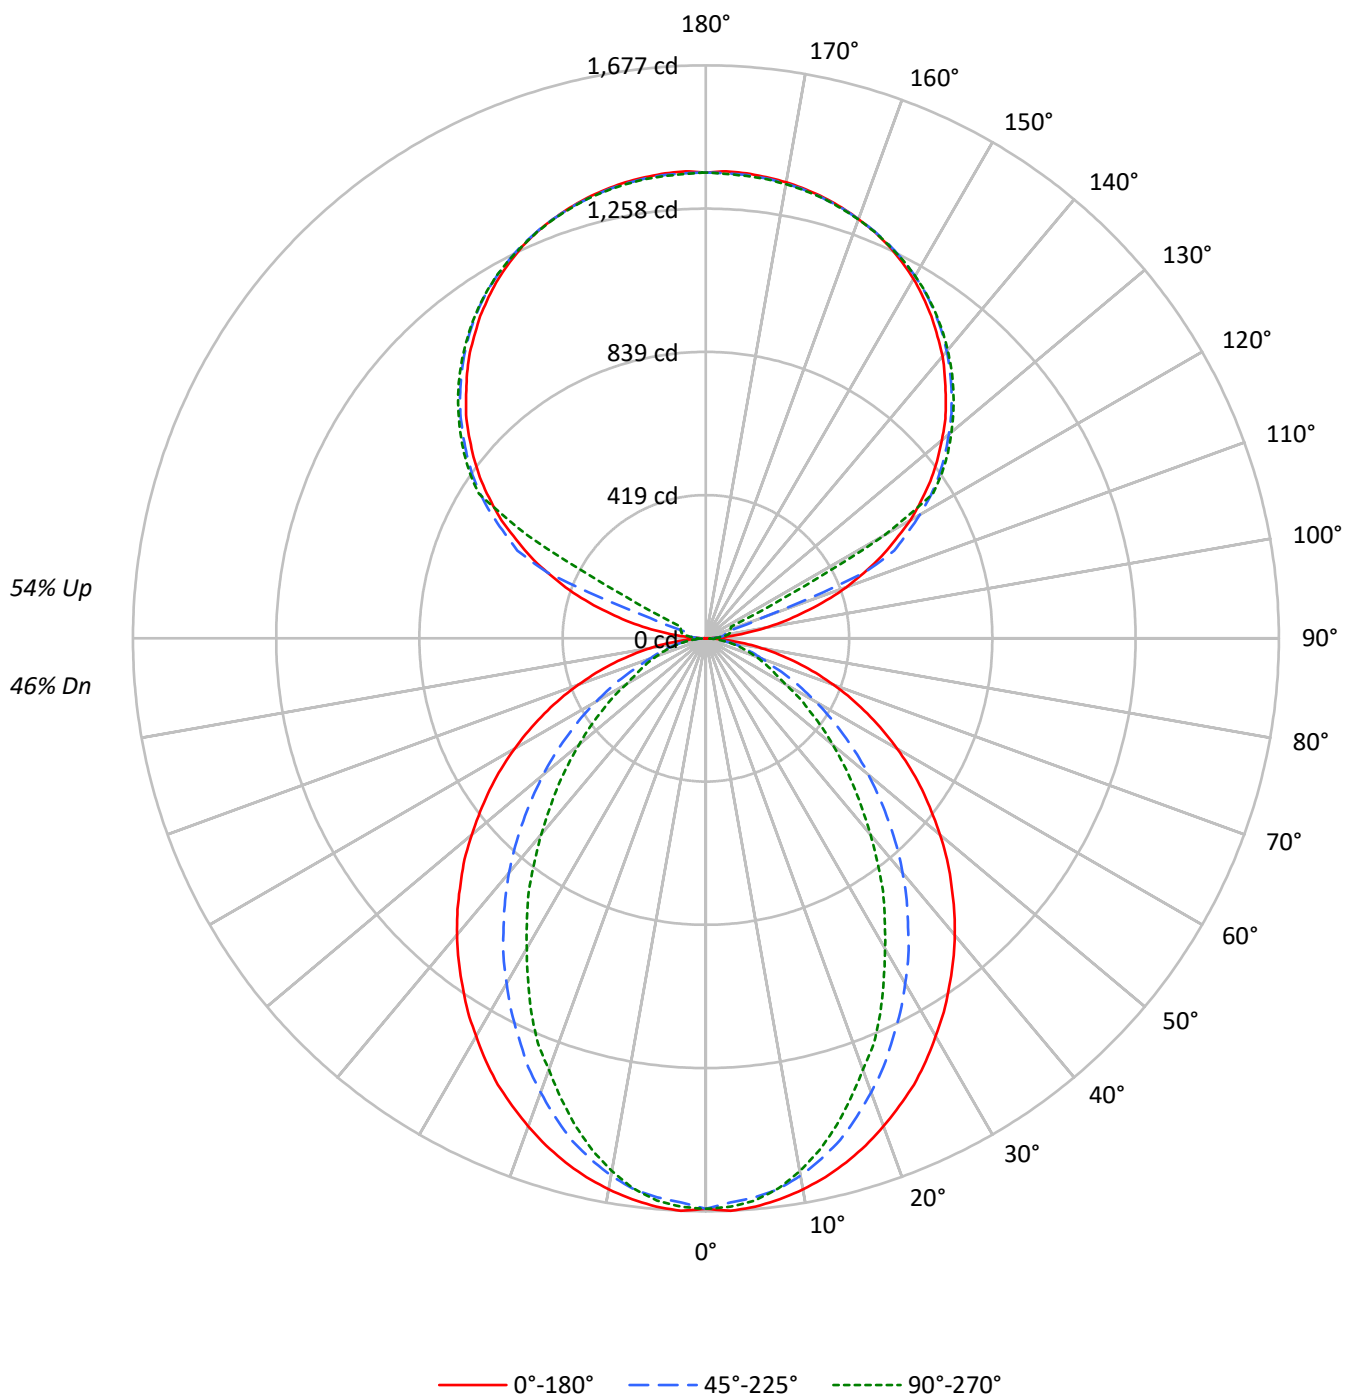

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3671	3671	3671
5°	3671	3605	3631
10°	3628	3526	3508
15°	3572	3402	3320
20°	3499	3234	3092
25°	3425	3047	2872
30°	3327	2856	2595
35°	3232	2652	2351
40°	3134	2441	2073
45°	3021	2208	1821
50°	2903	1974	1574
55°	2780	1725	1339
60°	2637	1465	1097
65°	2473	1203	981
70°	2273	958	881
75°	2020	829	792
80°	1659	673	671
85°	1080	418	477

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3021 cd/sqm

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.1
10°-20°	429.5	5.8
20°-30°	603.0	8.1
30°-40°	657.4	8.8
40°-50°	604.2	8.1
50°-60°	474.5	6.4
60°-70°	308.9	4.2
70°-80°	159.0	2.1
80°-90°	43.0	0.6
90°-100°	44.9	0.6
100°-110°	167.6	2.3
110°-120°	444.4	6.0
120°-130°	737.1	9.9
130°-140°	783.0	10.5
140°-150°	727.7	9.8
150°-160°	585.1	7.9
160°-170°	377.0	5.1
170°-180°	129.8	1.7
0°-30°	1189.0	16.0
0°-40°	1846.4	24.8
0°-60°	2925.1	39.4
0°-90°	3435.9	46.2
90°-120°	656.9	8.8
90°-150°	2904.8	39.1
90°-180°	3997.0	53.8
0°-180°	7432.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	12	20	25	27	7
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P908955

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.19	11.99	12.18	12.99	14.32	7.15	7.95	8.14	8.95	10.28
	3H	12.84	13.56	13.85	14.57	15.92	8.32	9.03	9.32	10.04	11.39
	4H	13.44	14.11	14.46	15.13	16.48	8.75	9.43	9.77	10.44	11.80
	6H	13.84	14.46	14.87	15.48	16.85	9.06	9.68	10.08	10.70	12.07
	8H	13.96	14.55	14.99	15.59	16.95	9.14	9.73	10.17	10.76	12.13
	12H	14.01	14.57	15.05	15.60	16.99	9.17	9.73	10.21	10.76	12.15
4H	2H	11.20	11.87	12.22	12.89	14.24	7.73	8.41	8.75	9.42	10.78
	3H	13.00	13.56	14.03	14.61	15.98	9.06	9.62	10.09	10.66	12.03
	4H	13.68	14.19	14.72	15.23	16.62	9.59	10.10	10.63	11.14	12.53
	6H	14.17	14.61	15.22	15.67	17.06	9.99	10.43	11.04	11.49	12.87
	8H	14.34	14.75	15.39	15.80	17.20	10.10	10.52	11.15	11.57	12.97
	12H	14.42	14.79	15.49	15.86	17.26	10.16	10.53	11.23	11.59	13.00
8H	4H	13.64	14.05	14.69	15.10	16.50	9.85	10.27	10.90	11.32	12.72
	6H	14.18	14.52	15.26	15.61	17.01	10.35	10.69	11.42	11.78	13.18
	8H	14.38	14.68	15.47	15.76	17.18	10.52	10.82	11.60	11.90	13.32
	12H	14.51	14.77	15.59	15.84	17.30	10.63	10.89	11.71	11.96	13.42
12H	4H	13.59	13.96	14.66	15.03	16.43	9.85	10.23	10.92	11.29	12.70
	6H	14.15	14.45	15.24	15.53	16.95	10.39	10.69	11.47	11.77	13.19
	8H	14.36	14.62	15.44	15.69	17.15	10.58	10.85	11.67	11.92	13.38

END OF REPORT