

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909011

Luminaire Tested: DFN2DIP-SQ2F0-060D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909011
REPORT IS A COMBINATION OF REPORTS P901334 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D060US840-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11148.9 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLLONL

Luminous Intensity Polar Plot

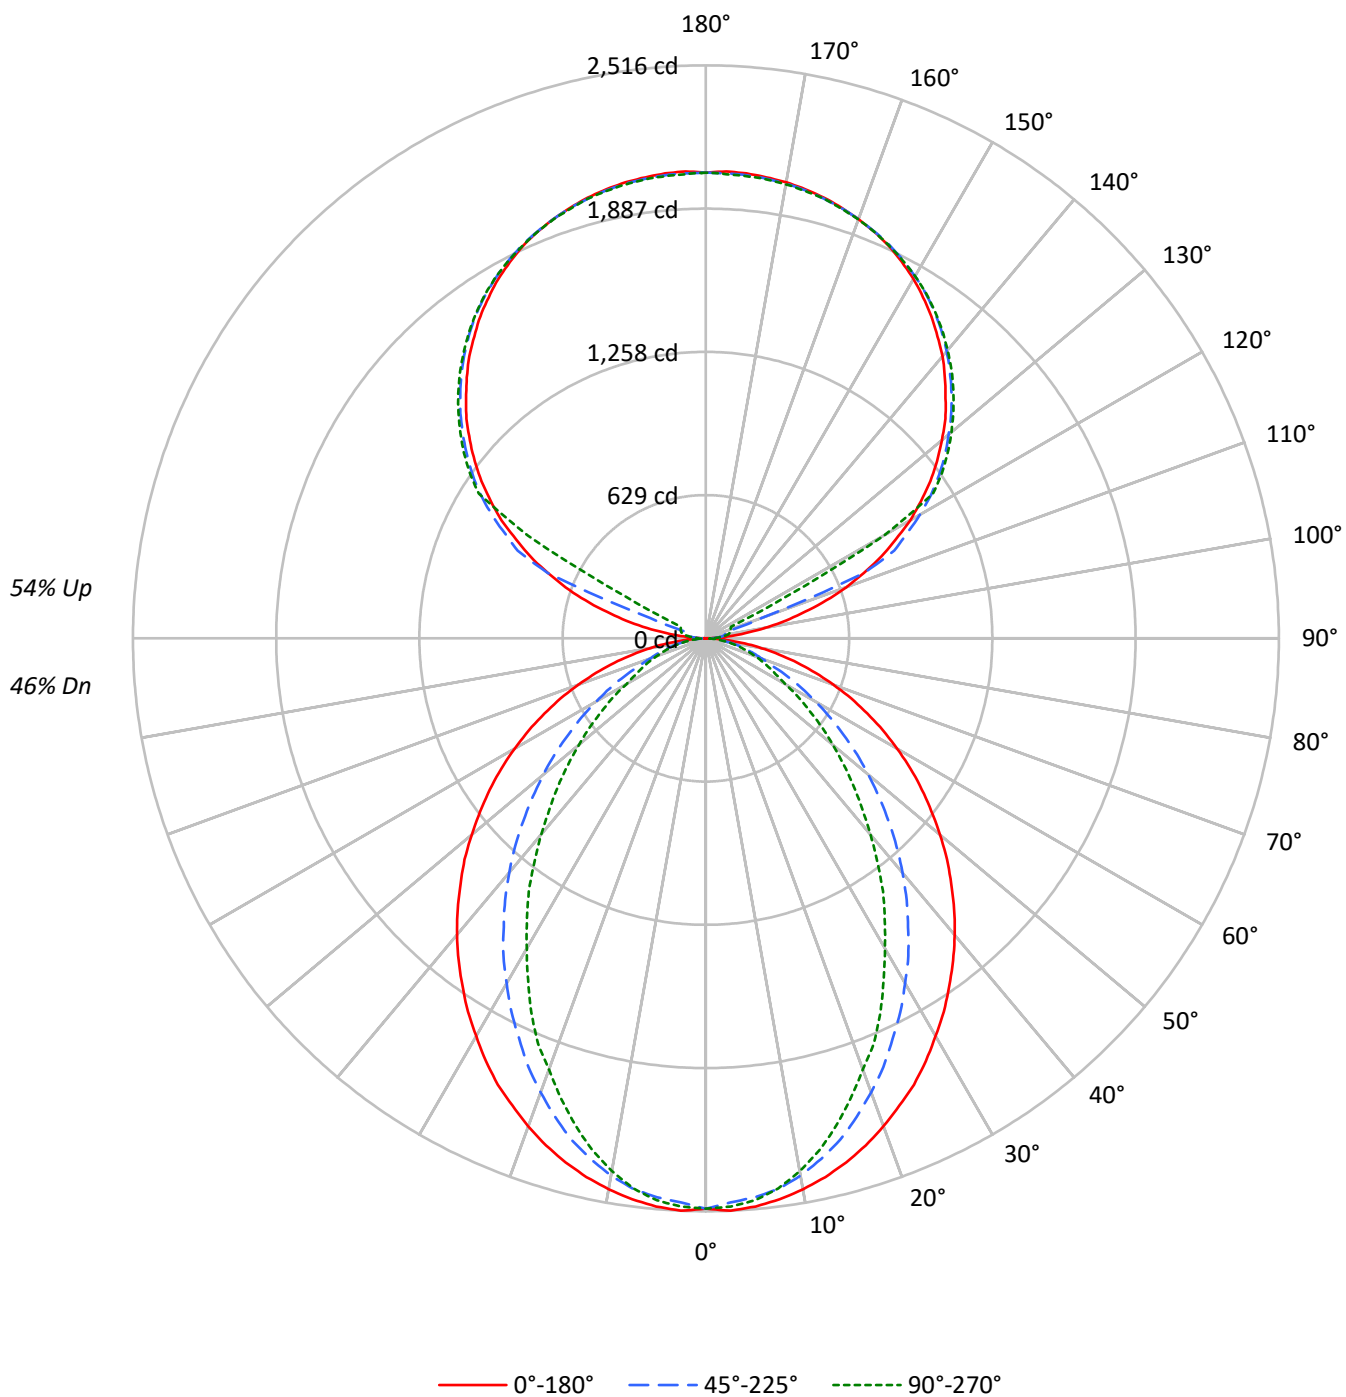

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5507	5507	5507
5°	5506	5407	5446
10°	5442	5289	5261
15°	5357	5103	4980
20°	5249	4851	4638
25°	5137	4571	4308
30°	4991	4284	3892
35°	4848	3977	3526
40°	4701	3661	3109
45°	4531	3312	2731
50°	4355	2961	2362
55°	4170	2587	2008
60°	3956	2198	1645
65°	3709	1805	1472
70°	3408	1437	1322
75°	3031	1244	1187
80°	2489	1010	1006
85°	1620	627	715

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4531 cd/sqm

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	234.7	2.1
10°-20°	644.3	5.8
20°-30°	904.6	8.1
30°-40°	986.1	8.8
40°-50°	906.3	8.1
50°-60°	711.7	6.4
60°-70°	463.3	4.2
70°-80°	238.5	2.1
80°-90°	64.5	0.6
90°-100°	67.4	0.6
100°-110°	251.4	2.3
110°-120°	666.7	6.0
120°-130°	1105.7	9.9
130°-140°	1174.5	10.5
140°-150°	1091.6	9.8
150°-160°	877.6	7.9
160°-170°	565.5	5.1
170°-180°	194.6	1.7
0°-30°	1783.6	16.0
0°-40°	2769.6	24.8
0°-60°	4387.7	39.4
0°-90°	5153.9	46.2
90°-120°	985.5	8.8
90°-150°	4357.2	39.1
90°-180°	5995.0	53.8
0°-180°	11148.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2504	2504	2504	2504	2504	
5°	2504	2493	2463	2484	2477	237
15°	2382	2357	2280	2237	2214	671
25°	2162	2090	1940	1847	1813	994
35°	1863	1747	1548	1405	1355	1166
45°	1523	1371	1133	972	918	1176
55°	1158	981	736	601	558	1035
65°	782	598	394	317	310	775
75°	417	258	181	165	163	441
85°	97	50	43	43	43	112
90°	1	18	30	37	40	10
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2504.3	2504.3	2504.3	2504.3	2504.3
2.5°	2515.6	2504.3	2479.2	2502.0	2497.5
5°	2504.3	2493.0	2463.4	2483.9	2477.1
7.5°	2483.9	2470.3	2438.6	2447.5	2436.2
10°	2456.6	2440.7	2395.6	2388.6	2375.1
12.5°	2422.8	2402.3	2341.0	2327.5	2302.5
15°	2381.9	2356.8	2279.9	2236.9	2214.2
17.5°	2334.3	2297.9	2202.7	2152.9	2116.7
20°	2279.9	2234.4	2121.2	2064.7	2014.7
22.5°	2221.0	2168.8	2037.3	1960.4	1926.4
25°	2162.1	2089.5	1940.0	1847.1	1813.0
27.5°	2091.9	2014.7	1849.3	1742.7	1690.6
30°	2017.1	1930.8	1749.5	1634.1	1572.8
32.5°	1944.5	1840.2	1654.6	1518.4	1461.7
35°	1863.0	1747.4	1548.0	1405.1	1355.1
37.5°	1783.6	1658.8	1448.2	1291.7	1235.2
40°	1699.7	1563.9	1343.8	1183.0	1124.1
42.5°	1613.7	1468.6	1239.7	1071.9	1015.4
45°	1523.0	1371.0	1133.3	972.1	917.8
47.5°	1436.9	1276.1	1031.3	870.2	820.4
50°	1341.7	1180.8	931.5	775.0	727.6
52.5°	1248.6	1078.6	836.3	686.7	643.7
55°	1158.0	981.3	736.5	600.7	557.5
57.5°	1065.2	883.8	648.2	521.3	484.9
60°	970.0	788.7	555.2	439.8	403.4
62.5°	877.2	695.9	475.8	367.2	349.1
65°	781.9	598.2	394.4	317.4	310.4
67.5°	691.3	507.6	317.4	278.7	272.0
70°	596.0	419.3	262.8	240.2	231.1
72.5°	505.4	337.6	219.7	201.8	197.1
75°	417.0	258.2	181.3	165.4	163.3
77.5°	328.7	183.5	142.8	133.7	129.2
80°	246.9	131.5	108.7	99.8	99.8
82.5°	172.2	88.5	74.7	70.2	70.2
85°	97.4	49.8	43.0	43.0	43.0
87.5°	36.4	18.1	18.1	15.9	15.9
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909011

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.60	13.40	13.59	14.40	15.72	8.56	9.36	9.55	10.36	11.69
	3H	14.25	14.97	15.26	15.98	17.33	9.72	10.44	10.73	11.45	12.80
	4H	14.85	15.52	15.86	16.54	17.89	10.16	10.84	11.18	11.85	13.21
	6H	15.25	15.87	16.28	16.89	18.26	10.46	11.09	11.49	12.11	13.47
	8H	15.37	15.96	16.40	16.99	18.36	10.55	11.14	11.58	12.17	13.54
	12H	15.42	15.98	16.46	17.01	18.40	10.58	11.14	11.62	12.17	13.56
4H	2H	12.61	13.28	13.63	14.30	15.65	9.14	9.81	10.16	10.83	12.19
	3H	14.41	14.97	15.44	16.02	17.38	10.46	11.03	11.50	12.07	13.44
	4H	15.09	15.60	16.13	16.63	18.03	11.00	11.51	12.04	12.55	13.94
	6H	15.58	16.02	16.63	17.08	18.47	11.39	11.84	12.44	12.89	14.28
	8H	15.74	16.16	16.79	17.21	18.61	11.51	11.92	12.56	12.97	14.38
	12H	15.83	16.20	16.90	17.26	18.67	11.56	11.94	12.63	13.00	14.41
8H	4H	15.05	15.46	16.10	16.51	17.91	11.26	11.67	12.31	12.72	14.13
	6H	15.59	15.93	16.66	17.02	18.42	11.75	12.10	12.83	13.19	14.59
	8H	15.79	16.09	16.87	17.17	18.59	11.93	12.23	13.01	13.31	14.73
	12H	15.92	16.18	17.00	17.25	18.71	12.03	12.30	13.12	13.37	14.83
12H	4H	15.00	15.37	16.06	16.43	17.84	11.26	11.63	12.33	12.70	14.11
	6H	15.56	15.86	16.64	16.94	18.36	11.80	12.10	12.88	13.17	14.59
	8H	15.77	16.03	16.85	17.10	18.56	11.99	12.25	13.08	13.33	14.79