

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909024

Luminaire Tested: DFN2DIP-SQ2F0-070D040US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909024
REPORT IS A COMBINATION OF REPORTS P899791 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D040US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10573.3 lumens
Efficiency: N/A
Efficacy: 108.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 97.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFLL

Luminous Intensity Polar Plot

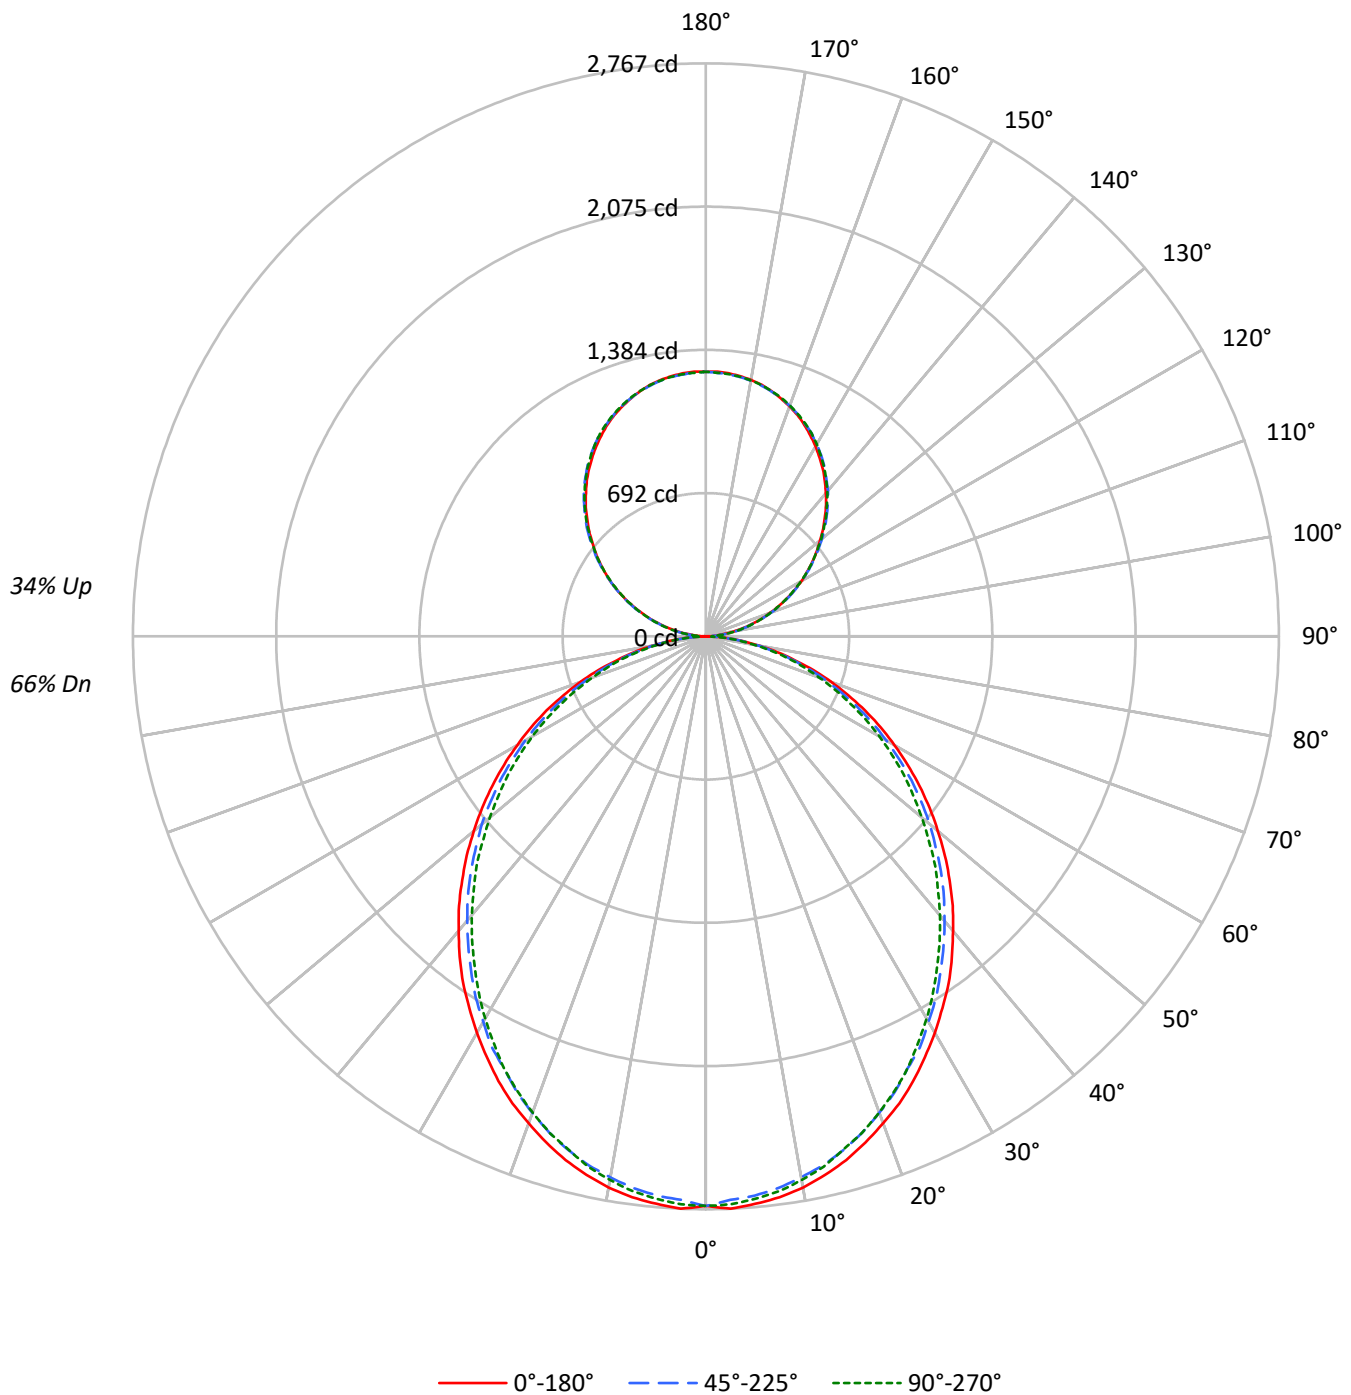

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92		81	81	81		71
1	101	97	93	89	95	91	88	85	81	78	76		72	70	68		63
2	92	85	78	73	87	80	74	70	71	67	63		63	60	57		55
3	84	75	67	61	79	70	64	58	63	57	53		56	51	48		49
4	77	66	58	52	72	63	55	50	56	50	45		50	45	41		44
5	71	59	51	44	67	56	48	43	50	44	39		45	40	36		40
6	65	53	45	39	61	50	43	37	45	39	34		40	35	31		36
7	61	48	40	34	57	46	38	33	41	35	30		37	32	28		33
8	56	44	36	30	53	42	34	29	38	31	27		34	29	25		30
9	53	40	32	27	49	38	31	26	34	28	24		31	26	22		28
10	49	37	29	24	46	35	28	24	32	26	22		29	24	20		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6048	6048	6048
5°	6047	5951	5996
10°	5988	5857	5906
15°	5890	5748	5771
20°	5760	5601	5633
25°	5631	5428	5474
30°	5472	5266	5275
35°	5320	5077	5065
40°	5135	4885	4864
45°	4950	4692	4659
50°	4748	4489	4421
55°	4534	4256	4201
60°	4293	3980	3949
65°	4028	3692	3651
70°	3691	3341	3328
75°	3229	2920	3020
80°	2667	2384	2452
85°	1803	1506	1540

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4950 cd/sqm

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	2.4
10°-20°	728.4	6.9
20°-30°	1070.5	10.1
30°-40°	1243.3	11.8
40°-50°	1241.7	11.7
50°-60°	1082.8	10.2
60°-70°	800.4	7.6
70°-80°	452.9	4.3
80°-90°	123.2	1.2
90°-100°	79.1	0.7
100°-110°	251.2	2.4
110°-120°	429.8	4.1
120°-130°	565.3	5.3
130°-140°	634.5	6.0
140°-150°	622.2	5.9
150°-160°	522.0	4.9
160°-170°	346.2	3.3
170°-180°	121.0	1.1
0°-30°	2057.8	19.5
0°-40°	3301.1	31.2
0°-60°	5625.6	53.2
0°-90°	7002.0	66.2
90°-120°	760.1	7.2
90°-150°	2582.2	24.4
90°-180°	3571.0	33.8
0°-180°	10573.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	1	14	38	35	37	10
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P909024

CATALOG NUMBER: DFN2DIP-SQ2F0-070D040US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.79	15.81	15.59	16.64	17.66	14.34	15.37	15.15	16.20	17.22
	3H	16.44	17.36	17.26	18.20	19.25	15.95	16.87	16.77	17.71	18.76
	4H	17.02	17.89	17.86	18.74	19.80	16.53	17.40	17.36	18.24	19.30
	6H	17.41	18.22	18.26	19.07	20.14	16.91	17.72	17.76	18.57	19.64
	8H	17.52	18.28	18.37	19.15	20.23	17.02	17.78	17.87	18.65	19.73
	12H	17.56	18.30	18.43	19.16	20.26	17.06	17.79	17.92	18.65	19.75
4H	2H	15.26	16.13	16.09	16.97	18.03	14.90	15.77	15.74	16.62	17.68
	3H	17.11	17.84	17.96	18.72	19.79	16.71	17.43	17.56	18.31	19.39
	4H	17.82	18.48	18.68	19.36	20.46	17.40	18.06	18.26	18.93	20.03
	6H	18.33	18.90	19.20	19.80	20.90	17.89	18.47	18.77	19.37	20.47
	8H	18.47	19.01	19.35	19.90	21.02	18.03	18.57	18.91	19.46	20.58
	12H	18.54	19.03	19.44	19.94	21.06	18.09	18.58	19.00	19.49	20.61
8H	4H	18.02	18.55	18.90	19.45	20.57	17.64	18.18	18.52	19.07	20.19
	6H	18.63	19.08	19.54	20.01	21.13	18.25	18.69	19.16	19.63	20.74
	8H	18.84	19.24	19.76	20.16	21.30	18.45	18.84	19.37	19.77	20.90
	12H	18.97	19.32	19.89	20.24	21.42	18.56	18.90	19.48	19.82	21.01
12H	4H	18.01	18.49	18.91	19.41	20.53	17.64	18.12	18.54	19.04	20.16
	6H	18.66	19.05	19.58	19.98	21.12	18.28	18.68	19.20	19.61	20.74
	8H	18.89	19.24	19.82	20.16	21.35	18.51	18.86	19.43	19.78	20.96

END OF REPORT