

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909037

Luminaire Tested: DFN2DIP-SQ2F0-070D070US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909037
REPORT IS A COMBINATION OF REPORTS P901347 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D070US840-FLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13996.8 lumens
Efficiency: N/A
Efficacy: 114.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLLONL

Luminous Intensity Polar Plot

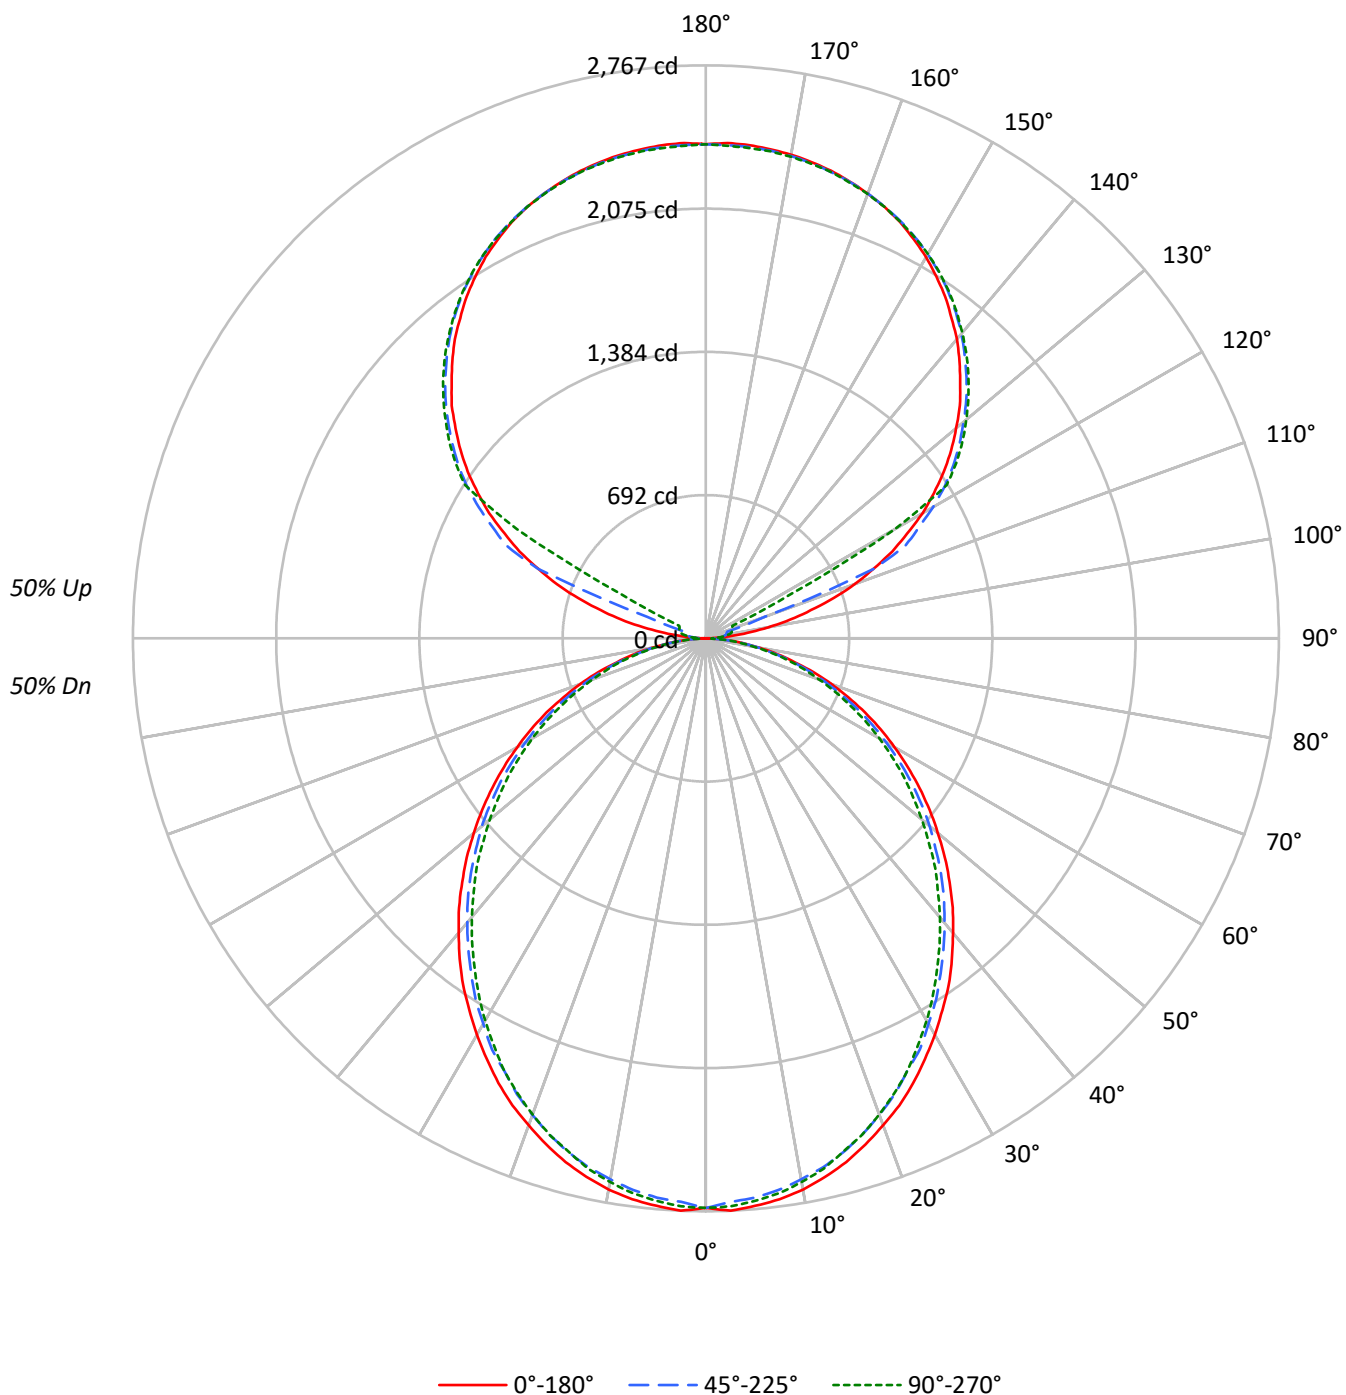

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6048	6048	6048
5°	6047	5951	5996
10°	5988	5857	5906
15°	5890	5748	5771
20°	5760	5601	5633
25°	5631	5428	5474
30°	5472	5266	5275
35°	5320	5077	5065
40°	5135	4885	4864
45°	4950	4692	4659
50°	4748	4489	4421
55°	4534	4256	4201
60°	4293	3980	3949
65°	4028	3692	3651
70°	3691	3341	3328
75°	3229	2920	3020
80°	2667	2384	2452
85°	1803	1506	1540

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4950 cd/sqm

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	1.8
10°-20°	728.4	5.2
20°-30°	1070.5	7.6
30°-40°	1243.3	8.9
40°-50°	1241.7	8.9
50°-60°	1082.8	7.7
60°-70°	800.4	5.7
70°-80°	452.9	3.2
80°-90°	123.7	0.9
90°-100°	78.7	0.6
100°-110°	293.3	2.1
110°-120°	777.8	5.6
120°-130°	1290.0	9.2
130°-140°	1370.3	9.8
140°-150°	1273.5	9.1
150°-160°	1023.9	7.3
160°-170°	659.7	4.7
170°-180°	227.1	1.6
0°-30°	2057.8	14.7
0°-40°	3301.1	23.6
0°-60°	5625.6	40.2
0°-90°	7002.6	50.0
90°-120°	1149.7	8.2
90°-150°	5083.5	36.3
90°-180°	6994.0	50.0
0°-180°	13996.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	2	21	34	43	47	13
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P909037

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.41	14.27	14.37	15.25	16.52	12.97	13.83	13.92	14.80	16.07
	3H	15.05	15.83	16.02	16.81	18.10	14.56	15.34	15.53	16.32	17.61
	4H	15.63	16.36	16.61	17.35	18.65	15.13	15.87	16.12	16.85	18.15
	6H	16.01	16.69	17.01	17.68	18.99	15.51	16.19	16.51	17.18	18.49
	8H	16.11	16.75	17.11	17.76	19.07	15.61	16.25	16.61	17.26	18.57
	12H	16.15	16.76	17.16	17.76	19.10	15.64	16.25	16.65	17.26	18.59
4H	2H	13.86	14.59	14.85	15.58	16.88	13.51	14.24	14.50	15.22	16.53
	3H	15.71	16.32	16.70	17.33	18.65	15.30	15.91	16.30	16.92	18.24
	4H	16.41	16.96	17.41	17.97	19.31	15.98	16.54	16.99	17.55	18.89
	6H	16.90	17.38	17.92	18.41	19.75	16.47	16.95	17.49	17.98	19.32
	8H	17.04	17.49	18.06	18.52	19.87	16.60	17.05	17.62	18.08	19.43
	12H	17.11	17.51	18.14	18.55	19.91	16.66	17.06	17.69	18.10	19.46
8H	4H	16.59	17.04	17.61	18.06	19.41	16.21	16.66	17.23	17.68	19.04
	6H	17.20	17.57	18.24	18.63	19.98	16.81	17.18	17.85	18.25	19.60
	8H	17.41	17.73	18.46	18.78	20.15	17.01	17.34	18.06	18.39	19.76
	12H	17.52	17.81	18.58	18.86	20.27	17.11	17.40	18.17	18.45	19.86
12H	4H	16.57	16.98	17.61	18.02	19.37	16.20	16.61	17.24	17.65	19.00
	6H	17.22	17.55	18.27	18.60	19.97	16.85	17.18	17.90	18.23	19.59
	8H	17.45	17.74	18.50	18.78	20.19	17.07	17.36	18.12	18.40	19.81