

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909044

Luminaire Tested: DFN2DIP-SQ2F0-080D030US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909044
REPORT IS A COMBINATION OF REPORTS P899781 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D030US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10679.4 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 101.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

Luminous Intensity Polar Plot

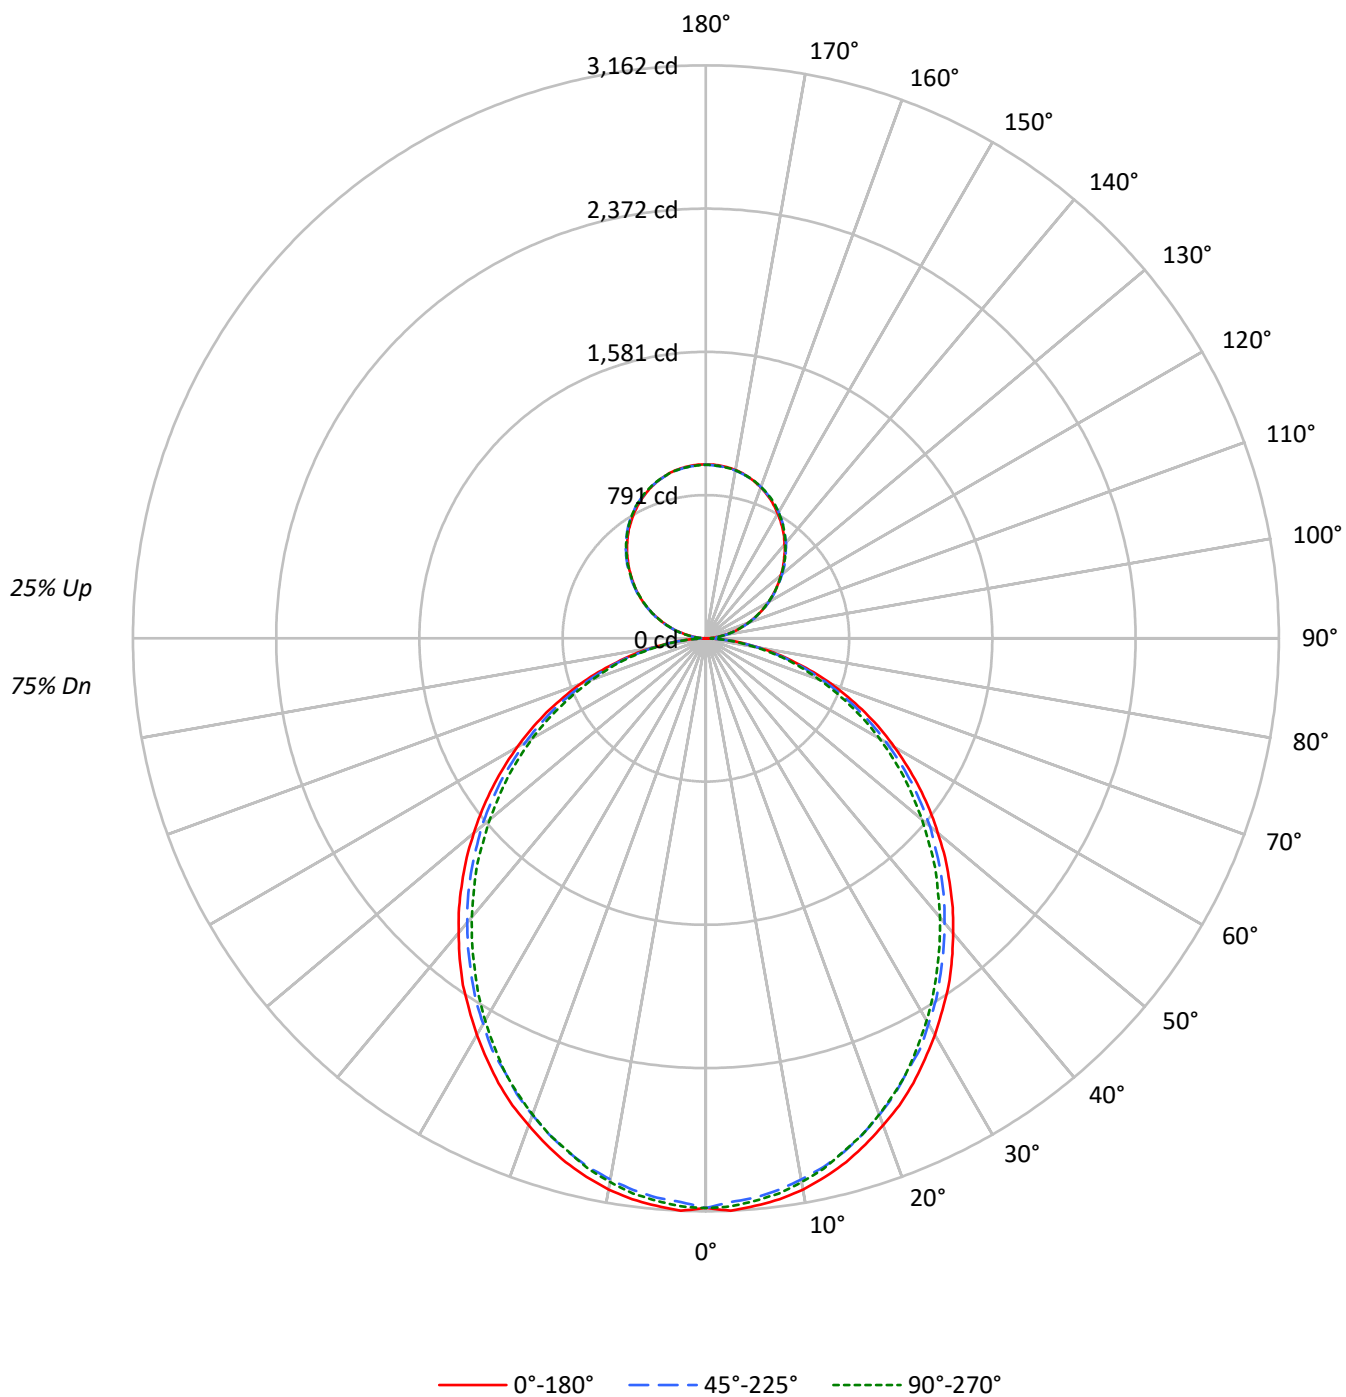

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	45	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	36	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6912	6912	6912
5°	6911	6801	6852
10°	6844	6694	6750
15°	6731	6569	6595
20°	6583	6401	6437
25°	6436	6203	6256
30°	6254	6018	6029
35°	6080	5802	5789
40°	5869	5583	5559
45°	5657	5363	5324
50°	5426	5131	5053
55°	5182	4864	4801
60°	4906	4548	4512
65°	4603	4219	4173
70°	4218	3818	3804
75°	3691	3338	3450
80°	3049	2725	2802
85°	2059	1722	1760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5657 cd/sqm

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.8
10°-20°	832.5	7.8
20°-30°	1223.4	11.5
30°-40°	1420.9	13.3
40°-50°	1419.1	13.3
50°-60°	1237.5	11.6
60°-70°	914.7	8.6
70°-80°	517.6	4.8
80°-90°	139.3	1.3
90°-100°	59.3	0.6
100°-110°	188.4	1.8
110°-120°	322.4	3.0
120°-130°	424.0	4.0
130°-140°	475.9	4.5
140°-150°	466.7	4.4
150°-160°	391.5	3.7
160°-170°	259.6	2.4
170°-180°	90.7	0.8
0°-30°	2351.8	22.0
0°-40°	3772.7	35.3
0°-60°	6429.3	60.2
0°-90°	8000.9	74.9
90°-120°	570.1	5.3
90°-150°	1936.6	18.1
90°-180°	2678.0	25.1
0°-180°	10679.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	1	10	28	27	28	10
95°	42	50	52	52	50	47
105°	174	176	178	179	179	184
115°	324	328	327	326	324	320
125°	471	478	475	473	472	420
135°	609	618	619	618	616	470
145°	739	745	749	750	747	462
155°	845	847	850	854	851	389
165°	919	918	918	924	920	259
175°	956	954	952	958	953	91
180°	958	958	958	958	958	

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	0.9	10.4	28.3	26.6	27.5
92.5°	17.9	24.2	25.1	26.0	26.0
95°	42.2	50.3	51.7	51.7	50.3
97.5°	70.2	77.7	80.9	80.9	80.9
100°	102.5	109.2	111.5	111.5	110.7
102.5°	136.6	141.6	144.7	145.6	144.7
105°	173.9	176.2	177.9	179.4	179.4
107.5°	210.9	214.3	214.3	214.9	210.9
110°	246.7	251.4	251.4	251.4	249.0

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	285.4	290.3	289.4	287.1	285.4
115°	323.6	328.1	326.7	325.9	323.6
117.5°	361.3	367.7	363.7	361.3	359.0
120°	399.5	405.9	399.5	399.5	396.9
122.5°	434.1	442.2	438.2	435.9	434.1
125°	470.6	477.8	475.4	472.8	472.0
127.5°	506.0	515.0	511.9	508.4	506.0
130°	539.3	549.7	548.3	546.5	543.3
132.5°	576.5	584.6	585.2	581.2	578.9
135°	608.6	617.5	619.4	618.4	616.1
137.5°	644.4	651.7	653.1	652.6	649.0
140°	675.9	683.2	687.2	687.2	684.0
142.5°	708.3	715.5	717.8	718.7	715.5
145°	738.9	744.7	749.3	750.1	747.0
147.5°	766.4	773.6	777.0	778.5	775.3
150°	794.7	799.6	802.7	805.4	802.7
152.5°	819.8	824.7	828.7	831.9	828.7
155°	845.0	847.2	849.8	853.8	851.3
157.5°	866.6	868.3	869.8	875.6	871.5
160°	886.0	887.7	888.6	893.4	890.0
162.5°	903.8	903.8	904.7	910.2	906.2
165°	919.2	918.3	918.3	924.0	920.0
167.5°	933.0	930.4	930.4	936.1	932.1
170°	943.4	941.1	940.3	946.0	941.1
172.5°	950.6	948.4	947.5	953.2	948.4
175°	956.4	954.1	952.4	958.2	953.2
177.5°	959.6	957.3	955.5	960.5	955.5
180°	958.2	958.2	958.2	958.2	958.2

TEST NUMBER: P909044

CATALOG NUMBER: DFN2DIP-SQ2F0-080D030US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.91	17.05	16.62	17.78	18.65	15.47	16.61	16.18	17.34	18.20
	3H	17.57	18.60	18.30	19.34	20.24	17.08	18.11	17.81	18.85	19.75
	4H	18.16	19.13	18.90	19.88	20.79	17.67	18.64	18.41	19.38	20.29
	6H	18.56	19.45	19.32	20.21	21.14	18.06	18.95	18.82	19.71	20.64
	8H	18.67	19.52	19.43	20.30	21.22	18.16	19.02	18.93	19.79	20.72
	12H	18.72	19.53	19.49	20.30	21.25	18.21	19.02	18.98	19.79	20.74
4H	2H	16.40	17.36	17.14	18.11	19.02	16.04	17.01	16.79	17.76	18.67
	3H	18.26	19.07	19.02	19.86	20.78	17.86	18.66	18.61	19.45	20.38
	4H	18.97	19.71	19.75	20.49	21.45	18.55	19.28	19.32	20.07	21.03
	6H	19.49	20.12	20.28	20.93	21.90	19.05	19.69	19.84	20.50	21.46
	8H	19.63	20.23	20.43	21.03	22.01	19.20	19.79	19.99	20.60	21.57
	12H	19.71	20.25	20.53	21.07	22.05	19.26	19.80	20.08	20.63	21.61
8H	4H	19.18	19.78	19.98	20.58	21.56	18.80	19.40	19.60	20.20	21.18
	6H	19.80	20.29	20.62	21.14	22.12	19.42	19.91	20.24	20.76	21.73
	8H	20.01	20.45	20.85	21.30	22.29	19.62	20.06	20.45	20.90	21.89
	12H	20.14	20.53	20.98	21.37	22.41	19.73	20.12	20.57	20.96	22.00
12H	4H	19.18	19.71	19.99	20.54	21.52	18.81	19.34	19.62	20.17	21.15
	6H	19.83	20.27	20.66	21.11	22.10	19.45	19.89	20.29	20.74	21.73
	8H	20.07	20.45	20.91	21.29	22.34	19.69	20.07	20.52	20.91	21.96