

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909052

Luminaire Tested: DFN2DIP-SQ2F0-080D050US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909052
REPORT IS A COMBINATION OF REPORTS P899805 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D050US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12466.8 lumens
Efficiency: N/A
Efficacy: 107.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 116.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

Luminous Intensity Polar Plot

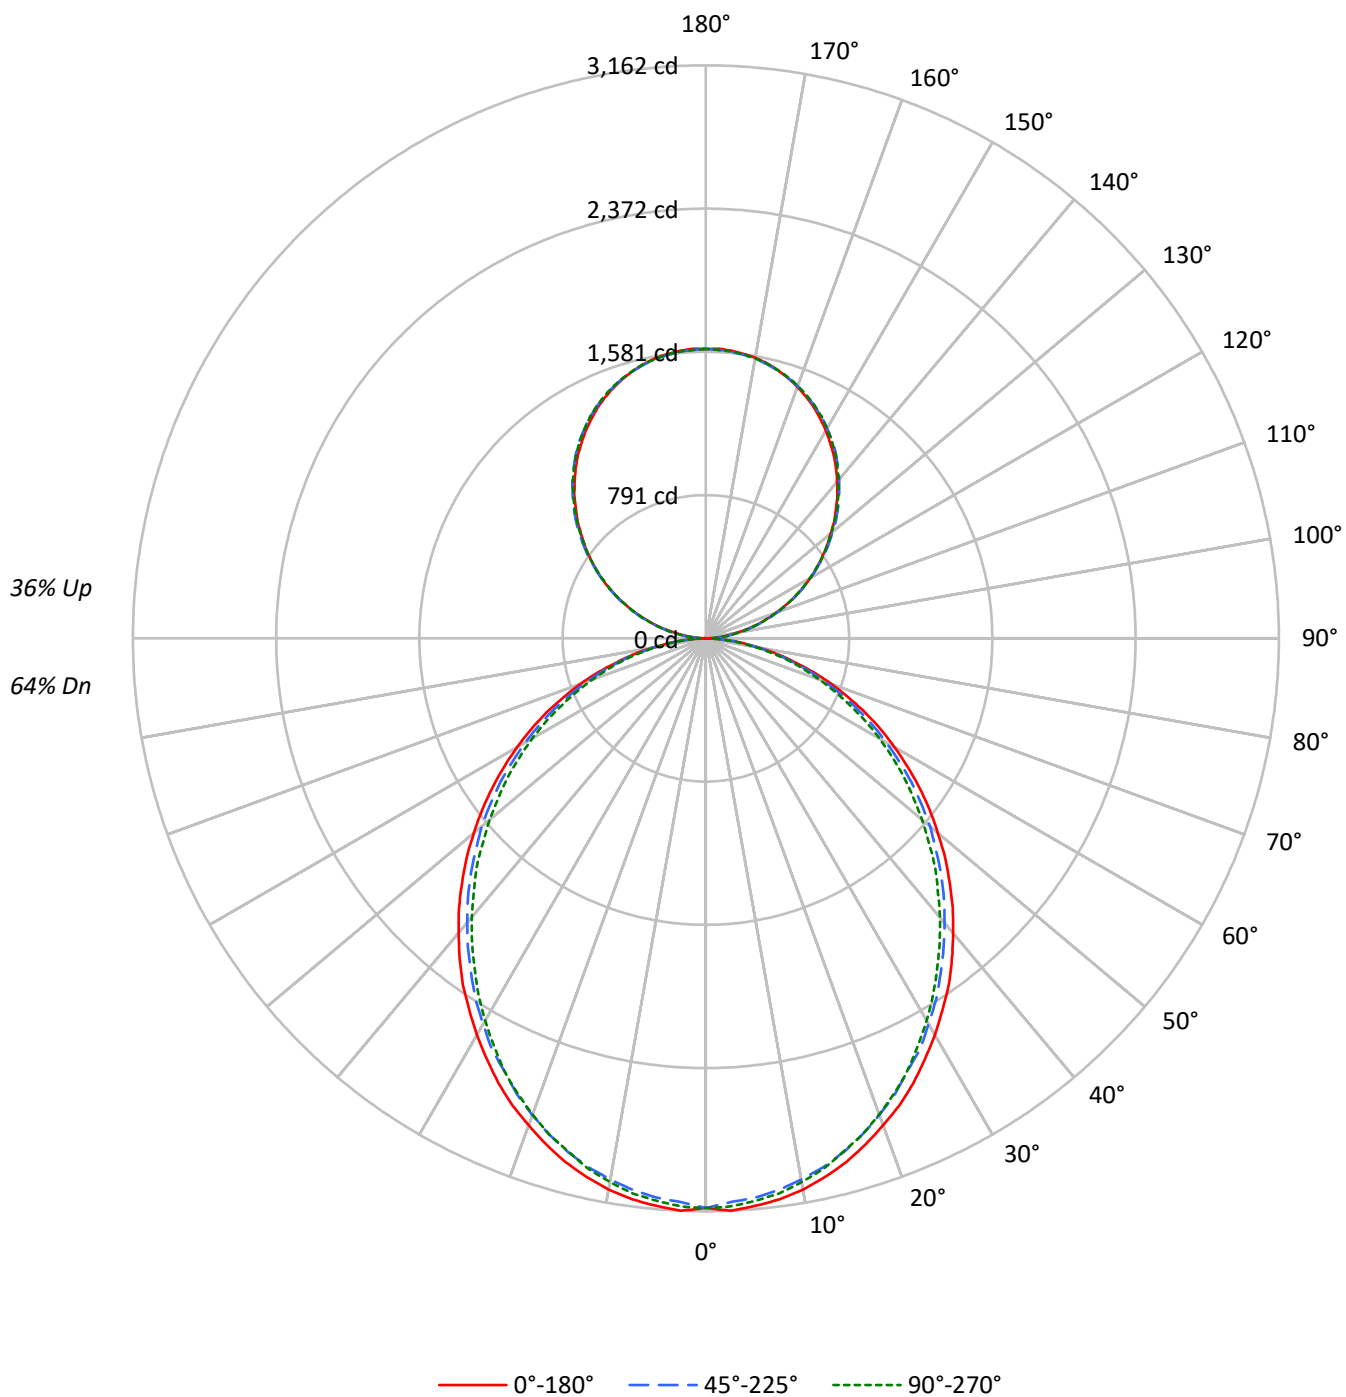

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	111	111	111	111	104	104	104	104	91	91	91		80	80	80		69
1	101	97	93	89	95	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		62	58	56		54
3	84	74	67	61	79	70	63	58	62	57	52		55	50	47		48
4	77	66	58	51	72	62	55	49	55	49	45		49	44	40		43
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	45	38	34		40	35	31		35
7	60	48	40	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	53	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	26	22		27
10	49	37	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6912	6912	6912
5°	6911	6801	6852
10°	6844	6694	6750
15°	6731	6569	6595
20°	6583	6401	6437
25°	6436	6203	6256
30°	6254	6018	6029
35°	6080	5802	5789
40°	5869	5583	5559
45°	5657	5363	5324
50°	5426	5131	5053
55°	5182	4864	4801
60°	4906	4548	4512
65°	4603	4219	4173
70°	4218	3818	3804
75°	3691	3338	3450
80°	3049	2725	2802
85°	2059	1722	1760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5657 cd/sqm

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.4
10°-20°	832.5	6.7
20°-30°	1223.4	9.8
30°-40°	1420.9	11.4
40°-50°	1419.1	11.4
50°-60°	1237.5	9.9
60°-70°	914.7	7.3
70°-80°	517.6	4.2
80°-90°	141.2	1.1
90°-100°	98.8	0.8
100°-110°	314.0	2.5
110°-120°	537.3	4.3
120°-130°	706.6	5.7
130°-140°	793.2	6.4
140°-150°	777.8	6.2
150°-160°	652.5	5.2
160°-170°	432.7	3.5
170°-180°	151.2	1.2
0°-30°	2351.8	18.9
0°-40°	3772.7	30.3
0°-60°	6429.3	51.6
0°-90°	8002.7	64.2
90°-120°	950.1	7.6
90°-150°	3227.7	25.9
90°-180°	4464.0	35.8
0°-180°	12466.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	1	17	47	44	46	12
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P909052

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.09	16.09	15.91	16.94	17.99	14.64	15.65	15.47	16.50	17.55
	3H	16.74	17.64	17.58	18.50	19.58	16.25	17.15	17.09	18.01	19.09
	4H	17.32	18.17	18.18	19.04	20.13	16.83	17.68	17.68	18.54	19.64
	6H	17.71	18.50	18.58	19.37	20.48	17.21	18.00	18.08	18.87	19.98
	8H	17.82	18.56	18.69	19.45	20.56	17.31	18.06	18.19	18.95	20.06
	12H	17.86	18.58	18.74	19.46	20.59	17.35	18.07	18.23	18.95	20.08
4H	2H	15.56	16.41	16.42	17.27	18.36	15.20	16.05	16.06	16.92	18.01
	3H	17.41	18.12	18.28	19.02	20.13	17.00	17.72	17.87	18.61	19.72
	4H	18.12	18.77	19.00	19.66	20.79	17.69	18.34	18.57	19.23	20.37
	6H	18.62	19.18	19.52	20.10	21.24	18.19	18.75	19.09	19.67	20.80
	8H	18.76	19.29	19.67	20.20	21.35	18.33	18.85	19.23	19.76	20.91
	12H	18.84	19.31	19.76	20.24	21.39	18.39	18.86	19.31	19.79	20.95
8H	4H	18.31	18.84	19.21	19.75	20.90	17.94	18.46	18.84	19.37	20.52
	6H	18.93	19.36	19.85	20.31	21.46	18.54	18.98	19.47	19.93	21.08
	8H	19.14	19.52	20.07	20.47	21.63	18.74	19.13	19.68	20.07	21.24
	12H	19.26	19.60	20.20	20.54	21.75	18.85	19.19	19.79	20.13	21.34
12H	4H	18.30	18.78	19.22	19.71	20.86	17.93	18.41	18.85	19.34	20.49
	6H	18.95	19.34	19.89	20.28	21.45	18.58	18.96	19.52	19.91	21.08
	8H	19.19	19.53	20.13	20.46	21.68	18.80	19.14	19.75	20.08	21.30