

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909060

Luminaire Tested: DFN2DIP-SQ2F0-080D070US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909060
REPORT IS A COMBINATION OF REPORTS P899829 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D070US840-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14254.3 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 133.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

Luminous Intensity Polar Plot

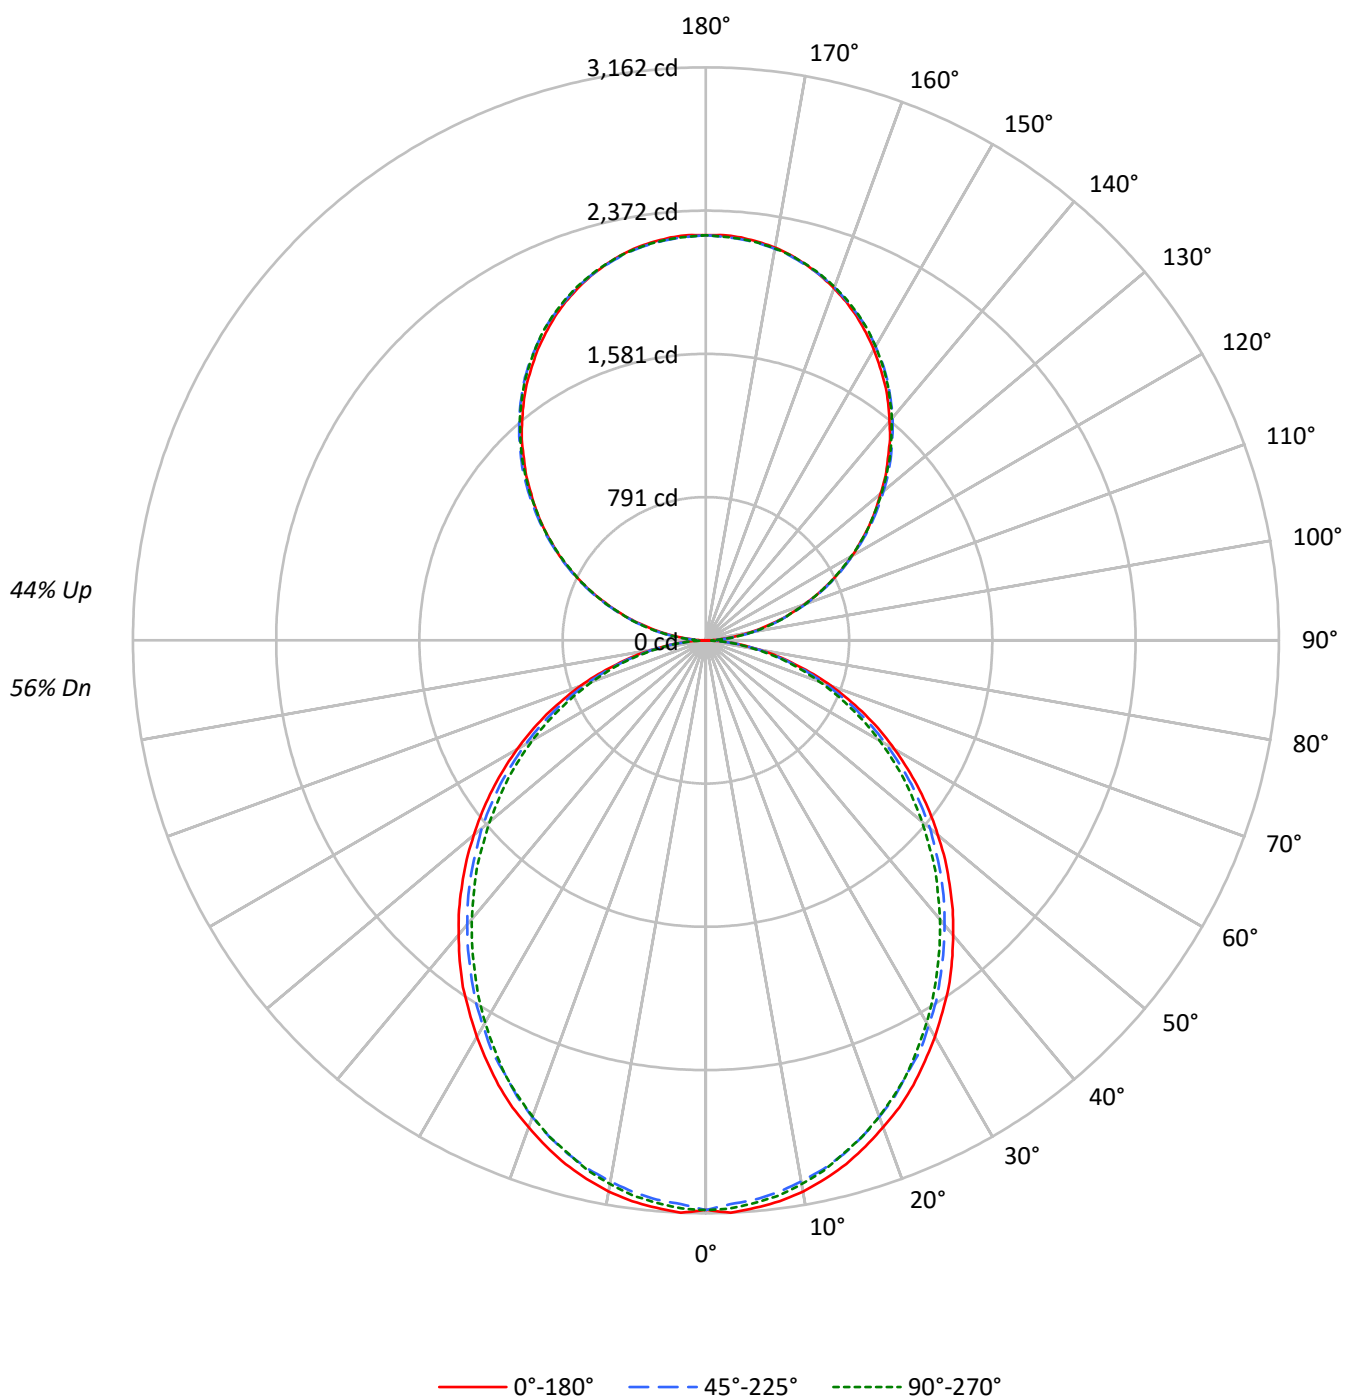

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		74	74	74		62	62	62
1	99	95	91	87		92	88	85	82		76	74	71		65	63	61		55	53	52
2	90	83	77	71		84	77	72	67		67	63	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		50	47	43		43	40	37
4	75	64	56	50		70	60	53	48		52	47	42		45	41	37		38	35	32
5	69	57	49	43		64	54	46	41		47	41	37		40	36	32		34	31	28
6	64	52	43	38		59	48	41	36		42	36	32		37	32	28		31	28	25
7	59	47	39	33		55	44	37	31		38	32	28		33	29	25		28	25	22
8	55	42	35	29		51	40	33	28		35	29	25		30	26	22		26	23	20
9	51	39	31	26		47	36	30	25		32	26	23		28	23	20		24	21	18
10	48	36	28	23		44	34	27	22		30	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6912	6912	6912
5°	6911	6801	6852
10°	6844	6694	6750
15°	6731	6569	6595
20°	6583	6401	6437
25°	6436	6203	6256
30°	6254	6018	6029
35°	6080	5802	5789
40°	5869	5583	5559
45°	5657	5363	5324
50°	5426	5131	5053
55°	5182	4864	4801
60°	4906	4548	4512
65°	4603	4219	4173
70°	4218	3818	3804
75°	3691	3338	3450
80°	3049	2725	2802
85°	2059	1722	1760

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5657 cd/sqm

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.1
10°-20°	832.5	5.8
20°-30°	1223.4	8.6
30°-40°	1420.9	10.0
40°-50°	1419.1	10.0
50°-60°	1237.5	8.7
60°-70°	914.7	6.4
70°-80°	517.6	3.6
80°-90°	143.0	1.0
90°-100°	138.3	1.0
100°-110°	439.6	3.1
110°-120°	752.2	5.3
120°-130°	989.3	6.9
130°-140°	1110.5	7.8
140°-150°	1088.9	7.6
150°-160°	913.5	6.4
160°-170°	605.8	4.2
170°-180°	211.7	1.5
0°-30°	2351.8	16.5
0°-40°	3772.7	26.5
0°-60°	6429.3	45.1
0°-90°	8004.5	56.2
90°-120°	1330.1	9.3
90°-150°	4518.8	31.7
90°-180°	6250.0	43.8
0°-180°	14254.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	2	24	66	62	64	14
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P909060

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.42	15.34	15.33	16.26	17.45	13.98	14.90	14.88	15.82	17.00
	3H	16.07	16.89	16.98	17.82	19.03	15.58	16.40	16.49	17.33	18.54
	4H	16.65	17.43	17.57	18.36	19.58	16.15	16.93	17.08	17.87	19.08
	6H	17.03	17.75	17.97	18.70	19.92	16.53	17.25	17.47	18.20	19.42
	8H	17.13	17.82	18.08	18.78	20.00	16.63	17.32	17.58	18.28	19.50
	12H	17.18	17.83	18.13	18.78	20.03	16.67	17.32	17.62	18.27	19.52
4H	2H	14.88	15.66	15.81	16.60	17.81	14.52	15.30	15.46	16.24	17.46
	3H	16.73	17.38	17.67	18.35	19.58	16.32	16.97	17.26	17.94	19.17
	4H	17.43	18.02	18.38	18.99	20.24	17.01	17.60	17.96	18.56	19.81
	6H	17.93	18.44	18.90	19.43	20.68	17.50	18.01	18.46	19.00	20.25
	8H	18.07	18.55	19.04	19.53	20.80	17.63	18.11	18.60	19.09	20.36
	12H	18.14	18.57	19.13	19.57	20.84	17.69	18.12	18.68	19.12	20.39
8H	4H	17.62	18.10	18.59	19.08	20.34	17.24	17.72	18.21	18.70	19.97
	6H	18.23	18.63	19.22	19.65	20.91	17.84	18.24	18.84	19.26	20.53
	8H	18.44	18.79	19.44	19.80	21.08	18.04	18.39	19.05	19.40	20.69
	12H	18.56	18.87	19.57	19.87	21.20	18.15	18.46	19.16	19.46	20.79
12H	4H	17.60	18.04	18.59	19.03	20.31	17.24	17.67	18.22	18.66	19.94
	6H	18.25	18.61	19.26	19.61	20.90	17.88	18.23	18.88	19.24	20.52
	8H	18.48	18.79	19.49	19.79	21.12	18.10	18.41	19.11	19.41	20.74