

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911657

Luminaire Tested: DFN2DIP-SQ2F0-030D040US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911657
REPORT IS A COMBINATION OF REPORTS P901303 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D040US850-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7685.4 lumens
Efficiency: N/A
Efficacy: 146.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 52.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLLONL

Luminous Intensity Polar Plot

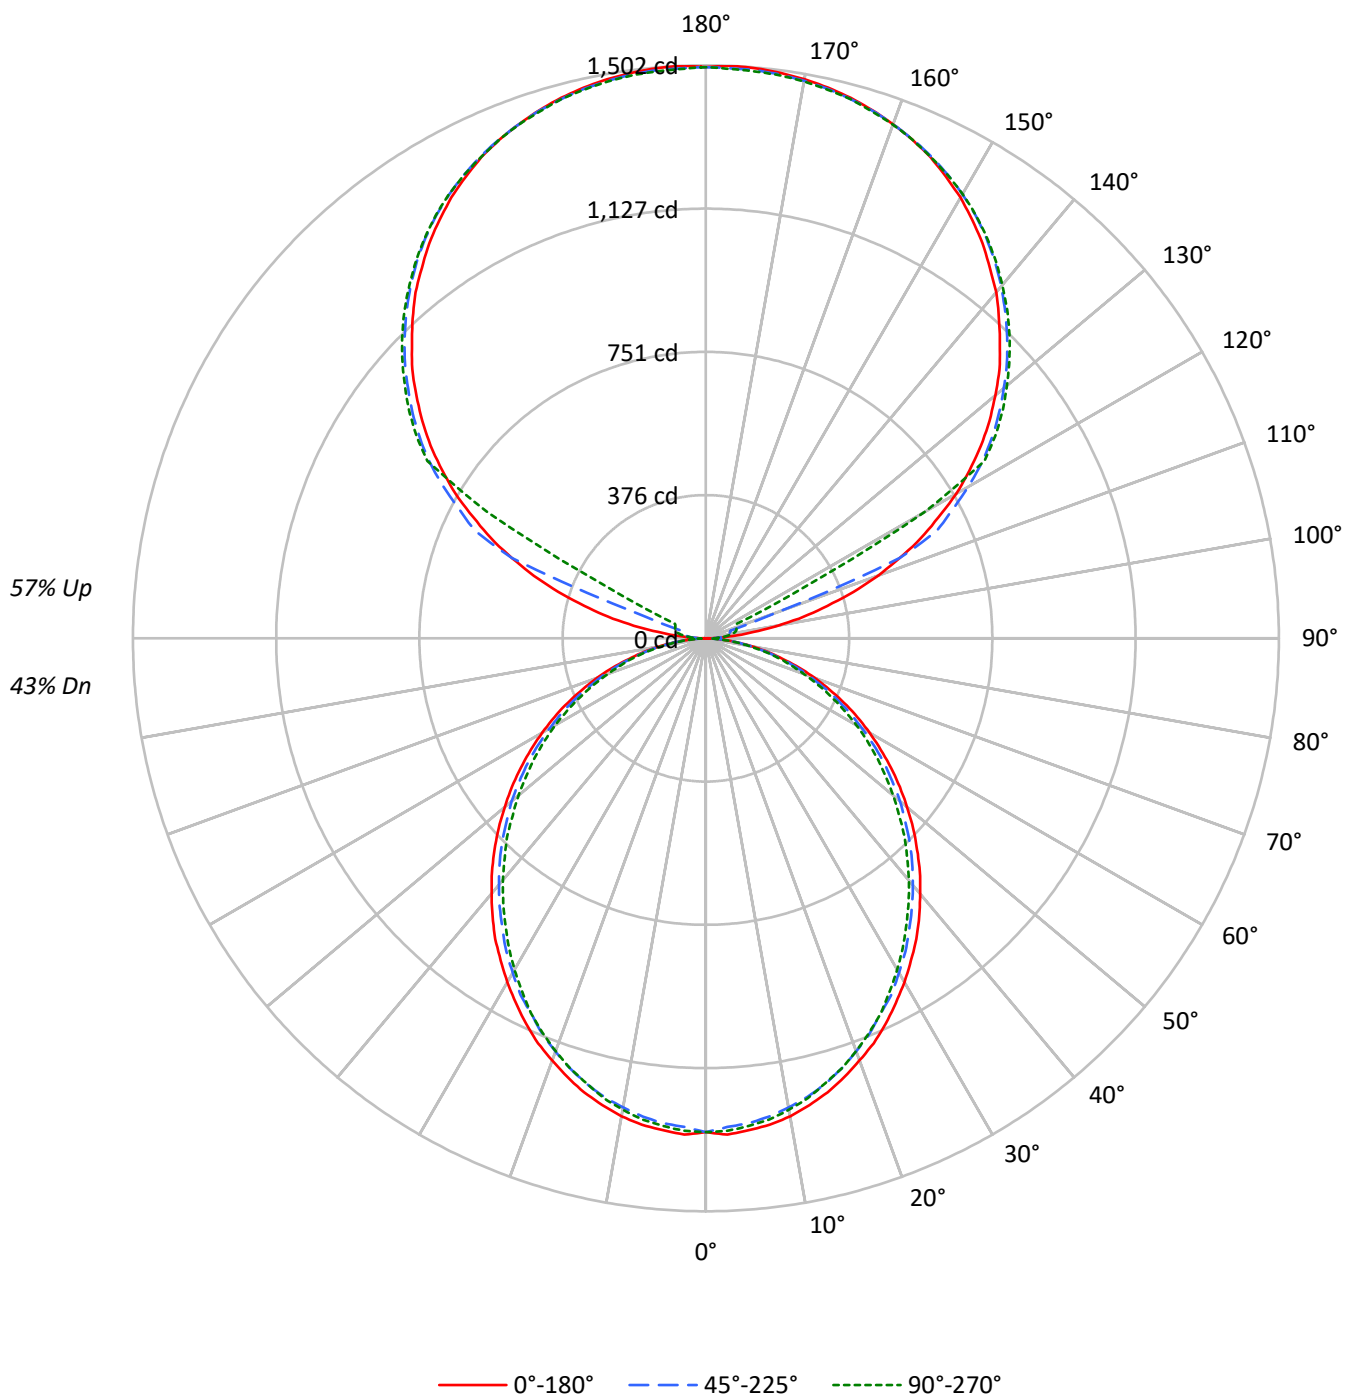

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2846	2846	2846
5°	2846	2801	2822
10°	2818	2757	2780
15°	2772	2705	2716
20°	2711	2636	2651
25°	2650	2555	2576
30°	2575	2478	2483
35°	2504	2389	2384
40°	2417	2299	2290
45°	2330	2209	2192
50°	2235	2113	2081
55°	2134	2003	1977
60°	2020	1873	1859
65°	1896	1737	1718
70°	1737	1573	1566
75°	1519	1375	1421
80°	1255	1122	1155
85°	848	709	725

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2330 cd/sqm

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	121.8	1.6
10°-20°	342.8	4.5
20°-30°	503.8	6.6
30°-40°	585.2	7.6
40°-50°	584.4	7.6
50°-60°	509.6	6.6
60°-70°	376.7	4.9
70°-80°	213.1	2.8
80°-90°	58.9	0.8
90°-100°	49.4	0.6
100°-110°	184.0	2.4
110°-120°	488.1	6.4
120°-130°	809.5	10.5
130°-140°	859.9	11.2
140°-150°	799.2	10.4
150°-160°	642.5	8.4
160°-170°	414.0	5.4
170°-180°	142.5	1.9
0°-30°	968.5	12.6
0°-40°	1553.6	20.2
0°-60°	2647.7	34.5
0°-90°	3296.4	42.9
90°-120°	721.5	9.4
90°-150°	3190.0	41.5
90°-180°	4389.0	57.1
0°-180°	7685.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1294	1294	1294	1294	1294	
5°	1294	1290	1276	1286	1283	123
15°	1232	1225	1209	1214	1208	347
25°	1115	1106	1084	1087	1084	513
35°	962	950	930	922	916	601
45°	783	774	756	742	737	604
55°	593	585	570	555	549	530
65°	400	392	380	368	362	395
75°	209	207	200	193	196	223
85°	51	50	49	45	44	57
90°	1	13	22	27	29	7
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1294.5	1294.5	1294.5	1294.5	1294.5
2.5°	1302.1	1295.9	1282.1	1294.5	1292.2
5°	1294.5	1289.7	1275.9	1285.9	1283.4
7.5°	1285.9	1278.5	1264.7	1274.8	1272.2
10°	1272.2	1263.5	1248.6	1258.5	1254.8
12.5°	1253.5	1246.1	1231.2	1237.3	1234.9
15°	1232.3	1225.0	1208.7	1213.7	1207.5
17.5°	1206.1	1198.8	1182.5	1188.7	1182.5
20°	1177.5	1170.1	1152.7	1156.4	1151.5
22.5°	1149.0	1137.8	1121.5	1121.5	1119.0
25°	1115.3	1105.5	1084.3	1086.7	1084.3
27.5°	1077.9	1069.2	1053.1	1049.4	1043.2
30°	1040.7	1030.7	1012.1	1008.3	1003.3
32.5°	1000.9	993.4	973.5	965.9	960.9
35°	962.3	949.9	929.9	922.4	916.1
37.5°	918.7	907.5	887.5	878.8	872.6
40°	873.9	863.9	843.9	832.9	827.9
42.5°	830.3	820.3	800.5	787.9	780.5
45°	783.1	774.3	755.6	741.9	736.9
47.5°	736.9	728.3	708.3	694.6	687.1
50°	688.4	682.1	664.7	647.3	641.1
52.5°	641.1	632.4	616.3	602.5	593.8
55°	592.6	585.1	570.1	555.3	549.1
57.5°	544.0	537.8	521.6	506.6	501.6
60°	495.4	490.5	473.1	459.3	455.7
62.5°	448.1	439.4	427.0	414.5	409.6
65°	399.7	392.1	379.7	368.5	362.3
67.5°	349.9	343.6	332.4	323.7	318.7
70°	303.8	298.8	287.6	278.8	273.9
72.5°	256.5	251.4	245.2	236.5	232.9
75°	209.0	206.7	200.4	193.0	195.5
77.5°	166.8	161.8	159.3	155.6	151.9
80°	124.5	123.2	120.7	117.0	114.6
82.5°	84.6	84.6	83.5	78.4	78.4
85°	51.0	49.8	48.6	44.8	43.6
87.5°	22.4	20.0	17.4	13.8	12.4
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P911657

CATALOG NUMBER: DFN2DIP-SQ2F0-030D040US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.10	10.90	11.11	11.92	13.29	9.65	10.45	10.67	11.48	12.85
	3H	11.73	12.45	12.76	13.49	14.87	11.24	11.96	12.27	12.99	14.38
	4H	12.31	12.99	13.34	14.02	15.42	11.81	12.49	12.85	13.53	14.92
	6H	12.69	13.31	13.74	14.35	15.76	12.19	12.81	13.24	13.85	15.26
	8H	12.78	13.38	13.84	14.44	15.84	12.28	12.88	13.33	13.93	15.34
	12H	12.82	13.39	13.88	14.44	15.87	12.31	12.88	13.37	13.93	15.36
4H	2H	10.54	11.22	11.58	12.26	13.65	10.18	10.86	11.23	11.90	13.30
	3H	12.38	12.95	13.43	14.01	15.42	11.97	12.54	13.02	13.60	15.01
	4H	13.07	13.59	14.13	14.65	16.08	12.65	13.17	13.71	14.23	15.66
	6H	13.57	14.01	14.64	15.09	16.52	13.13	13.58	14.20	14.66	16.09
	8H	13.71	14.12	14.77	15.19	16.64	13.27	13.69	14.34	14.76	16.20
	12H	13.77	14.14	14.85	15.23	16.68	13.32	13.70	14.41	14.78	16.23
8H	4H	13.25	13.67	14.32	14.74	16.19	12.88	13.29	13.94	14.36	15.81
	6H	13.86	14.20	14.95	15.32	16.76	13.47	13.82	14.57	14.93	16.37
	8H	14.06	14.37	15.16	15.46	16.92	13.67	13.97	14.77	15.07	16.53
	12H	14.18	14.45	15.28	15.54	17.04	13.77	14.04	14.87	15.13	16.63
12H	4H	13.23	13.61	14.32	14.70	16.14	12.86	13.24	13.95	14.33	15.77
	6H	13.88	14.19	14.98	15.28	16.74	13.51	13.81	14.61	14.91	16.37
	8H	14.11	14.37	15.21	15.46	16.96	13.73	13.99	14.83	15.08	16.58

END OF REPORT