

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911682

Luminaire Tested: DFN2DIP-SQ2F0-040D040US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911682
REPORT IS A COMBINATION OF REPORTS P899786 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D040US850-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7696.4 lumens
Efficiency: N/A
Efficacy: 121.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLLFLL

Luminous Intensity Polar Plot

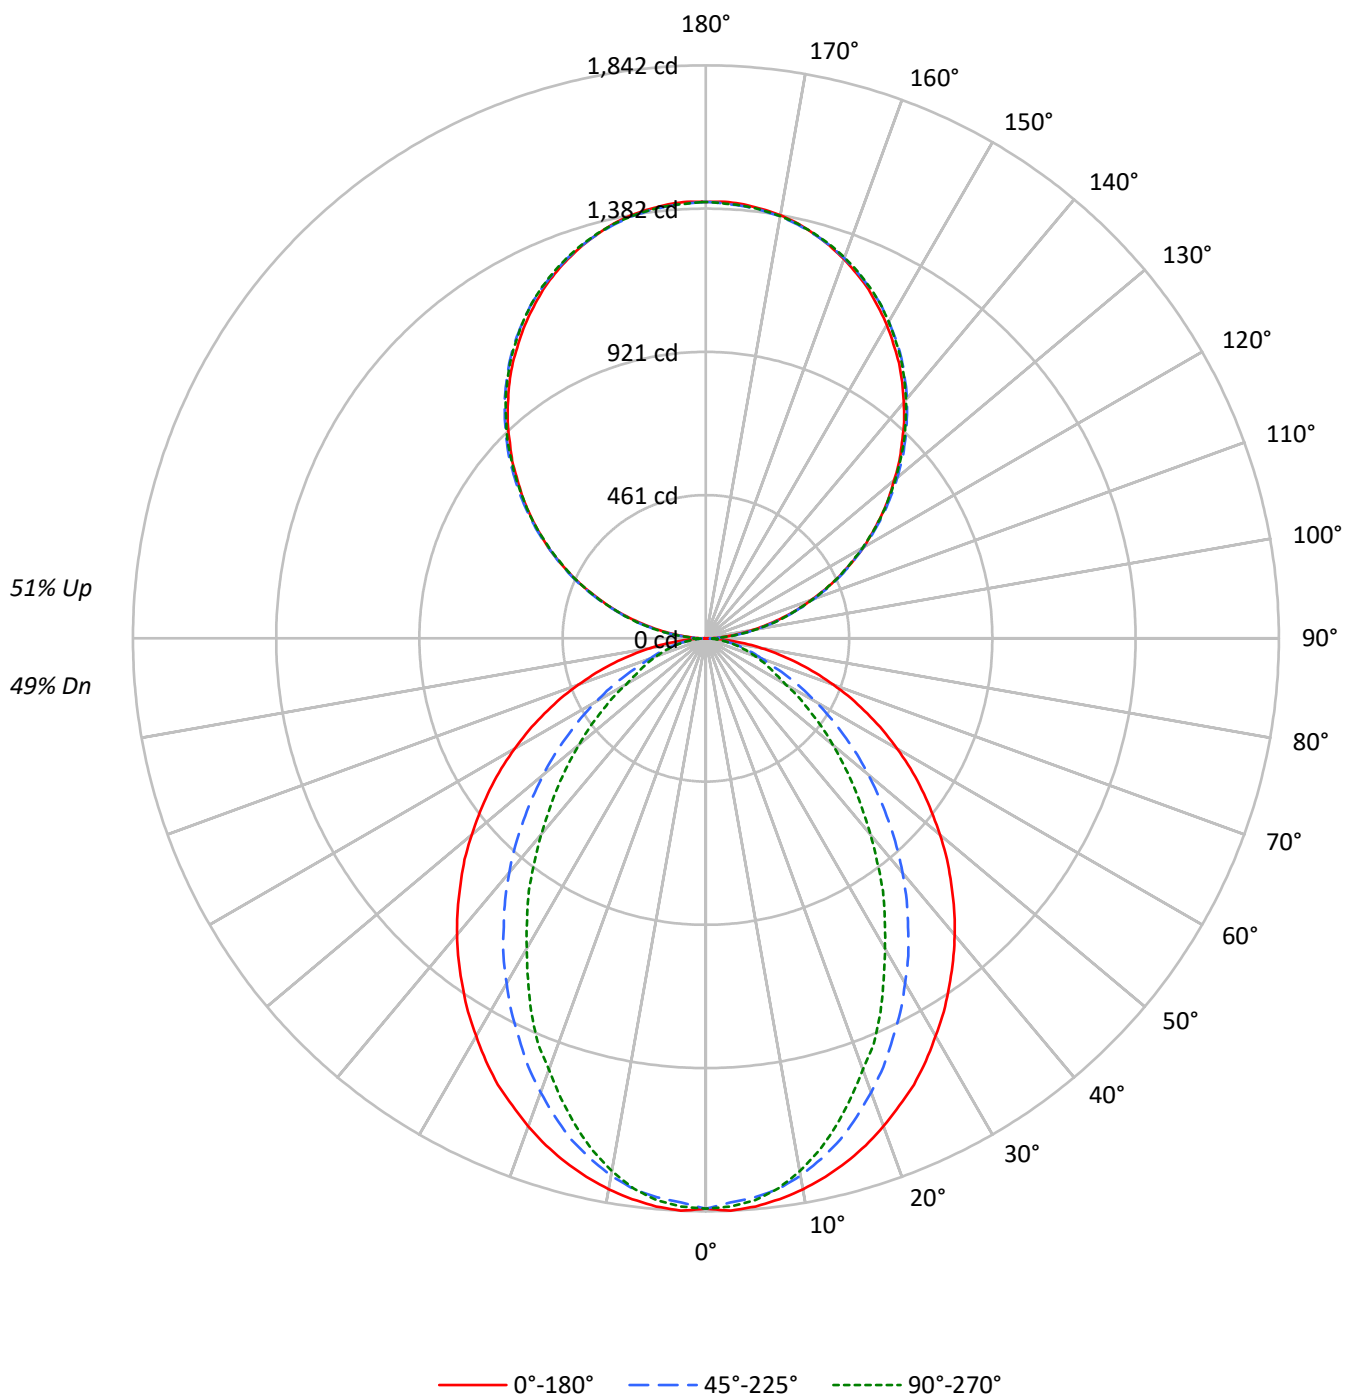

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4031	4031	4031
5°	4031	3959	3987
10°	3984	3872	3852
15°	3922	3736	3646
20°	3843	3551	3396
25°	3761	3346	3154
30°	3654	3136	2849
35°	3549	2912	2581
40°	3441	2680	2276
45°	3317	2425	1999
50°	3188	2168	1729
55°	3053	1894	1470
60°	2896	1609	1205
65°	2716	1321	1078
70°	2496	1052	967
75°	2219	910	869
80°	1822	739	737
85°	1186	459	524

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3317 cd/sqm

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	171.8	2.2
10°-20°	471.7	6.1
20°-30°	662.3	8.6
30°-40°	721.9	9.4
40°-50°	663.5	8.6
50°-60°	521.1	6.8
60°-70°	339.2	4.4
70°-80°	174.6	2.3
80°-90°	48.6	0.6
90°-100°	86.8	1.1
100°-110°	275.8	3.6
110°-120°	472.0	6.1
120°-130°	620.8	8.1
130°-140°	696.8	9.1
140°-150°	683.3	8.9
150°-160°	573.2	7.4
160°-170°	380.1	4.9
170°-180°	132.9	1.7
0°-30°	1305.8	17.0
0°-40°	2027.7	26.3
0°-60°	3212.2	41.7
0°-90°	3774.6	49.0
90°-120°	834.7	10.8
90°-150°	2835.6	36.8
90°-180°	3922.0	51.0
0°-180°	7696.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1833	1833	1833	1833	1833	
5°	1833	1825	1804	1818	1814	174
15°	1744	1726	1669	1638	1621	491
25°	1583	1530	1420	1352	1327	728
35°	1364	1279	1133	1029	992	854
45°	1115	1004	830	712	672	861
55°	848	718	539	440	408	758
65°	572	438	289	232	227	568
75°	305	189	133	121	120	323
85°	71	36	32	32	32	82
90°	1	15	42	39	40	8
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.4	1833.4	1833.4	1833.4	1833.4
2.5°	1841.7	1833.4	1815.1	1831.8	1828.4
5°	1833.4	1825.1	1803.5	1818.4	1813.5
7.5°	1818.4	1808.6	1785.4	1791.8	1783.6
10°	1798.6	1786.9	1753.8	1748.7	1738.9
12.5°	1773.7	1758.8	1713.8	1704.0	1685.7
15°	1743.8	1725.5	1669.2	1637.7	1621.1
17.5°	1709.0	1682.4	1612.6	1576.2	1549.6
20°	1669.2	1635.9	1552.9	1511.6	1475.0
22.5°	1626.0	1587.9	1491.5	1435.2	1410.4
25°	1582.9	1529.8	1420.2	1352.3	1327.3
27.5°	1531.5	1475.0	1353.9	1275.9	1237.6
30°	1476.7	1413.5	1280.8	1196.3	1151.5
32.5°	1423.6	1347.2	1211.2	1111.7	1070.1
35°	1364.0	1279.2	1133.3	1028.7	992.1
37.5°	1305.8	1214.5	1060.2	945.6	904.3
40°	1244.4	1144.9	983.9	866.1	823.0
42.5°	1181.3	1075.2	907.6	784.7	743.4
45°	1115.0	1003.8	829.6	711.8	671.9
47.5°	1052.0	934.2	755.0	637.1	600.6
50°	982.2	864.5	681.9	567.4	532.7
52.5°	914.1	789.7	612.3	502.7	471.2
55°	847.8	718.4	539.2	439.7	408.2
57.5°	779.8	647.1	474.5	381.6	355.1
60°	710.1	577.3	406.4	321.9	295.4
62.5°	642.2	509.5	348.3	268.8	255.6
65°	572.5	437.9	288.7	232.3	227.2
67.5°	506.1	371.6	232.3	204.1	199.1
70°	436.4	307.0	192.4	175.9	169.1
72.5°	370.1	247.2	160.9	147.7	144.4
75°	305.2	189.1	132.7	121.1	119.6
77.5°	240.7	134.3	104.6	97.9	94.5
80°	180.8	96.3	79.5	73.1	73.1
82.5°	126.1	64.8	54.8	51.3	51.3
85°	71.3	36.5	31.5	31.5	31.5
87.5°	26.6	13.2	13.2	11.6	11.6
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P911682

CATALOG NUMBER: DFN2DIP-SQ2F0-040D040US850-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.78	12.61	12.76	13.59	14.87	7.74	8.57	8.72	9.55	10.84
	3H	13.44	14.18	14.42	15.17	16.48	8.91	9.65	9.90	10.64	11.95
	4H	14.04	14.73	15.03	15.73	17.04	9.35	10.05	10.35	11.04	12.36
	6H	14.44	15.08	15.45	16.08	17.41	9.66	10.30	10.66	11.30	12.63
	8H	14.56	15.17	15.57	16.18	17.51	9.74	10.35	10.75	11.36	12.69
	12H	14.61	15.19	15.63	16.20	17.55	9.77	10.35	10.79	11.36	12.71
4H	2H	11.80	12.49	12.80	13.49	14.80	8.33	9.02	9.33	10.02	11.34
	3H	13.60	14.18	14.61	15.20	16.53	9.66	10.23	10.67	11.26	12.59
	4H	14.28	14.81	15.30	15.82	17.18	10.19	10.72	11.21	11.73	13.09
	6H	14.77	15.23	15.80	16.27	17.62	10.59	11.04	11.62	12.08	13.43
	8H	14.94	15.36	15.97	16.39	17.76	10.71	11.13	11.74	12.16	13.53
	12H	15.02	15.41	16.07	16.45	17.82	10.76	11.14	11.81	12.19	13.56
8H	4H	14.24	14.67	15.27	15.70	17.06	10.46	10.88	11.49	11.91	13.28
	6H	14.79	15.14	15.84	16.21	17.57	10.95	11.30	12.00	12.37	13.74
	8H	14.99	15.30	16.05	16.36	17.74	11.13	11.43	12.19	12.49	13.88
	12H	15.11	15.38	16.18	16.44	17.86	11.23	11.50	12.30	12.55	13.98
12H	4H	14.19	14.57	15.24	15.62	16.99	10.46	10.84	11.51	11.89	13.26
	6H	14.76	15.07	15.82	16.13	17.51	10.99	11.30	12.06	12.36	13.74
	8H	14.97	15.24	16.03	16.29	17.71	11.19	11.46	12.25	12.51	13.94

END OF REPORT