

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911692

Luminaire Tested: DFN2DIP-SQ2F0-040D070US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911692
REPORT IS A COMBINATION OF REPORTS P899821 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D070US850-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11261.9 lumens
Efficiency: N/A
Efficacy: 127.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 88.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFLL

Luminous Intensity Polar Plot

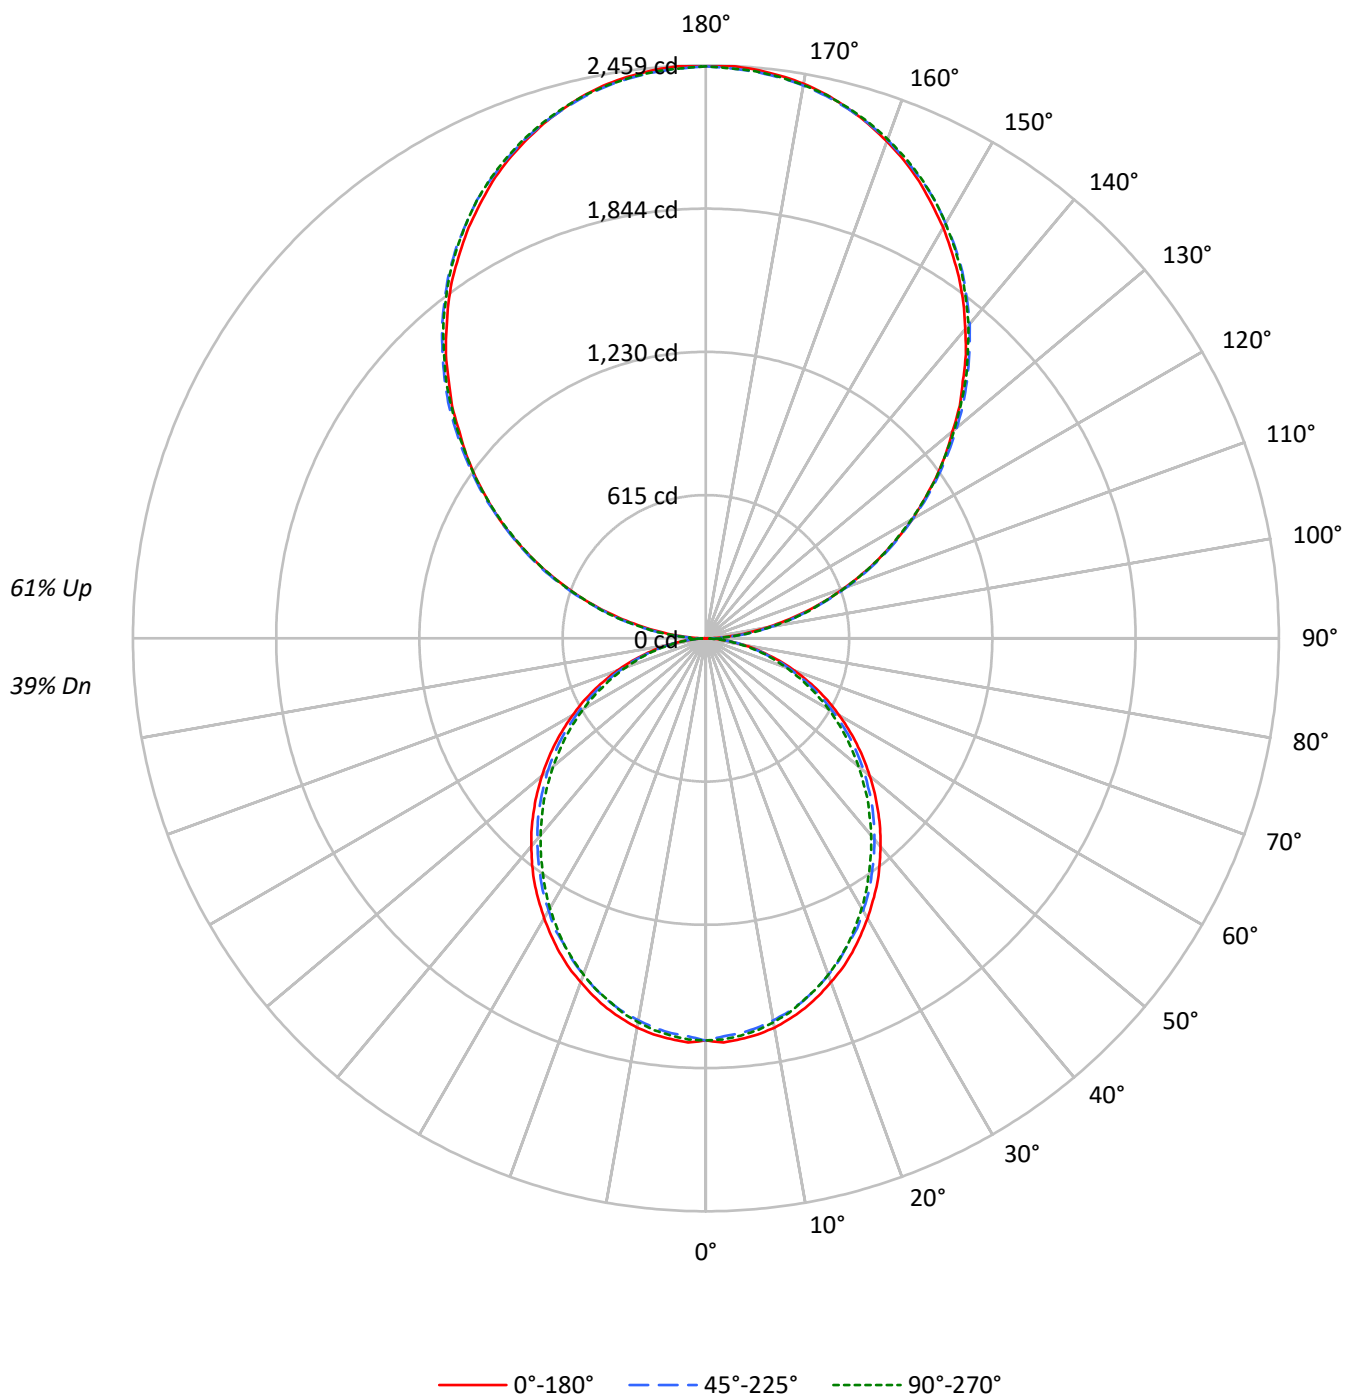

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	45	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	26	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	18	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3795	3795	3795
5°	3795	3734	3762
10°	3758	3676	3706
15°	3696	3607	3621
20°	3614	3515	3535
25°	3534	3406	3435
30°	3434	3304	3310
35°	3338	3186	3179
40°	3222	3065	3053
45°	3106	2945	2923
50°	2979	2817	2774
55°	2846	2671	2636
60°	2694	2498	2478
65°	2528	2317	2291
70°	2316	2097	2089
75°	2027	1833	1894
80°	1673	1495	1539
85°	1131	945	967

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3420 cd/sqm

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	162.5	1.4
10°-20°	457.1	4.1
20°-30°	671.7	6.0
30°-40°	780.2	6.9
40°-50°	779.2	6.9
50°-60°	679.5	6.0
60°-70°	502.3	4.5
70°-80°	284.2	2.5
80°-90°	82.0	0.7
90°-100°	151.9	1.3
100°-110°	482.7	4.3
110°-120°	826.1	7.3
120°-130°	1086.4	9.6
130°-140°	1219.5	10.8
140°-150°	1195.8	10.6
150°-160°	1003.1	8.9
160°-170°	665.3	5.9
170°-180°	232.5	2.1
0°-30°	1291.3	11.5
0°-40°	2071.5	18.4
0°-60°	3530.2	31.3
0°-90°	4398.6	39.1
90°-120°	1460.7	13.0
90°-150°	4962.4	44.1
90°-180°	6863.0	60.9
0°-180°	11261.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1726	1726	1726	1726	1726	
5°	1726	1720	1701	1714	1711	164
15°	1643	1633	1612	1618	1610	463
25°	1487	1474	1446	1449	1446	684
35°	1283	1266	1240	1230	1222	801
45°	1044	1032	1007	989	983	806
55°	790	780	760	740	732	706
65°	533	523	506	491	483	527
75°	279	276	267	257	261	298
85°	68	66	65	60	58	76
90°	2	27	72	68	70	11
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1726.0	1726.0	1726.0	1726.0	1726.0
2.5°	1736.1	1727.8	1709.5	1726.0	1722.9
5°	1726.0	1719.5	1701.2	1714.4	1711.3
7.5°	1714.4	1704.5	1686.2	1699.7	1696.3
10°	1696.3	1684.7	1664.8	1678.0	1673.0
12.5°	1671.3	1661.4	1641.5	1649.9	1646.4
15°	1643.1	1633.2	1611.6	1618.3	1610.0
17.5°	1608.3	1598.4	1576.8	1585.0	1576.8
20°	1570.0	1560.1	1537.0	1541.8	1535.4
22.5°	1532.0	1517.0	1495.4	1495.4	1492.0
25°	1487.1	1473.9	1445.7	1448.9	1445.7
27.5°	1437.3	1425.6	1404.2	1399.2	1391.0
30°	1387.6	1374.3	1349.4	1344.4	1337.8
32.5°	1334.5	1324.6	1298.0	1288.0	1281.2
35°	1283.0	1266.5	1239.9	1229.9	1221.6
37.5°	1224.9	1209.9	1183.3	1171.8	1163.5
40°	1165.2	1151.8	1125.2	1110.4	1103.8
42.5°	1107.1	1093.7	1067.3	1050.6	1040.7
45°	1044.0	1032.5	1007.4	989.3	982.6
47.5°	982.6	970.9	944.4	926.1	916.3
50°	917.8	909.5	886.3	863.0	854.7
52.5°	854.7	843.2	821.7	803.4	791.7
55°	790.2	780.1	760.2	740.3	732.1
57.5°	725.3	717.1	695.3	675.5	668.8
60°	660.5	654.0	630.8	612.5	607.5
62.5°	597.5	585.9	569.4	552.7	546.1
65°	532.9	522.8	506.3	491.3	483.1
67.5°	466.4	458.0	443.3	431.6	425.0
70°	405.0	398.4	383.4	371.7	365.2
72.5°	342.0	335.3	327.0	315.4	310.4
75°	278.8	275.6	267.2	257.3	260.6
77.5°	222.4	215.7	212.4	207.4	202.5
80°	166.0	164.2	160.9	156.0	152.7
82.5°	112.9	112.9	111.3	104.6	104.6
85°	68.0	66.4	64.8	59.7	58.1
87.5°	29.9	26.6	23.3	18.3	16.5
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P911692

CATALOG NUMBER: DFN2DIP-SQ2F0-040D070US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.68	11.46	11.73	12.51	13.93	10.24	11.01	11.29	12.06	13.48
	3H	12.32	13.01	13.37	14.07	15.51	11.83	12.52	12.88	13.58	15.02
	4H	12.89	13.54	13.96	14.61	16.05	12.39	13.05	13.46	14.11	15.56
	6H	13.27	13.87	14.35	14.94	16.39	12.77	13.37	13.85	14.44	15.89
	8H	13.36	13.94	14.44	15.02	16.47	12.86	13.44	13.94	14.52	15.97
	12H	13.40	13.95	14.49	15.02	16.50	12.89	13.44	13.98	14.51	15.99
4H	2H	11.12	11.78	12.20	12.84	14.29	10.77	11.42	11.84	12.48	13.93
	3H	12.96	13.50	14.04	14.59	16.05	12.55	13.10	13.63	14.19	15.64
	4H	13.65	14.15	14.74	15.23	16.71	13.23	13.73	14.32	14.81	16.29
	6H	14.14	14.57	15.24	15.68	17.15	13.71	14.14	14.81	15.25	16.72
	8H	14.28	14.68	15.38	15.78	17.27	13.85	14.25	14.94	15.34	16.83
	12H	14.34	14.71	15.45	15.81	17.31	13.89	14.26	15.01	15.37	16.86
8H	4H	13.83	14.23	14.93	15.33	16.82	13.45	13.85	14.55	14.95	16.44
	6H	14.43	14.77	15.55	15.90	17.39	14.05	14.38	15.17	15.52	17.00
	8H	14.64	14.93	15.76	16.05	17.56	14.25	14.54	15.37	15.66	17.16
	12H	14.75	15.01	15.88	16.13	17.67	14.34	14.60	15.47	15.72	17.26
12H	4H	13.81	14.17	14.92	15.28	16.78	13.44	13.80	14.55	14.91	16.41
	6H	14.46	14.75	15.58	15.87	17.37	14.08	14.38	15.21	15.49	17.00
	8H	14.68	14.94	15.81	16.05	17.59	14.30	14.56	15.43	15.67	17.21

END OF REPORT