

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911712

Luminaire Tested: DFN2DIP-SQ2F0-050D060US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911712
REPORT IS A COMBINATION OF REPORTS P899811 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D060US850-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11378.4 lumens
Efficiency: N/A
Efficacy: 126.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

Luminous Intensity Polar Plot

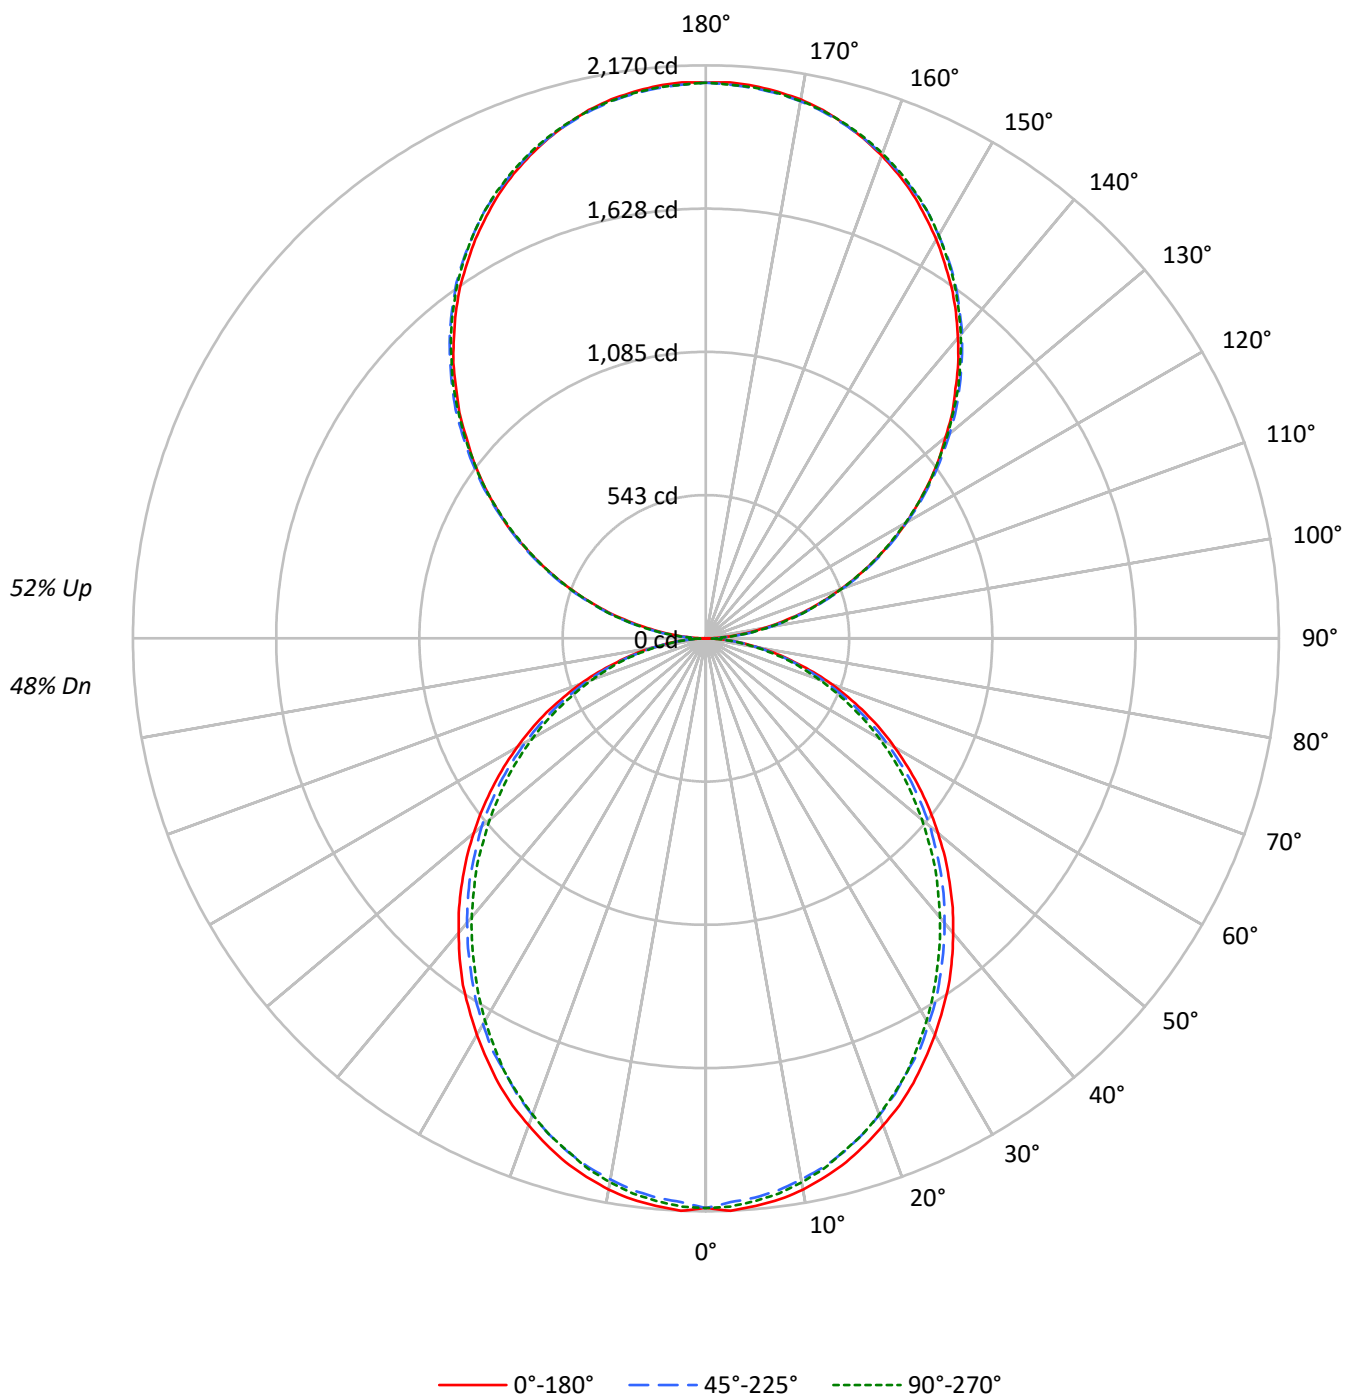

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4744	4744	4744
5°	4744	4668	4703
10°	4697	4595	4633
15°	4620	4509	4527
20°	4518	4393	4418
25°	4417	4258	4294
30°	4292	4130	4138
35°	4173	3982	3973
40°	4028	3832	3816
45°	3883	3681	3654
50°	3724	3522	3468
55°	3557	3338	3295
60°	3368	3122	3097
65°	3159	2896	2864
70°	2896	2621	2611
75°	2533	2290	2368
80°	2092	1870	1924
85°	1412	1181	1208

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3883 cd/sqm

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.8
10°-20°	571.4	5.0
20°-30°	839.7	7.4
30°-40°	975.2	8.6
40°-50°	974.0	8.6
50°-60°	849.3	7.5
60°-70°	627.9	5.5
70°-80°	355.2	3.1
80°-90°	99.7	0.9
90°-100°	130.2	1.1
100°-110°	413.7	3.6
110°-120°	708.0	6.2
120°-130°	931.2	8.2
130°-140°	1045.3	9.2
140°-150°	1025.0	9.0
150°-160°	859.8	7.6
160°-170°	570.2	5.0
170°-180°	199.3	1.8
0°-30°	1614.1	14.2
0°-40°	2589.4	22.8
0°-60°	4412.7	38.8
0°-90°	5495.5	48.3
90°-120°	1252.0	11.0
90°-150°	4253.5	37.4
90°-180°	5883.0	51.7
0°-180°	11378.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	2	23	62	58	60	11
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P911712

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.40	13.25	13.38	14.24	15.53	11.96	12.81	12.93	13.79	15.09
	3H	14.04	14.80	15.03	15.80	17.12	13.56	14.31	14.54	15.31	16.63
	4H	14.62	15.34	15.61	16.34	17.66	14.13	14.84	15.12	15.84	17.17
	6H	15.00	15.67	16.01	16.67	18.01	14.50	15.17	15.51	16.17	17.51
	8H	15.10	15.73	16.11	16.75	18.08	14.60	15.23	15.61	16.25	17.58
	12H	15.14	15.74	16.16	16.75	18.11	14.63	15.23	15.65	16.25	17.60
4H	2H	12.85	13.57	13.86	14.57	15.90	12.50	13.22	13.50	14.21	15.54
	3H	14.70	15.29	15.71	16.32	17.66	14.29	14.89	15.30	15.91	17.25
	4H	15.39	15.94	16.41	16.96	18.32	14.97	15.52	15.99	16.54	17.90
	6H	15.89	16.36	16.92	17.40	18.76	15.46	15.93	16.49	16.97	18.33
	8H	16.03	16.47	17.06	17.51	18.88	15.59	16.03	16.62	17.07	18.44
	12H	16.09	16.49	17.14	17.54	18.92	15.64	16.04	16.69	17.09	18.47
8H	4H	15.58	16.02	16.61	17.05	18.43	15.20	15.64	16.23	16.68	18.05
	6H	16.18	16.55	17.24	17.63	19.00	15.80	16.16	16.85	17.24	18.61
	8H	16.39	16.71	17.45	17.77	19.16	16.00	16.32	17.06	17.38	18.77
	12H	16.51	16.79	17.57	17.85	19.28	16.10	16.38	17.17	17.44	18.87
12H	4H	15.56	15.96	16.61	17.01	18.39	15.19	15.59	16.24	16.64	18.02
	6H	16.21	16.53	17.27	17.59	18.98	15.84	16.16	16.90	17.22	18.61
	8H	16.43	16.72	17.50	17.77	19.21	16.05	16.34	17.12	17.39	18.83