

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911726

Luminaire Tested: DFN2DIP-SQ2F0-060D030US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911726
REPORT IS A COMBINATION OF REPORTS P899778 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D030US850-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8600.3 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 77.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLLFLL

Luminous Intensity Polar Plot

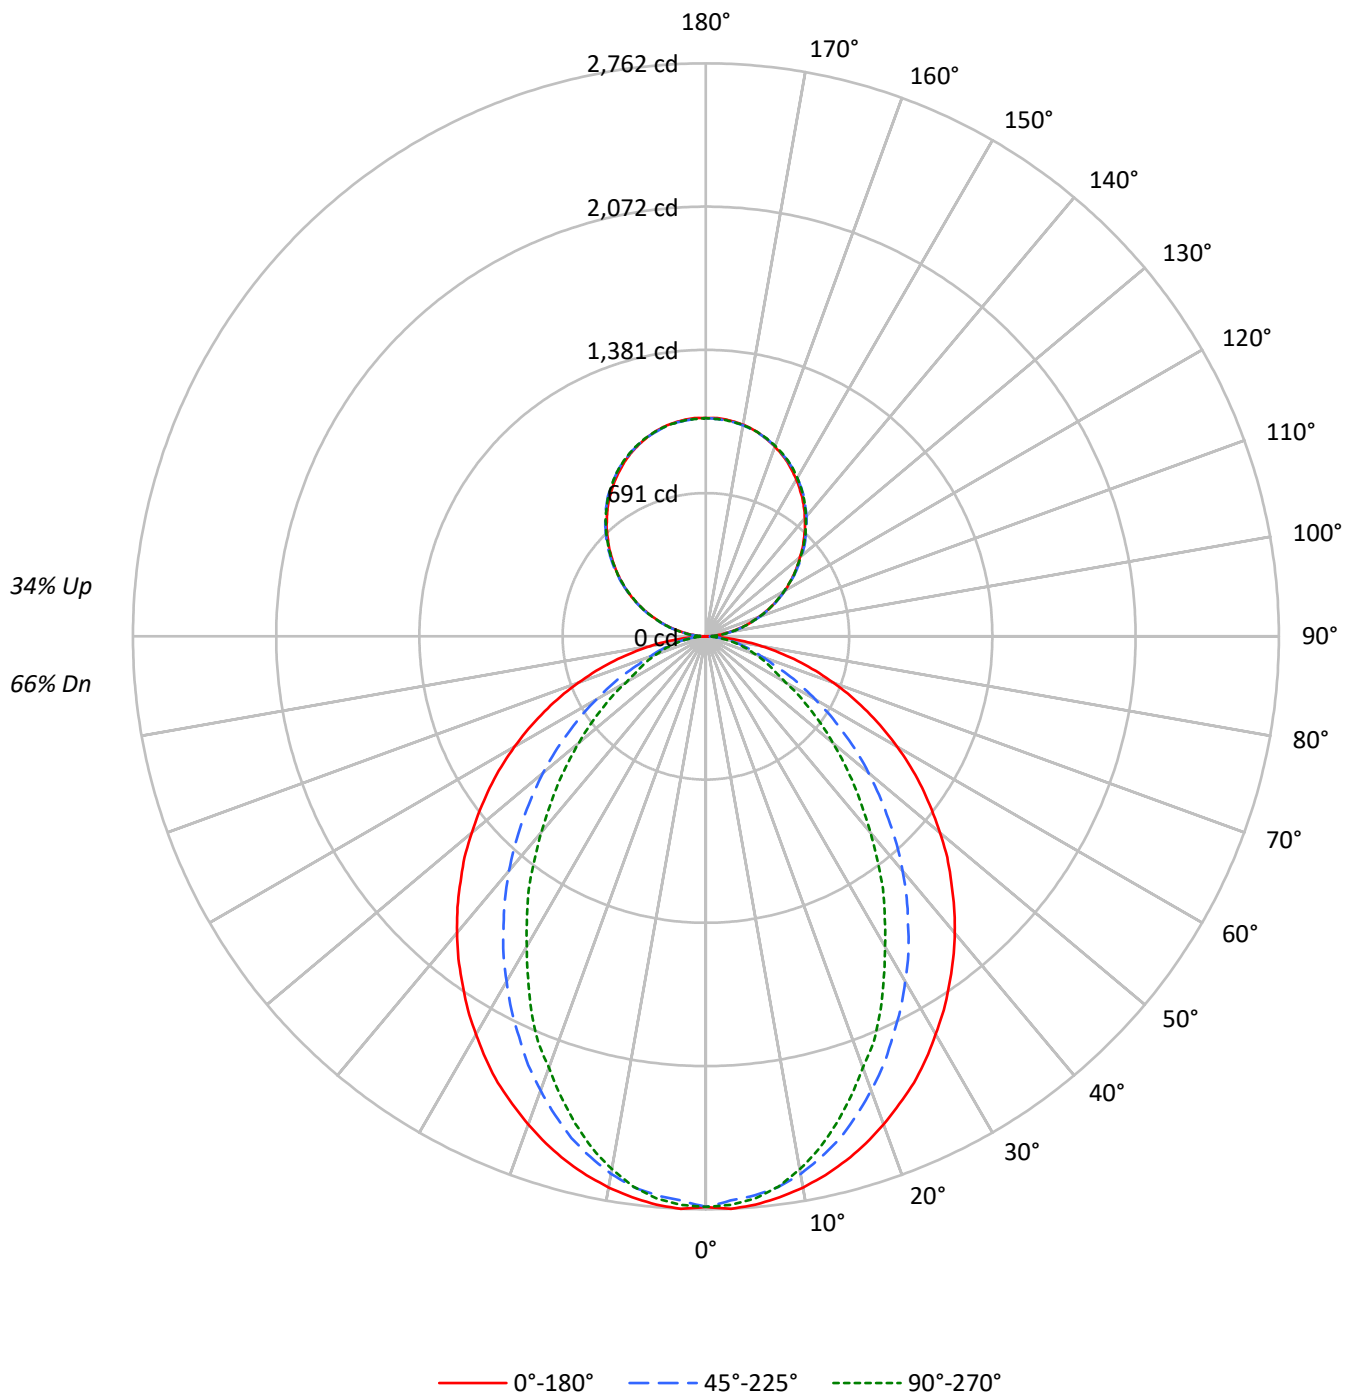

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6047	6047	6047
5°	6046	5938	5981
10°	5976	5809	5778
15°	5883	5604	5469
20°	5764	5327	5093
25°	5642	5019	4731
30°	5481	4704	4274
35°	5323	4368	3872
40°	5162	4020	3414
45°	4976	3638	2999
50°	4783	3252	2594
55°	4580	2841	2205
60°	4344	2414	1807
65°	4073	1982	1617
70°	3743	1578	1451
75°	3329	1366	1303
80°	2734	1109	1105
85°	1778	688	785

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4976 cd/sqm

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	3.0
10°-20°	707.6	8.2
20°-30°	993.4	11.6
30°-40°	1082.8	12.6
40°-50°	995.2	11.6
50°-60°	781.6	9.1
60°-70°	508.8	5.9
70°-80°	261.9	3.0
80°-90°	69.8	0.8
90°-100°	65.1	0.8
100°-110°	206.9	2.4
110°-120°	354.0	4.1
120°-130°	465.6	5.4
130°-140°	522.6	6.1
140°-150°	512.5	6.0
150°-160°	429.9	5.0
160°-170°	285.1	3.3
170°-180°	99.7	1.2
0°-30°	1958.7	22.8
0°-40°	3041.5	35.4
0°-60°	4818.4	56.0
0°-90°	5658.9	65.8
90°-120°	626.0	7.3
90°-150°	2126.7	24.7
90°-180°	2941.0	34.2
0°-180°	8600.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	1	11	31	29	30	8
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2

TEST NUMBER: P911726

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.64	15.62	15.46	16.46	17.48	10.61	11.58	11.42	12.42	13.45
	3H	16.31	17.19	17.14	18.03	19.09	11.79	12.66	12.62	13.51	14.56
	4H	16.92	17.74	17.76	18.59	19.66	12.23	13.06	13.08	13.91	14.98
	6H	17.33	18.09	18.19	18.95	20.03	12.54	13.30	13.40	14.16	15.24
	8H	17.45	18.17	18.32	19.05	20.13	12.63	13.35	13.50	14.23	15.31
	12H	17.51	18.20	18.38	19.07	20.17	12.67	13.36	13.54	14.23	15.33
4H	2H	14.68	15.50	15.53	16.35	17.42	11.21	12.03	12.06	12.88	13.95
	3H	16.50	17.18	17.36	18.06	19.15	12.55	13.24	13.41	14.12	15.20
	4H	17.18	17.80	18.05	18.68	19.79	13.09	13.71	13.96	14.59	15.70
	6H	17.68	18.22	18.57	19.12	20.24	13.50	14.03	14.39	14.94	16.05
	8H	17.85	18.35	18.74	19.25	20.38	13.62	14.12	14.51	15.02	16.14
	12H	17.94	18.39	18.85	19.31	20.44	13.68	14.13	14.59	15.05	16.18
8H	4H	17.15	17.65	18.04	18.55	19.68	13.37	13.87	14.26	14.77	15.90
	6H	17.70	18.12	18.62	19.06	20.18	13.87	14.28	14.79	15.22	16.35
	8H	17.91	18.27	18.84	19.21	20.35	14.04	14.41	14.97	15.35	16.49
	12H	18.04	18.36	18.97	19.29	20.48	14.16	14.48	15.09	15.40	16.60
12H	4H	17.11	17.56	18.02	18.48	19.61	13.38	13.83	14.29	14.75	15.88
	6H	17.68	18.04	18.61	18.98	20.12	13.91	14.28	14.84	15.21	16.36
	8H	17.89	18.21	18.82	19.14	20.33	14.11	14.44	15.04	15.36	16.56

END OF REPORT