

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911782

Luminaire Tested: DFN2DIP-SQ2F0-080D050US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911782
REPORT IS A COMBINATION OF REPORTS P899806 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D050US850-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12448.6 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 116.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLLFLL

Luminous Intensity Polar Plot

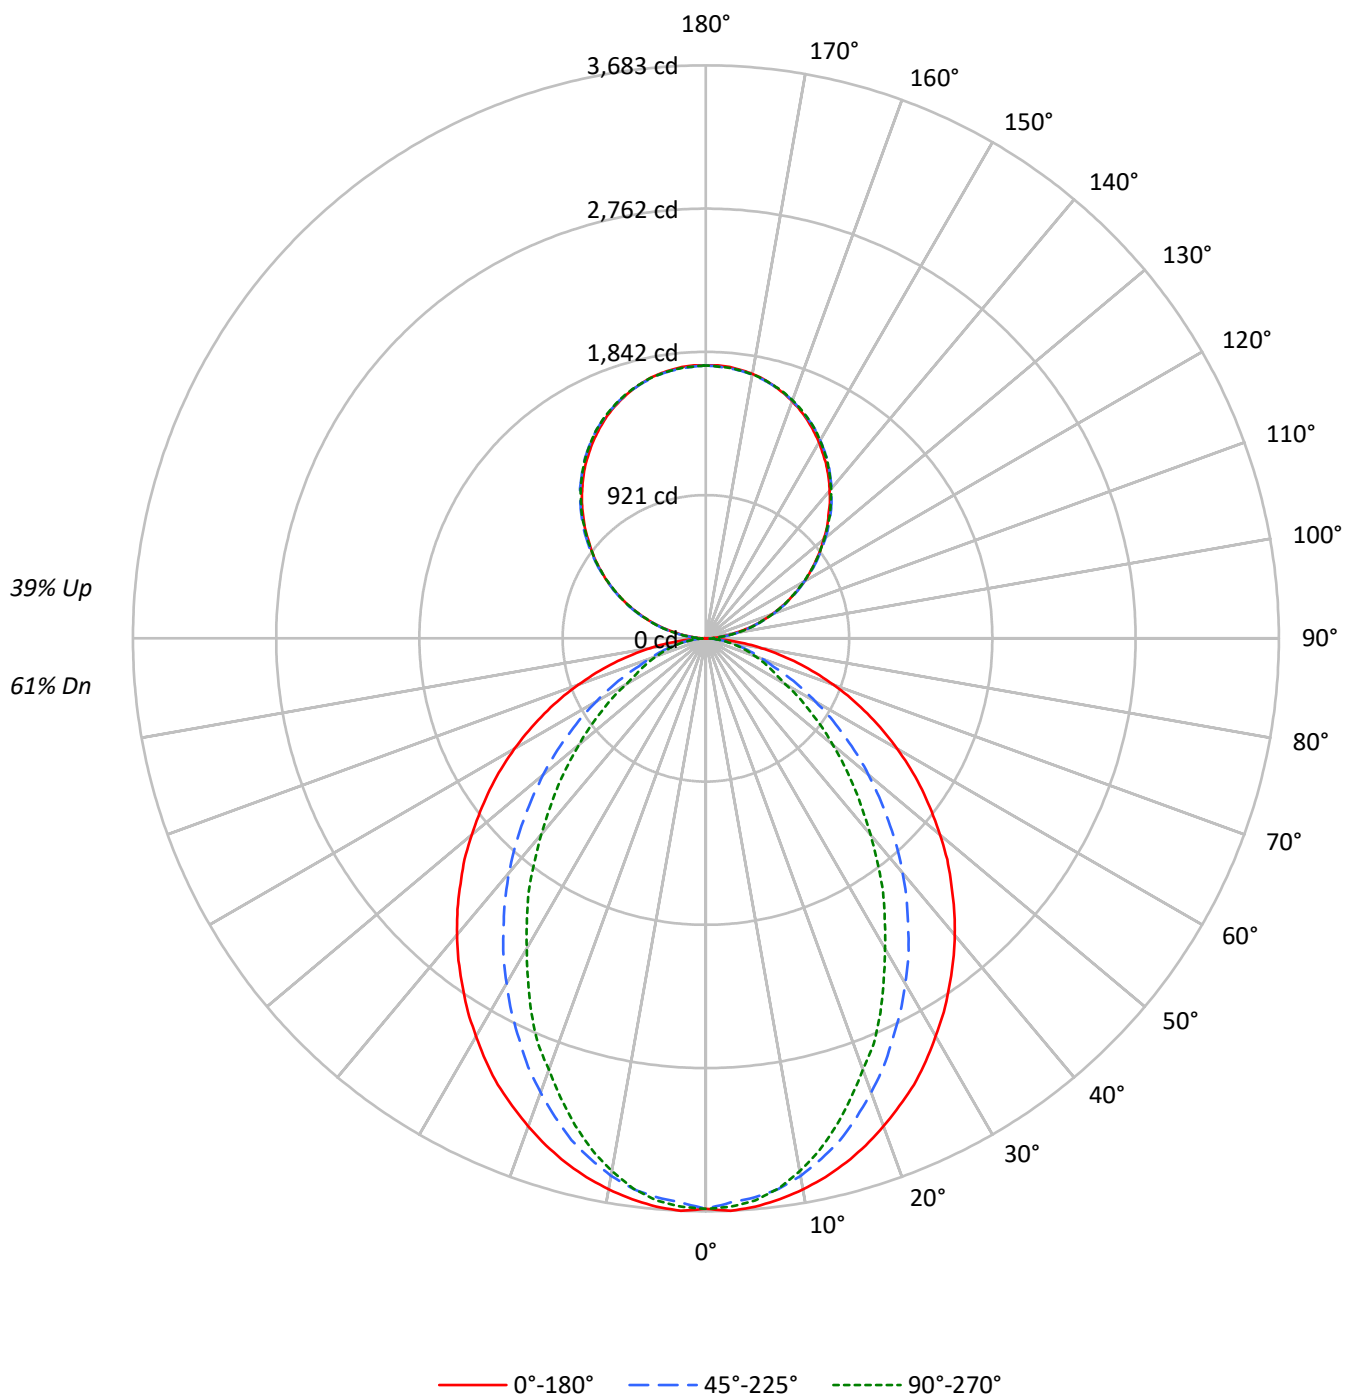

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	89	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	64	59	62	57	53	55	51	48	47	45	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	43	39	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	32
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	32	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	26	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	8063	8063	8063
5°	8062	7917	7974
10°	7968	7745	7704
15°	7844	7472	7292
20°	7685	7103	6791
25°	7522	6692	6308
30°	7308	6273	5698
35°	7098	5824	5163
40°	6883	5361	4552
45°	6635	4850	3998
50°	6377	4336	3458
55°	6106	3788	2940
60°	5792	3219	2410
65°	5431	2642	2156
70°	4991	2104	1935
75°	4438	1821	1738
80°	3644	1479	1473
85°	2372	918	1048

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 6635 cd/sqm

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	343.7	2.8
10°-20°	943.4	7.6
20°-30°	1324.5	10.6
30°-40°	1443.8	11.6
40°-50°	1327.0	10.7
50°-60°	1042.1	8.4
60°-70°	678.3	5.4
70°-80°	349.2	2.8
80°-90°	94.1	0.8
90°-100°	108.5	0.9
100°-110°	344.8	2.8
110°-120°	590.1	4.7
120°-130°	776.0	6.2
130°-140°	871.0	7.0
140°-150°	854.2	6.9
150°-160°	716.5	5.8
160°-170°	475.2	3.8
170°-180°	166.1	1.3
0°-30°	2611.6	21.0
0°-40°	4055.4	32.6
0°-60°	6424.5	51.6
0°-90°	7546.2	60.6
90°-120°	1043.4	8.4
90°-150°	3544.6	28.5
90°-180°	4902.0	39.4
0°-180°	12448.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3667	3667	3667	3667	3667	
5°	3667	3650	3607	3637	3627	348
15°	3488	3451	3338	3275	3242	983
25°	3166	3060	2840	2705	2655	1456
35°	2728	2558	2267	2058	1984	1707
45°	2230	2008	1659	1423	1344	1722
55°	1696	1437	1078	879	816	1515
65°	1145	876	577	465	454	1135
75°	610	378	266	242	239	646
85°	143	73	63	63	63	164
90°	2	19	52	49	50	12
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1371	1373	1367	845
155°	1546	1551	1555	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3666.8	3666.8	3666.8	3666.8	3666.8
2.5°	3683.3	3666.8	3630.2	3663.6	3656.9
5°	3666.8	3650.3	3606.9	3636.9	3627.0
7.5°	3636.9	3617.1	3570.6	3583.7	3567.1
10°	3597.0	3573.9	3507.7	3497.5	3477.7
12.5°	3547.5	3517.5	3427.7	3408.0	3371.4
15°	3487.6	3451.0	3338.3	3275.3	3242.2
17.5°	3417.8	3364.7	3225.3	3152.4	3099.2
20°	3338.3	3271.8	3106.0	3023.2	2949.9
22.5°	3252.0	3175.6	2983.1	2870.4	2820.7
25°	3165.8	3059.5	2840.5	2704.6	2654.6
27.5°	3062.9	2949.9	2707.7	2551.8	2475.4
30°	2953.5	2827.1	2561.7	2392.7	2302.8
32.5°	2847.1	2694.4	2422.6	2223.3	2140.3
35°	2727.8	2558.5	2266.6	2057.5	1984.2
37.5°	2611.6	2428.9	2120.5	1891.3	1808.6
40°	2488.8	2289.9	1967.7	1732.1	1645.9
42.5°	2362.7	2150.5	1815.2	1569.6	1486.7
45°	2230.0	2007.5	1659.3	1423.4	1343.9
47.5°	2104.0	1868.4	1510.0	1274.1	1201.3
50°	1964.5	1729.0	1364.0	1134.7	1065.3
52.5°	1828.3	1579.3	1224.4	1005.5	942.5
55°	1695.6	1436.8	1078.4	879.4	816.4
57.5°	1559.7	1294.2	949.2	763.3	710.1
60°	1420.2	1154.8	812.9	643.9	590.8
62.5°	1284.3	1018.8	696.8	537.6	511.2
65°	1144.9	875.9	577.3	464.8	454.5
67.5°	1012.2	743.3	464.8	408.0	398.2
70°	872.8	614.1	384.8	351.7	338.4
72.5°	740.0	494.3	321.8	295.4	288.7
75°	610.5	378.2	265.5	242.2	239.1
77.5°	481.3	268.6	209.2	195.7	189.1
80°	361.5	192.6	159.1	146.1	146.1
82.5°	252.1	129.5	109.5	102.8	102.8
85°	142.6	72.9	63.0	63.0	63.0
87.5°	53.1	26.4	26.4	23.3	23.3
90°	1.6	19.1	51.8	48.7	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.6	94.6	92.0
97.5°	128.4	142.2	148.1	148.1	148.1
100°	187.6	199.8	204.1	204.1	202.5
102.5°	250.1	259.1	264.8	266.5	264.8
105°	318.3	322.5	325.7	328.3	328.3
107.5°	385.9	392.3	392.3	393.4	385.9
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.3	531.3	529.8	525.6	522.3
115°	592.1	600.6	598.0	596.4	592.1
117.5°	661.4	673.1	665.6	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.0	797.8	794.6
125°	861.2	874.4	870.2	865.5	863.9
127.5°	926.2	942.6	936.9	930.5	926.2
130°	987.1	1006.1	1003.4	1000.3	994.4
132.5°	1055.3	1070.1	1071.2	1063.8	1059.5
135°	1114.0	1130.3	1133.5	1132.0	1127.7
137.5°	1179.5	1192.7	1195.4	1194.3	1188.0
140°	1237.1	1250.4	1257.7	1257.7	1252.0
142.5°	1296.3	1309.6	1313.8	1315.4	1309.6
145°	1352.4	1363.0	1371.4	1373.1	1367.2
147.5°	1402.7	1415.9	1422.2	1424.8	1419.0
150°	1454.5	1463.4	1469.2	1474.0	1469.2
152.5°	1500.5	1509.5	1516.8	1522.7	1516.8
155°	1546.4	1550.6	1555.4	1562.8	1558.0
157.5°	1586.1	1589.2	1591.9	1602.5	1595.1
160°	1621.5	1624.7	1626.2	1635.2	1628.9
162.5°	1654.3	1654.3	1655.8	1665.9	1658.5
165°	1682.4	1680.7	1680.7	1691.3	1683.9
167.5°	1707.6	1702.9	1702.9	1713.5	1706.1
170°	1726.7	1722.5	1720.9	1731.5	1722.5
172.5°	1739.9	1735.7	1734.1	1744.7	1735.7
175°	1750.6	1746.2	1743.1	1753.7	1744.7
177.5°	1756.3	1752.1	1748.9	1757.9	1748.9
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P911782

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.22	16.15	16.09	17.03	18.14	11.18	12.11	12.05	12.99	14.10
	3H	16.89	17.71	17.77	18.61	19.75	12.36	13.19	13.24	14.08	15.22
	4H	17.49	18.27	18.38	19.17	20.32	12.80	13.58	13.70	14.48	15.63
	6H	17.90	18.62	18.80	19.52	20.68	13.11	13.83	14.02	14.74	15.90
	8H	18.02	18.70	18.93	19.62	20.79	13.19	13.88	14.11	14.80	15.96
	12H	18.07	18.72	18.99	19.64	20.83	13.23	13.88	14.15	14.80	15.99
4H	2H	15.25	16.03	16.15	16.93	18.08	11.78	12.56	12.68	13.46	14.61
	3H	17.06	17.71	17.97	18.64	19.81	13.12	13.76	14.03	14.69	15.86
	4H	17.74	18.33	18.66	19.26	20.45	13.65	14.24	14.57	15.17	16.36
	6H	18.24	18.75	19.18	19.70	20.89	14.06	14.56	14.99	15.51	16.71
	8H	18.41	18.88	19.35	19.83	21.03	14.18	14.65	15.11	15.60	16.80
	12H	18.50	18.92	19.45	19.89	21.10	14.23	14.66	15.19	15.62	16.83
8H	4H	17.71	18.19	18.65	19.13	20.34	13.93	14.40	14.87	15.35	16.55
	6H	18.26	18.65	19.22	19.64	20.84	14.42	14.82	15.39	15.80	17.01
	8H	18.46	18.81	19.44	19.79	21.01	14.60	14.95	15.57	15.92	17.15
	12H	18.59	18.90	19.57	19.87	21.14	14.71	15.01	15.69	15.98	17.25
12H	4H	17.67	18.09	18.62	19.06	20.27	13.93	14.36	14.89	15.32	16.53
	6H	18.23	18.58	19.21	19.56	20.78	14.47	14.82	15.44	15.79	17.01
	8H	18.44	18.75	19.42	19.72	20.99	14.67	14.97	15.64	15.94	17.21

END OF REPORT