

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911792

Luminaire Tested: DFN2DIP-SQ2F0-080D080US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911792
REPORT IS A COMBINATION OF REPORTS P899841 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D080US850-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16635.0 lumens
Efficiency: N/A
Efficacy: 115.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

Luminous Intensity Polar Plot

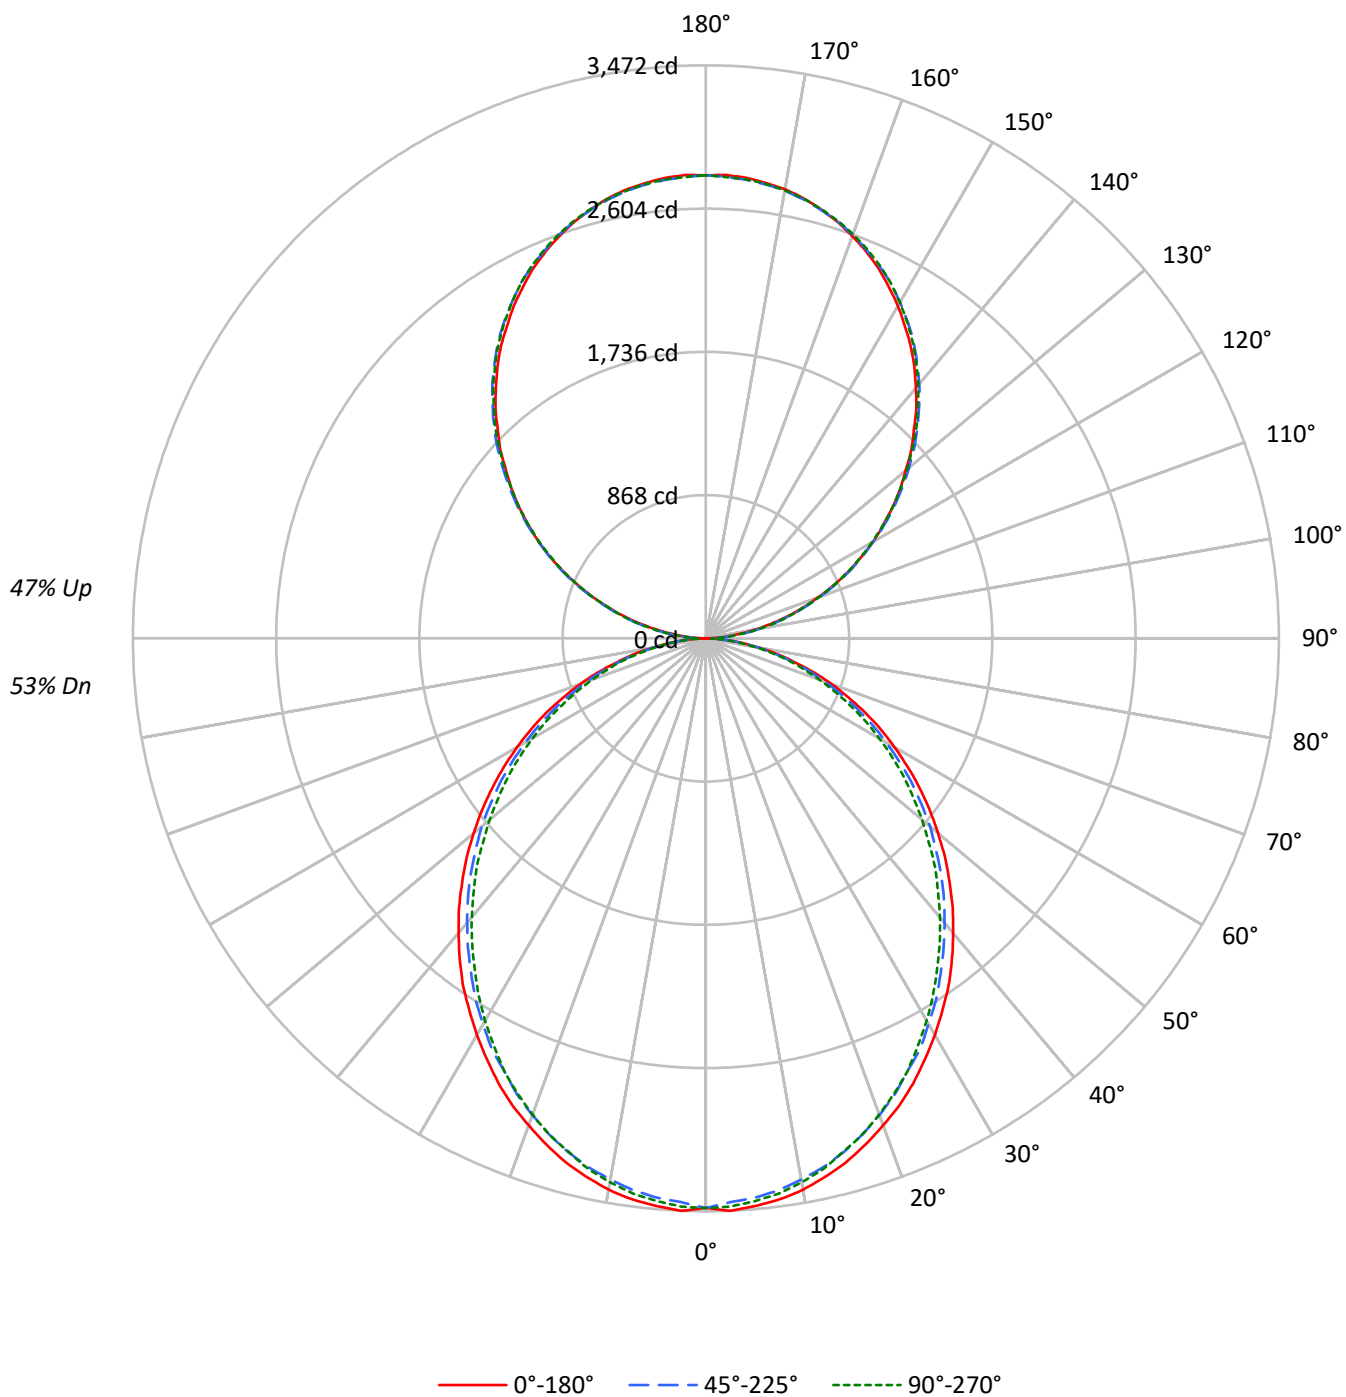

TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	7591	7591	7591
5°	7590	7469	7525
10°	7515	7352	7412
15°	7392	7214	7243
20°	7229	7029	7069
25°	7067	6812	6871
30°	6867	6609	6621
35°	6677	6371	6357
40°	6445	6131	6105
45°	6213	5889	5847
50°	5958	5634	5549
55°	5691	5341	5272
60°	5388	4995	4955
65°	5055	4633	4582
70°	4632	4193	4177
75°	4053	3665	3789
80°	3347	2992	3077
85°	2262	1889	1933

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 6213 cd/sqm

TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	324.9	2.0
10°-20°	914.2	5.5
20°-30°	1343.5	8.1
30°-40°	1560.4	9.4
40°-50°	1558.4	9.4
50°-60°	1358.9	8.2
60°-70°	1004.5	6.0
70°-80°	568.4	3.4
80°-90°	158.0	0.9
90°-100°	173.6	1.0
100°-110°	551.7	3.3
110°-120°	944.1	5.7
120°-130°	1241.6	7.5
130°-140°	1393.7	8.4
140°-150°	1366.6	8.2
150°-160°	1146.4	6.9
160°-170°	760.3	4.6
170°-180°	265.7	1.6
0°-30°	2582.6	15.5
0°-40°	4143.0	24.9
0°-60°	7060.4	42.4
0°-90°	8791.3	52.8
90°-120°	1669.4	10.0
90°-150°	5671.3	34.1
90°-180°	7844.0	47.2
0°-180°	16635.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3452	3452	3452	3452	3452	
5°	3452	3439	3402	3429	3423	328
15°	3286	3267	3223	3237	3220	926
25°	2974	2948	2892	2898	2892	1369
35°	2566	2533	2480	2460	2443	1602
45°	2088	2065	2015	1979	1965	1612
55°	1580	1560	1520	1481	1464	1413
65°	1066	1046	1012	983	966	1054
75°	558	551	534	515	521	595
85°	136	133	130	119	116	152
90°	3	30	83	78	80	16
95°	124	147	151	151	147	137
105°	509	516	521	525	525	537
115°	947	961	957	954	947	937
125°	1378	1399	1392	1385	1382	1231
135°	1782	1809	1814	1811	1804	1378
145°	2164	2181	2194	2197	2188	1352
155°	2474	2481	2489	2500	2493	1139
165°	2692	2689	2689	2706	2694	759
175°	2801	2794	2789	2806	2792	266
180°	2806	2806	2806	2806	2806	

TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3452.1	3452.1	3452.1	3452.1	3452.1
2.5°	3472.2	3455.6	3419.0	3452.1	3445.8
5°	3452.1	3439.1	3402.5	3428.9	3422.6
7.5°	3428.9	3409.2	3372.6	3399.3	3392.7
10°	3392.7	3369.4	3329.6	3355.9	3346.2
12.5°	3342.6	3322.9	3283.1	3299.6	3293.0
15°	3286.3	3266.6	3223.2	3236.6	3220.1
17.5°	3216.5	3196.8	3153.4	3170.1	3153.4
20°	3140.1	3120.4	3073.9	3083.8	3070.7
22.5°	3064.1	3034.1	2990.8	2990.8	2984.1
25°	2974.2	2947.8	2891.5	2897.8	2891.5
27.5°	2874.5	2851.3	2808.3	2798.5	2781.9
30°	2775.3	2748.4	2698.9	2689.0	2675.6
32.5°	2668.9	2649.2	2595.9	2575.9	2562.6
35°	2566.0	2533.0	2479.7	2459.7	2443.1
37.5°	2449.8	2419.8	2366.7	2343.4	2326.9
40°	2330.5	2303.6	2250.5	2220.9	2207.5
42.5°	2214.2	2187.4	2134.6	2101.1	2081.5
45°	2088.1	2064.8	2014.8	1978.6	1965.3
47.5°	1965.3	1942.0	1888.7	1852.1	1832.4
50°	1835.6	1819.1	1772.5	1726.0	1709.5
52.5°	1709.5	1686.2	1643.3	1606.7	1583.4
55°	1580.2	1560.1	1520.4	1480.6	1464.0
57.5°	1450.7	1434.2	1390.8	1351.0	1337.6
60°	1321.0	1308.1	1261.5	1224.9	1215.0
62.5°	1194.9	1171.8	1138.6	1105.6	1092.1
65°	1065.7	1045.7	1012.5	982.6	966.0
67.5°	932.9	916.0	886.4	863.2	849.8
70°	810.0	796.6	766.8	743.5	730.4
72.5°	683.9	670.6	654.0	630.8	620.9
75°	557.5	551.2	534.3	514.6	521.2
77.5°	444.8	431.4	424.7	414.9	405.0
80°	332.1	328.6	321.9	312.1	305.3
82.5°	225.8	225.8	222.6	209.2	209.2
85°	136.0	132.7	129.6	119.4	116.2
87.5°	59.9	53.2	46.5	36.6	33.2
90°	2.6	30.5	83.0	77.9	80.4
92.5°	52.5	71.1	73.6	76.1	76.1
95°	123.5	147.2	151.4	151.4	147.2
97.5°	205.6	227.6	236.9	236.9	236.9
100°	300.3	319.7	326.5	326.5	323.9
102.5°	400.1	414.5	423.7	426.3	423.7
105°	509.3	516.0	521.1	525.3	525.3
107.5°	617.5	627.7	627.7	629.4	617.5
110°	722.4	735.9	735.9	735.9	729.2



TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	835.7	850.2	847.6	840.8	835.7
115°	947.4	960.9	956.7	954.2	947.4
117.5°	1058.2	1076.8	1065.0	1058.2	1051.4
120°	1169.9	1188.5	1169.9	1169.9	1162.2
122.5°	1271.4	1295.1	1283.2	1276.5	1271.4
125°	1377.9	1399.1	1392.3	1384.7	1382.3
127.5°	1482.1	1508.2	1498.9	1488.8	1482.1
130°	1579.3	1609.7	1605.5	1600.5	1591.2
132.5°	1688.5	1712.1	1713.8	1702.0	1695.2
135°	1782.3	1808.6	1813.7	1811.1	1804.3
137.5°	1887.2	1908.4	1912.6	1910.9	1900.7
140°	1979.5	2000.5	2012.4	2012.4	2003.1
142.5°	2074.2	2095.3	2102.1	2104.7	2095.3
145°	2163.9	2180.7	2194.3	2196.8	2187.5
147.5°	2244.2	2265.4	2275.4	2279.8	2270.5
150°	2327.1	2341.4	2350.7	2358.4	2350.7
152.5°	2400.7	2415.1	2426.9	2436.3	2426.9
155°	2474.3	2481.1	2488.7	2500.5	2492.9
157.5°	2537.7	2542.8	2547.0	2563.9	2552.1
160°	2594.4	2599.5	2602.0	2616.4	2606.3
162.5°	2646.9	2646.9	2649.4	2665.5	2653.6
165°	2691.7	2689.1	2689.1	2706.1	2694.2
167.5°	2732.2	2724.7	2724.7	2741.6	2729.7
170°	2762.7	2756.0	2753.4	2770.4	2756.0
172.5°	2783.9	2777.2	2774.6	2791.5	2777.2
175°	2800.8	2794.0	2788.9	2805.9	2791.5
177.5°	2810.1	2803.3	2798.2	2812.6	2798.2
180°	2805.9	2805.9	2805.9	2805.9	2805.9

TEST NUMBER: P911792

CATALOG NUMBER: DFN2DIP-SQ2F0-080D080US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.46	15.35	15.39	16.30	17.53	14.01	14.90	14.95	15.85	17.08
	3H	16.10	16.90	17.04	17.86	19.11	15.61	16.41	16.55	17.37	18.62
	4H	16.68	17.43	17.63	18.39	19.66	16.18	16.94	17.14	17.90	19.16
	6H	17.06	17.76	18.03	18.73	20.00	16.56	17.26	17.53	18.23	19.50
	8H	17.16	17.82	18.14	18.81	20.08	16.66	17.32	17.64	18.31	19.58
	12H	17.20	17.83	18.18	18.81	20.11	16.69	17.32	17.68	18.30	19.60
4H	2H	14.91	15.66	15.88	16.63	17.89	14.56	15.31	15.52	16.27	17.53
	3H	16.76	17.39	17.73	18.38	19.65	16.35	16.98	17.32	17.97	19.25
	4H	17.46	18.03	18.44	19.02	20.32	17.03	17.61	18.01	18.59	19.89
	6H	17.95	18.45	18.95	19.46	20.76	17.52	18.02	18.52	19.03	20.33
	8H	18.09	18.56	19.09	19.56	20.87	17.66	18.12	18.65	19.12	20.44
	12H	18.16	18.58	19.18	19.60	20.92	17.71	18.13	18.73	19.15	20.47
8H	4H	17.64	18.11	18.64	19.11	20.42	17.27	17.73	18.26	18.73	20.04
	6H	18.25	18.63	19.27	19.68	20.99	17.87	18.25	18.89	19.30	20.61
	8H	18.46	18.80	19.49	19.83	21.16	18.07	18.40	19.10	19.44	20.77
	12H	18.58	18.88	19.61	19.90	21.28	18.17	18.47	19.20	19.49	20.87
12H	4H	17.63	18.05	18.64	19.07	20.38	17.26	17.68	18.27	18.70	20.01
	6H	18.28	18.61	19.31	19.65	20.98	17.90	18.24	18.93	19.27	20.60
	8H	18.50	18.80	19.54	19.83	21.20	18.12	18.42	19.16	19.45	20.82