

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914439

Luminaire Tested: DFN2DIP-SQ2F0-050D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914439
REPORT IS A COMBINATION OF REPORTS P901320 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US927-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7288.1 lumens
Efficiency: N/A
Efficacy: 89.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLLONL

Luminous Intensity Polar Plot

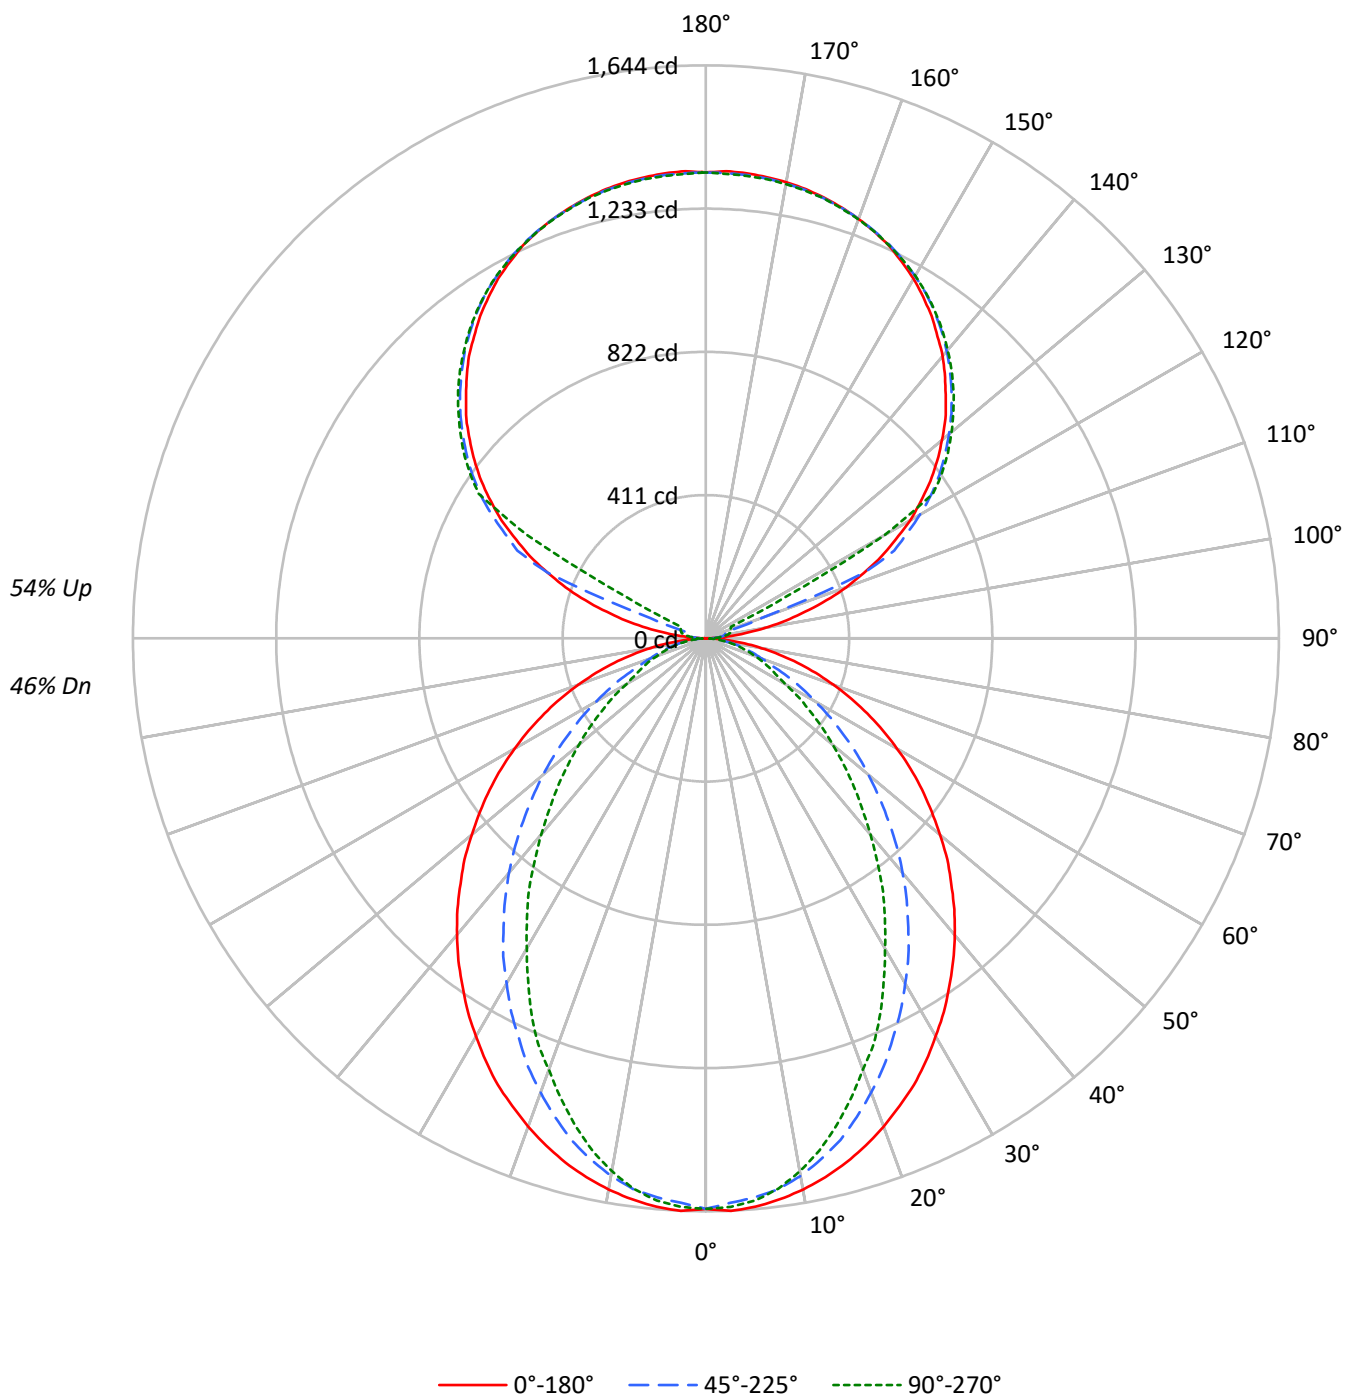

TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3600	3600	3600
5°	3599	3535	3560
10°	3557	3458	3439
15°	3502	3336	3256
20°	3431	3171	3032
25°	3358	2988	2816
30°	3263	2801	2544
35°	3169	2600	2305
40°	3073	2393	2032
45°	2962	2165	1785
50°	2847	1936	1544
55°	2726	1691	1313
60°	2586	1437	1075
65°	2424	1180	963
70°	2229	940	864
75°	1982	813	776
80°	1627	661	657
85°	1060	410	467

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2962 cd/sqm

TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	153.4	2.1
10°-20°	421.2	5.8
20°-30°	591.3	8.1
30°-40°	644.6	8.8
40°-50°	592.4	8.1
50°-60°	465.3	6.4
60°-70°	302.9	4.2
70°-80°	155.9	2.1
80°-90°	42.2	0.6
90°-100°	44.1	0.6
100°-110°	164.3	2.3
110°-120°	435.8	6.0
120°-130°	722.8	9.9
130°-140°	767.8	10.5
140°-150°	713.6	9.8
150°-160°	573.7	7.9
160°-170°	369.7	5.1
170°-180°	127.2	1.7
0°-30°	1165.9	16.0
0°-40°	1810.5	24.8
0°-60°	2868.2	39.4
0°-90°	3369.1	46.2
90°-120°	644.2	8.8
90°-150°	2848.4	39.1
90°-180°	3919.0	53.8
0°-180°	7288.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1637	1637	1637	1637	1637	
5°	1637	1630	1610	1624	1619	155
15°	1557	1541	1490	1462	1448	439
25°	1413	1366	1268	1207	1185	650
35°	1218	1142	1012	918	886	762
45°	996	896	741	636	600	769
55°	757	641	481	393	364	676
65°	511	391	258	208	203	507
75°	273	169	118	108	107	288
85°	64	33	28	28	28	73
90°	1	12	19	24	26	7
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1637.0	1637.0	1637.0	1637.0	1637.0
2.5°	1644.4	1637.0	1620.7	1635.6	1632.6
5°	1637.0	1629.7	1610.3	1623.7	1619.3
7.5°	1623.7	1614.9	1594.1	1600.0	1592.5
10°	1605.9	1595.5	1566.0	1561.5	1552.6
12.5°	1583.7	1570.4	1530.3	1521.5	1505.1
15°	1557.0	1540.7	1490.4	1462.3	1447.5
17.5°	1525.9	1502.2	1439.9	1407.4	1383.6
20°	1490.4	1460.7	1386.6	1349.7	1317.0
22.5°	1451.9	1417.8	1331.8	1281.5	1259.3
25°	1413.3	1365.9	1268.1	1207.4	1185.1
27.5°	1367.5	1317.0	1208.9	1139.2	1105.2
30°	1318.6	1262.2	1143.7	1068.2	1028.1
32.5°	1271.1	1202.9	1081.6	992.6	955.5
35°	1217.8	1142.2	1011.9	918.5	885.9
37.5°	1165.9	1084.4	946.7	844.4	807.5
40°	1111.1	1022.3	878.4	773.3	734.8
42.5°	1054.9	960.0	810.4	700.7	663.8
45°	995.6	896.3	740.8	635.5	599.9
47.5°	939.3	834.2	674.1	568.9	536.3
50°	877.1	771.9	608.9	506.6	475.6
52.5°	816.3	705.1	546.7	448.9	420.8
55°	757.0	641.4	481.4	392.6	364.5
57.5°	696.3	577.8	423.7	340.8	317.0
60°	634.1	515.6	362.9	287.5	263.7
62.5°	573.4	454.9	311.1	240.0	228.2
65°	511.1	391.1	257.8	207.5	203.0
67.5°	451.9	331.8	207.5	182.2	177.8
70°	389.7	274.1	171.8	157.0	151.1
72.5°	330.4	220.7	143.7	131.9	128.9
75°	272.6	168.8	118.5	108.1	106.7
77.5°	214.8	119.9	93.4	87.4	84.4
80°	161.4	86.0	71.1	65.2	65.2
82.5°	112.6	57.8	48.9	45.9	45.9
85°	63.7	32.6	28.1	28.1	28.1
87.5°	23.8	11.8	11.8	10.4	10.4
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4



TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914439

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.12	11.92	12.11	12.92	14.25	7.08	7.88	8.08	8.88	10.21
	3H	12.77	13.49	13.78	14.50	15.85	8.25	8.96	9.25	9.98	11.32
	4H	13.37	14.05	14.39	15.06	16.42	8.68	9.36	9.70	10.38	11.73
	6H	13.77	14.40	14.80	15.42	16.78	8.99	9.61	10.02	10.63	12.00
	8H	13.89	14.48	14.92	15.52	16.88	9.07	9.66	10.10	10.70	12.06
	12H	13.94	14.51	14.98	15.53	16.92	9.10	9.67	10.14	10.69	12.08
4H	2H	11.13	11.81	12.15	12.82	14.18	7.66	8.34	8.69	9.35	10.71
	3H	12.93	13.50	13.97	14.54	15.91	8.99	9.55	10.02	10.59	11.96
	4H	13.61	14.12	14.65	15.16	16.55	9.52	10.03	10.56	11.07	12.46
	6H	14.10	14.54	15.15	15.60	16.99	9.92	10.36	10.97	11.42	12.80
	8H	14.27	14.68	15.32	15.73	17.13	10.03	10.45	11.09	11.50	12.90
	12H	14.35	14.72	15.42	15.79	17.19	10.09	10.46	11.16	11.53	12.93
8H	4H	13.57	13.98	14.62	15.03	16.44	9.78	10.20	10.84	11.25	12.65
	6H	14.11	14.45	15.19	15.55	16.95	10.28	10.62	11.35	11.71	13.11
	8H	14.32	14.62	15.40	15.69	17.11	10.45	10.75	11.54	11.83	13.25
	12H	14.44	14.70	15.52	15.77	17.23	10.56	10.82	11.64	11.89	13.35
12H	4H	13.52	13.89	14.59	14.96	16.36	9.79	10.16	10.85	11.22	12.63
	6H	14.09	14.39	15.17	15.46	16.88	10.32	10.62	11.40	11.70	13.12
	8H	14.29	14.55	15.38	15.63	17.09	10.51	10.78	11.60	11.85	13.31

END OF REPORT