

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914452

Luminaire Tested: DFN2DIP-SQ2F0-060D030US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914452
REPORT IS A COMBINATION OF REPORTS P899777 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D030US927-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6808.8 lumens
Efficiency: N/A
Efficacy: 87.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 77.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

Luminous Intensity Polar Plot

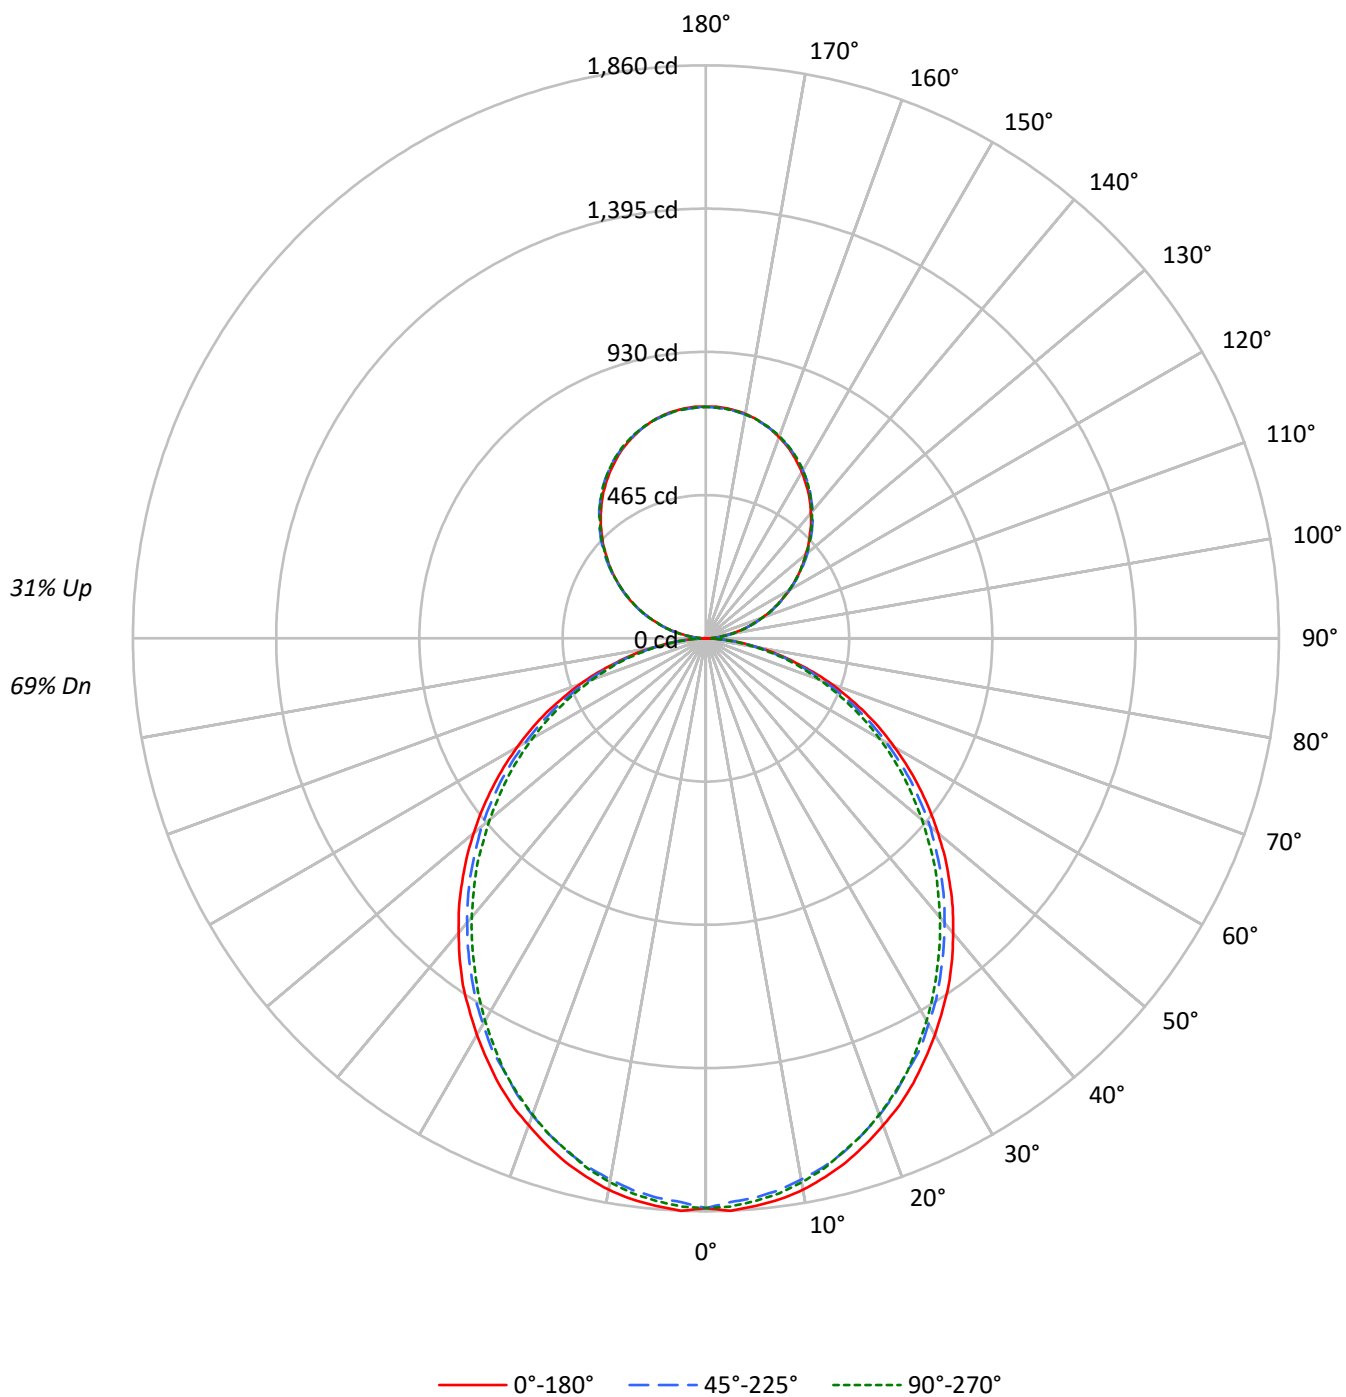

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4067	4067	4067
5°	4066	4001	4031
10°	4026	3939	3971
15°	3960	3865	3880
20°	3873	3766	3787
25°	3786	3649	3681
30°	3679	3541	3547
35°	3577	3413	3406
40°	3453	3285	3271
45°	3328	3155	3132
50°	3192	3019	2973
55°	3049	2861	2824
60°	2886	2676	2655
65°	2708	2482	2455
70°	2482	2246	2238
75°	2171	1963	2030
80°	1793	1603	1649
85°	1211	1012	1036

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3328 cd/sqm

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	2.6
10°-20°	489.8	7.2
20°-30°	719.8	10.6
30°-40°	836.0	12.3
40°-50°	834.9	12.3
50°-60°	728.0	10.7
60°-70°	538.2	7.9
70°-80°	304.5	4.5
80°-90°	82.5	1.2
90°-100°	46.5	0.7
100°-110°	147.8	2.2
110°-120°	252.9	3.7
120°-130°	332.6	4.9
130°-140°	373.3	5.5
140°-150°	366.1	5.4
150°-160°	307.1	4.5
160°-170°	203.7	3.0
170°-180°	71.2	1.0
0°-30°	1383.6	20.3
0°-40°	2219.6	32.6
0°-60°	3782.5	55.6
0°-90°	4707.7	69.1
90°-120°	447.2	6.6
90°-150°	1519.2	22.3
90°-180°	2101.0	30.9
0°-180°	6808.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	1	8	22	21	22	7
95°	33	40	41	41	40	37
105°	136	138	140	141	141	144
115°	254	257	256	256	254	251
125°	369	375	373	371	370	330
135°	477	484	486	485	483	369
145°	580	584	588	588	586	362
155°	663	665	667	670	668	305
165°	721	720	720	725	722	203
175°	750	748	747	752	748	71
180°	752	752	752	752	752	

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	0.7	8.2	22.2	20.8	21.5
92.5°	14.0	19.0	19.7	20.4	20.4
95°	33.1	39.5	40.6	40.6	39.5
97.5°	55.1	60.9	63.5	63.5	63.5
100°	80.4	85.6	87.5	87.5	86.8
102.5°	107.2	111.1	113.5	114.2	113.5
105°	136.4	138.2	139.6	140.7	140.7
107.5°	165.4	168.1	168.1	168.6	165.4
110°	193.5	197.2	197.2	197.2	195.4

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	223.9	227.8	227.0	225.2	223.9
115°	253.8	257.4	256.3	255.6	253.8
117.5°	283.4	288.4	285.3	283.4	281.6
120°	313.4	318.4	313.4	313.4	311.3
122.5°	340.6	346.9	343.7	341.9	340.6
125°	369.2	374.8	373.0	370.9	370.3
127.5°	397.0	404.0	401.6	398.8	397.0
130°	423.0	431.2	430.1	428.7	426.2
132.5°	452.3	458.6	459.1	455.9	454.1
135°	477.4	484.4	485.8	485.1	483.3
137.5°	505.5	511.2	512.3	511.9	509.1
140°	530.2	535.9	539.1	539.1	536.5
142.5°	555.6	561.3	563.1	563.8	561.3
145°	579.6	584.2	587.8	588.4	586.0
147.5°	601.2	606.8	609.5	610.7	608.2
150°	623.4	627.2	629.7	631.8	629.7
152.5°	643.1	646.9	650.1	652.6	650.1
155°	662.8	664.6	666.6	669.8	667.8
157.5°	679.8	681.1	682.3	686.8	683.7
160°	695.0	696.3	697.0	700.8	698.1
162.5°	709.0	709.0	709.7	714.0	710.8
165°	721.0	720.3	720.3	724.8	721.7
167.5°	731.9	729.8	729.8	734.4	731.2
170°	740.1	738.2	737.6	742.1	738.2
172.5°	745.7	743.9	743.2	747.7	743.9
175°	750.3	748.5	747.1	751.6	747.7
177.5°	752.7	750.9	749.6	753.4	749.6
180°	751.6	751.6	751.6	751.6	751.6

TEST NUMBER: P914452

CATALOG NUMBER: DFN2DIP-SQ2F0-060D030US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.63	14.70	14.41	15.49	16.46	13.19	14.25	13.96	15.05	16.02
	3H	15.29	16.25	16.08	17.05	18.05	14.80	15.76	15.59	16.56	17.56
	4H	15.87	16.78	16.68	17.59	18.60	15.38	16.28	16.18	17.10	18.11
	6H	16.27	17.10	17.09	17.92	18.95	15.77	16.60	16.59	17.42	18.45
	8H	16.37	17.17	17.20	18.01	19.03	15.87	16.66	16.70	17.51	18.53
	12H	16.42	17.18	17.25	18.01	19.06	15.91	16.67	16.74	17.50	18.55
4H	2H	14.11	15.01	14.92	15.82	16.83	13.75	14.66	14.56	15.47	16.48
	3H	15.97	16.72	16.79	17.57	18.60	15.56	16.31	16.38	17.16	18.19
	4H	16.68	17.36	17.51	18.21	19.26	16.25	16.94	17.09	17.78	18.84
	6H	17.18	17.78	18.03	18.65	19.71	16.75	17.35	17.60	18.22	19.27
	8H	17.33	17.88	18.18	18.75	19.82	16.89	17.45	17.75	18.31	19.38
	12H	17.40	17.90	18.28	18.79	19.87	16.95	17.45	17.83	18.34	19.42
8H	4H	16.88	17.43	17.73	18.30	19.37	16.50	17.05	17.35	17.92	18.99
	6H	17.49	17.95	18.37	18.86	19.93	17.11	17.57	17.99	18.48	19.55
	8H	17.70	18.11	18.59	19.01	20.10	17.31	17.72	18.20	18.62	19.71
	12H	17.83	18.19	18.73	19.08	20.22	17.42	17.78	18.32	18.67	19.81
12H	4H	16.87	17.37	17.74	18.26	19.33	16.50	17.00	17.37	17.89	18.96
	6H	17.52	17.93	18.41	18.83	19.92	17.15	17.56	18.04	18.46	19.54
	8H	17.76	18.12	18.65	19.01	20.15	17.37	17.73	18.27	18.63	19.77