

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914470

Luminaire Tested: DFN2DIP-SQ2F0-060D070US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914470
REPORT IS A COMBINATION OF REPORTS P899826 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D070US927-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8947.7 lumens
Efficiency: N/A
Efficacy: 81.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLLFLL

Luminous Intensity Polar Plot

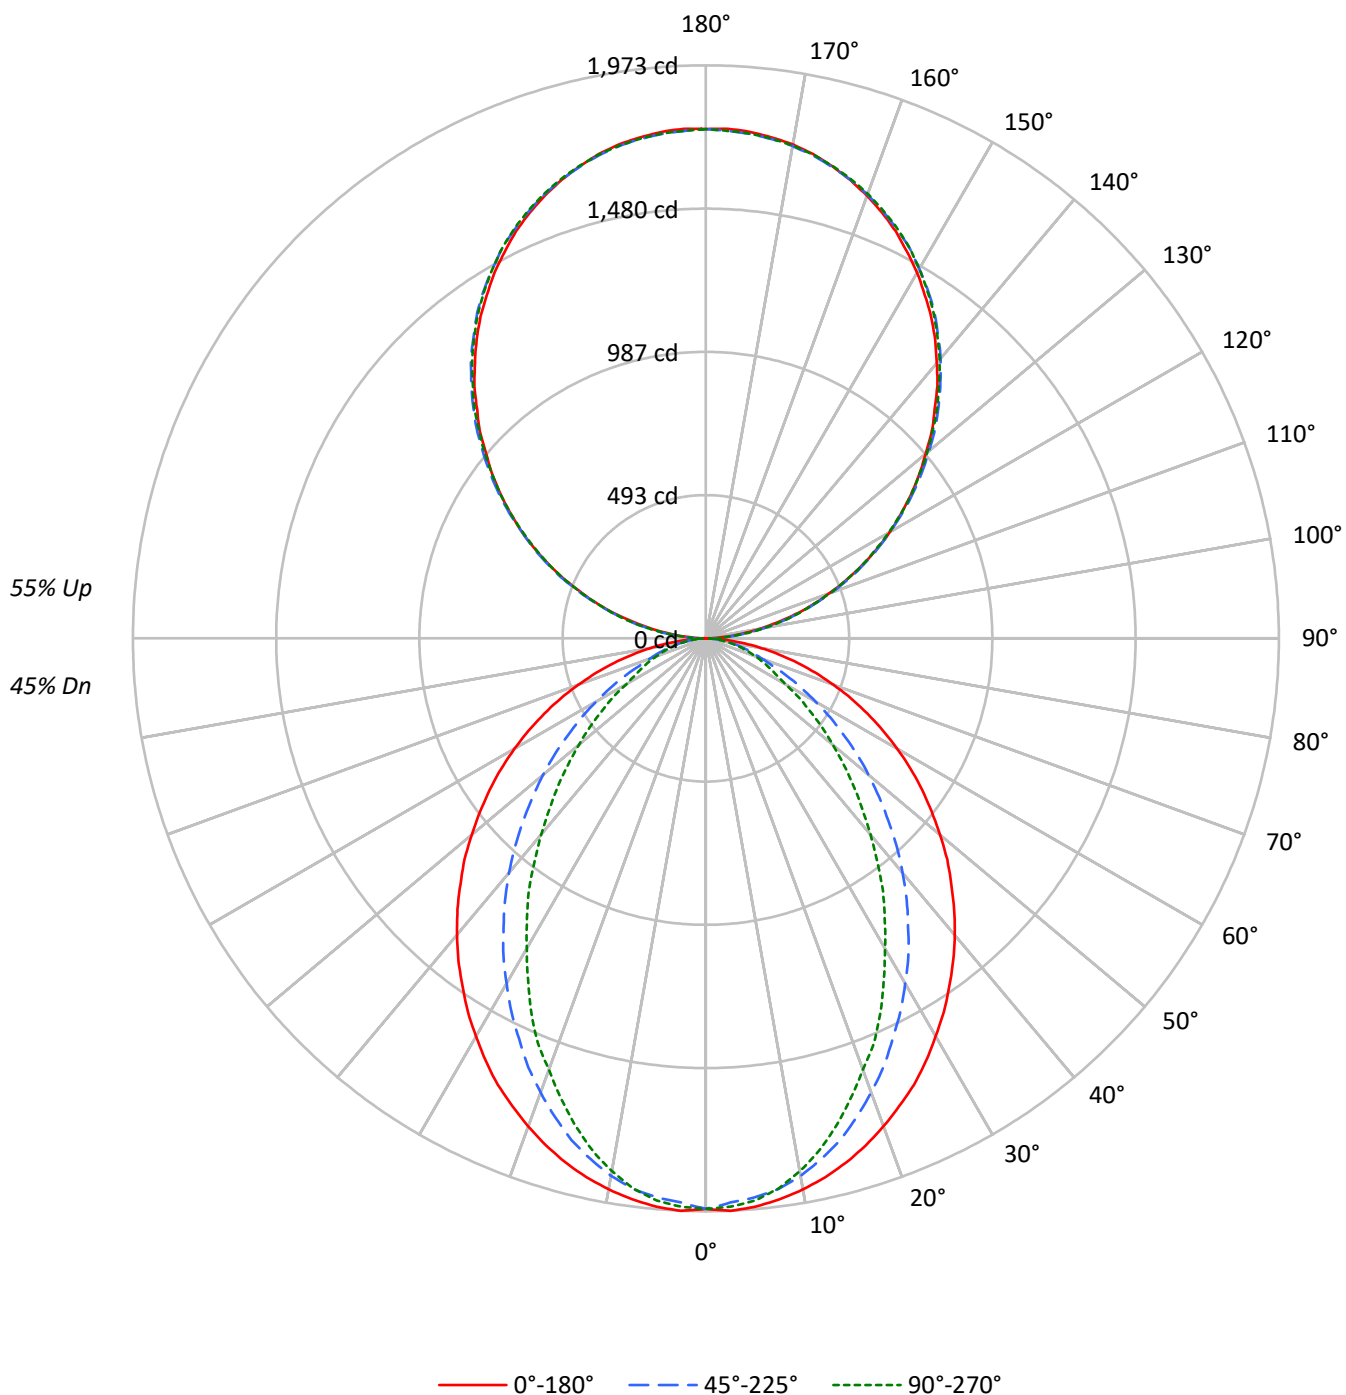

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	85	82	79	71	69	67	58	57	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	52	49	47	41	40	38
3	81	72	65	60	74	67	60	56	56	51	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	47	50	45	41	41	38	35	33	31	29
5	69	57	50	44	63	53	46	41	45	40	36	37	33	30	30	28	25
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	36	32	37	32	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	19	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4320	4320	4320
5°	4319	4242	4272
10°	4269	4149	4127
15°	4202	4003	3907
20°	4117	3805	3638
25°	4030	3585	3379
30°	3915	3361	3053
35°	3803	3120	2766
40°	3687	2872	2439
45°	3555	2598	2142
50°	3416	2323	1853
55°	3271	2029	1575
60°	3103	1724	1291
65°	2910	1415	1155
70°	2674	1127	1037
75°	2378	975	931
80°	1952	792	789
85°	1271	491	561

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3555 cd/sqm

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.1
10°-20°	505.4	5.6
20°-30°	709.6	7.9
30°-40°	773.5	8.6
40°-50°	710.9	7.9
50°-60°	558.3	6.2
60°-70°	363.4	4.1
70°-80°	187.1	2.1
80°-90°	52.7	0.6
90°-100°	108.5	1.2
100°-110°	344.8	3.9
110°-120°	590.1	6.6
120°-130°	776.1	8.7
130°-140°	871.1	9.7
140°-150°	854.2	9.5
150°-160°	716.6	8.0
160°-170°	475.2	5.3
170°-180°	166.1	1.9
0°-30°	1399.1	15.6
0°-40°	2172.6	24.3
0°-60°	3441.9	38.5
0°-90°	4045.1	45.2
90°-120°	1043.4	11.7
90°-150°	3544.8	39.6
90°-180°	4903.0	54.8
0°-180°	8947.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	2	19	52	49	50	9
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1372	1373	1367	845
155°	1546	1551	1556	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.6	19.0	51.8	48.6	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.7	94.7	92.0
97.5°	128.5	142.2	148.1	148.1	148.1
100°	187.7	199.9	204.1	204.1	202.5
102.5°	250.1	259.0	264.9	266.5	264.9
105°	318.3	322.5	325.7	328.4	328.4
107.5°	386.0	392.3	392.3	393.4	386.0
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.4	531.4	529.8	525.5	522.4
115°	592.2	600.6	598.0	596.4	592.2
117.5°	661.4	673.0	665.7	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.1	797.8	794.6
125°	861.3	874.5	870.3	865.5	864.0
127.5°	926.3	942.7	936.9	930.6	926.3
130°	987.1	1006.1	1003.5	1000.4	994.5
132.5°	1055.3	1070.2	1071.2	1063.8	1059.5
135°	1114.0	1130.4	1133.6	1131.9	1127.7
137.5°	1179.6	1192.8	1195.4	1194.4	1188.0
140°	1237.2	1250.5	1257.8	1257.8	1252.0
142.5°	1296.4	1309.6	1313.8	1315.4	1309.6
145°	1352.5	1363.0	1371.5	1373.1	1367.3
147.5°	1402.7	1415.9	1422.3	1424.9	1419.1
150°	1454.5	1463.5	1469.3	1474.1	1469.3
152.5°	1500.5	1509.5	1516.9	1522.7	1516.9
155°	1546.5	1550.7	1555.5	1562.9	1558.1
157.5°	1586.2	1589.4	1592.0	1602.6	1595.1
160°	1621.6	1624.8	1626.3	1635.3	1629.0
162.5°	1654.4	1654.4	1656.0	1666.0	1658.6
165°	1682.4	1680.8	1680.8	1691.4	1683.9
167.5°	1707.8	1703.0	1703.0	1713.6	1706.2
170°	1726.8	1722.6	1721.0	1731.5	1722.6
172.5°	1740.0	1735.7	1734.2	1744.8	1735.7
175°	1750.6	1746.4	1743.2	1753.7	1744.8
177.5°	1756.4	1752.1	1749.0	1758.0	1749.0
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P914470

CATALOG NUMBER: DFN2DIP-SQ2F0-060D070US927-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.65	12.44	12.65	13.45	14.79	7.61	8.40	8.61	9.41	10.75
	3H	13.30	14.01	14.32	15.03	16.39	8.78	9.49	9.79	10.50	11.87
	4H	13.90	14.57	14.92	15.59	16.96	9.21	9.88	10.24	10.91	12.27
	6H	14.30	14.92	15.34	15.94	17.33	9.52	10.13	10.55	11.16	12.54
	8H	14.42	15.01	15.46	16.05	17.42	9.60	10.18	10.64	11.23	12.60
	12H	14.47	15.03	15.52	16.06	17.47	9.63	10.19	10.68	11.22	12.62
4H	2H	11.66	12.33	12.69	13.35	14.72	8.19	8.86	9.22	9.88	11.25
	3H	13.46	14.02	14.50	15.07	16.45	9.52	10.07	10.56	11.12	12.51
	4H	14.14	14.65	15.18	15.69	17.09	10.05	10.56	11.09	11.60	13.00
	6H	14.63	15.07	15.69	16.13	17.53	10.44	10.88	11.50	11.95	13.35
	8H	14.79	15.20	15.85	16.26	17.68	10.56	10.97	11.62	12.03	13.44
	12H	14.88	15.25	15.95	16.32	17.74	10.61	10.98	11.69	12.06	13.48
8H	4H	14.10	14.51	15.15	15.56	16.98	10.31	10.72	11.37	11.78	13.19
	6H	14.64	14.98	15.72	16.08	17.49	10.80	11.14	11.89	12.24	13.65
	8H	14.84	15.14	15.93	16.22	17.65	10.98	11.28	12.07	12.36	13.79
	12H	14.97	15.23	16.06	16.30	17.78	11.08	11.34	12.18	12.42	13.90
12H	4H	14.05	14.42	15.12	15.49	16.91	10.31	10.68	11.39	11.75	13.17
	6H	14.61	14.91	15.70	15.99	17.42	10.85	11.14	11.94	12.23	13.66
	8H	14.82	15.08	15.91	16.16	17.63	11.04	11.30	12.13	12.38	13.85