

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914489

Luminaire Tested: DFN2DIP-SQ2F0-070D060US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914489
REPORT IS A COMBINATION OF REPORTS P901335 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D060US927-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10195.4 lumens
Efficiency: N/A
Efficacy: 89.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 113.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

Luminous Intensity Polar Plot

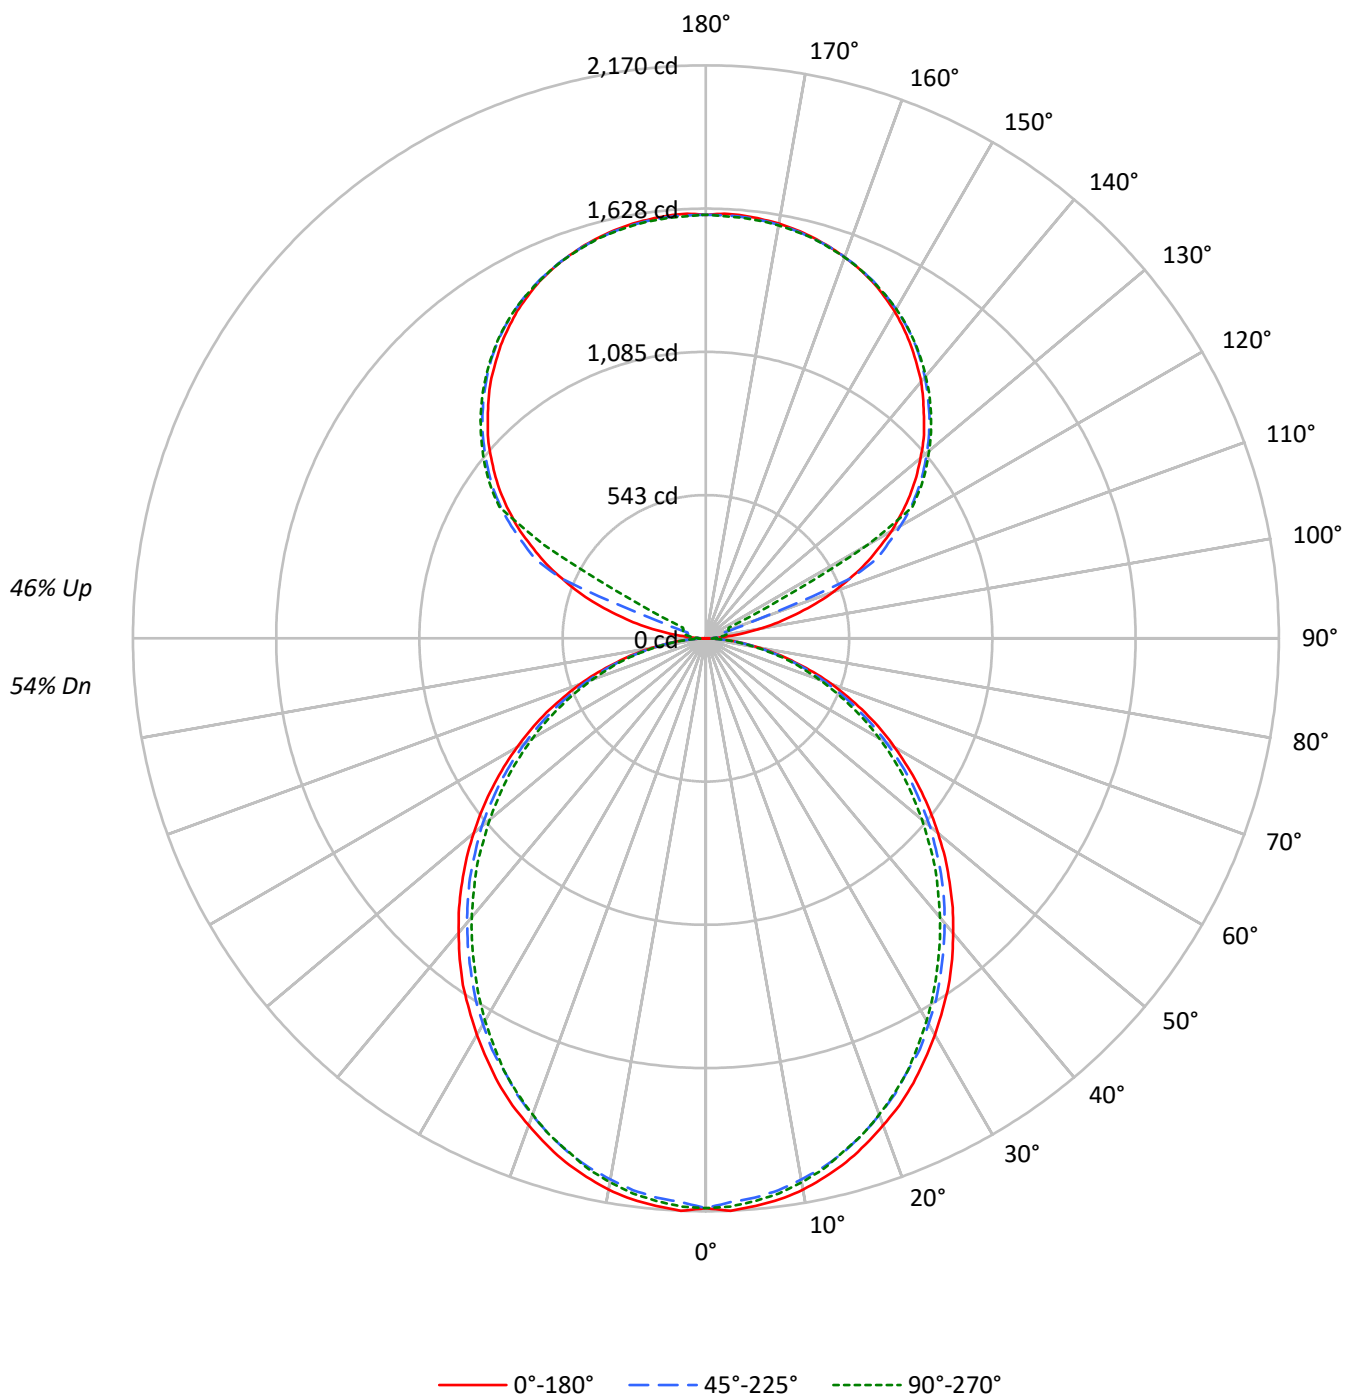

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	60	60	60
1	99	94	90	87	91	88	84	81	75	73	70	63	62	60	53	52	50
2	90	82	76	71	83	77	71	67	66	62	58	56	53	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	46	42	41	38	36
4	75	64	56	50	69	60	53	47	52	46	42	44	40	36	37	34	31
5	69	57	49	43	64	53	46	41	46	40	36	39	35	32	33	30	27
6	63	51	43	37	59	48	41	35	42	36	31	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	28	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	32	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4745	4745	4745
5°	4744	4668	4703
10°	4697	4595	4633
15°	4620	4509	4527
20°	4518	4394	4418
25°	4417	4258	4294
30°	4292	4131	4138
35°	4173	3982	3973
40°	4028	3832	3816
45°	3883	3681	3654
50°	3724	3522	3468
55°	3557	3338	3295
60°	3368	3122	3098
65°	3159	2896	2864
70°	2896	2621	2611
75°	2533	2290	2368
80°	2092	1870	1923
85°	1414	1181	1208

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3883 cd/sqm

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.0
10°-20°	571.4	5.6
20°-30°	839.7	8.2
30°-40°	975.3	9.6
40°-50°	974.1	9.6
50°-60°	849.4	8.3
60°-70°	627.9	6.2
70°-80°	355.2	3.5
80°-90°	96.6	0.9
90°-100°	52.9	0.5
100°-110°	197.2	1.9
110°-120°	523.0	5.1
120°-130°	867.4	8.5
130°-140°	921.3	9.0
140°-150°	856.3	8.4
150°-160°	688.4	6.8
160°-170°	443.6	4.4
170°-180°	152.7	1.5
0°-30°	1614.2	15.8
0°-40°	2589.5	25.4
0°-60°	4412.9	43.3
0°-90°	5492.7	53.9
90°-120°	773.0	7.6
90°-150°	3418.0	33.5
90°-180°	4703.0	46.1
0°-180°	10195.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P914489

CATALOG NUMBER: DFN2DIP-SQ2F0-070D060US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.92	13.81	13.84	14.76	15.97	12.47	13.37	13.40	14.31	15.53
	3H	14.56	15.37	15.50	16.32	17.56	14.07	14.88	15.01	15.83	17.07
	4H	15.14	15.90	16.09	16.85	18.10	14.64	15.41	15.59	16.36	17.61
	6H	15.52	16.23	16.49	17.19	18.45	15.02	15.73	15.99	16.69	17.95
	8H	15.62	16.29	16.59	17.27	18.53	15.12	15.79	16.09	16.77	18.03
	12H	15.67	16.30	16.64	17.27	18.56	15.16	15.79	16.13	16.76	18.05
4H	2H	13.37	14.13	14.33	15.09	16.34	13.02	13.78	13.97	14.73	15.98
	3H	15.22	15.85	16.18	16.84	18.10	14.81	15.45	15.78	16.43	17.69
	4H	15.92	16.50	16.89	17.48	18.76	15.49	16.08	16.47	17.05	18.34
	6H	16.42	16.92	17.40	17.92	19.21	15.99	16.49	16.97	17.49	18.77
	8H	16.56	17.03	17.55	18.02	19.32	16.12	16.59	17.11	17.58	18.88
	12H	16.62	17.05	17.63	18.06	19.36	16.18	16.60	17.18	17.61	18.91
8H	4H	16.11	16.57	17.09	17.57	18.87	15.73	16.20	16.72	17.19	18.49
	6H	16.72	17.10	17.73	18.14	19.44	16.33	16.72	17.34	17.76	19.05
	8H	16.92	17.26	17.95	18.29	19.60	16.53	16.87	17.55	17.90	19.21
	12H	17.04	17.34	18.07	18.36	19.72	16.63	16.93	17.66	17.95	19.31
12H	4H	16.09	16.51	17.10	17.53	18.83	15.72	16.14	16.73	17.16	18.46
	6H	16.74	17.08	17.76	18.11	19.42	16.37	16.71	17.39	17.73	19.05
	8H	16.97	17.27	17.99	18.29	19.65	16.59	16.89	17.61	17.91	19.27