

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914511

Luminaire Tested: DFN2DIP-SQ2F0-080D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914511
REPORT IS A COMBINATION OF REPORTS P901326 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D050US927-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9308.1 lumens
Efficiency: N/A
Efficacy: 80.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 116.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLLONL

Luminous Intensity Polar Plot

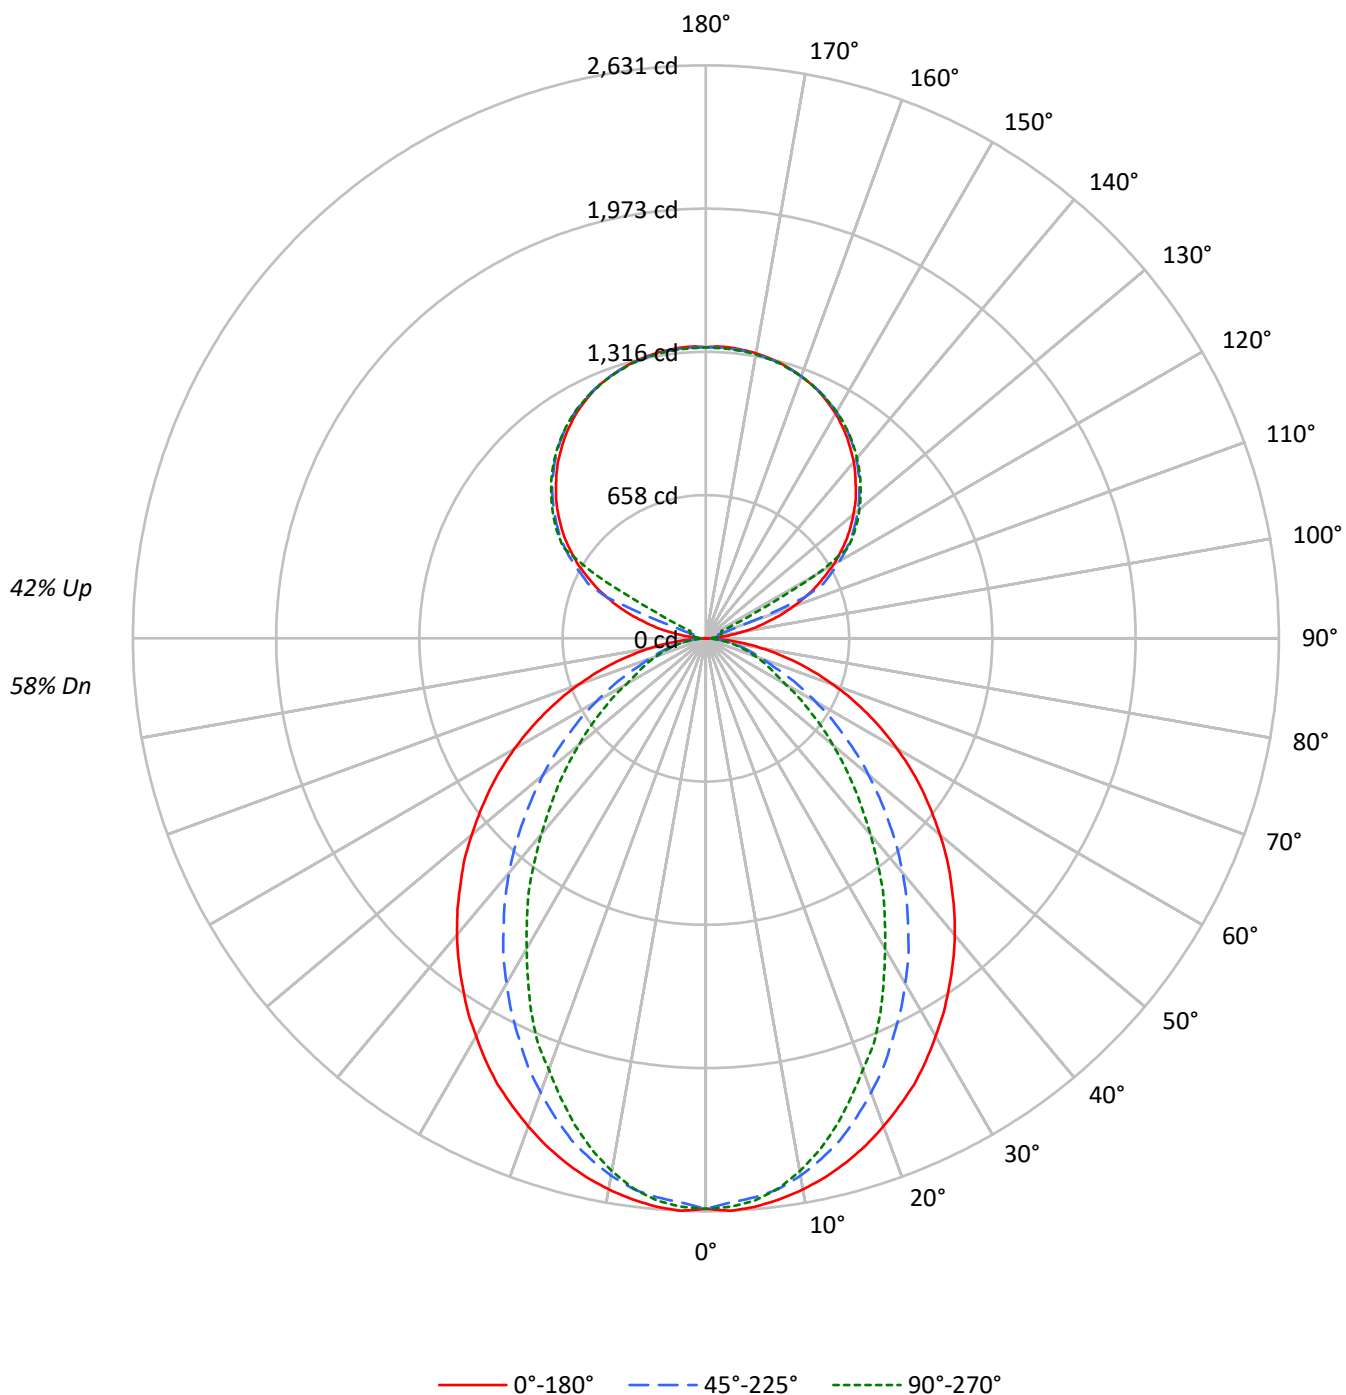

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	63	63	63
1	100	96	92	89	93	90	86	83	78	75	73	67	65	64	57	56	55
2	92	84	79	74	85	79	74	69	69	65	62	59	57	54	51	49	47
3	84	75	68	62	78	70	64	59	61	56	52	53	49	46	45	43	41
4	77	67	59	53	72	62	56	50	55	49	45	48	44	40	41	38	35
5	71	60	52	46	66	56	49	44	49	44	39	43	39	35	37	34	31
6	66	54	46	40	61	51	43	38	45	39	35	39	35	31	34	31	28
7	61	49	41	35	57	46	39	34	41	35	31	36	31	28	31	28	25
8	57	44	37	32	53	42	35	30	37	32	28	33	28	25	29	25	23
9	53	41	33	28	49	39	32	27	34	29	25	30	26	23	27	23	20
10	49	38	30	26	46	36	29	25	32	26	23	28	24	21	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5760	5760	5760
5°	5759	5655	5696
10°	5692	5532	5503
15°	5603	5337	5209
20°	5490	5074	4851
25°	5373	4780	4506
30°	5220	4481	4071
35°	5070	4160	3688
40°	4917	3829	3251
45°	4739	3464	2856
50°	4555	3097	2470
55°	4362	2706	2100
60°	4138	2299	1721
65°	3879	1887	1540
70°	3565	1503	1382
75°	3170	1301	1242
80°	2603	1057	1051
85°	1695	656	749

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4739 cd/sqm

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.6
10°-20°	673.9	7.2
20°-30°	946.1	10.2
30°-40°	1031.3	11.1
40°-50°	947.9	10.2
50°-60°	744.4	8.0
60°-70°	484.5	5.2
70°-80°	249.4	2.7
80°-90°	66.0	0.7
90°-100°	44.1	0.5
100°-110°	164.3	1.8
110°-120°	435.8	4.7
120°-130°	722.8	7.8
130°-140°	767.8	8.2
140°-150°	713.6	7.7
150°-160°	573.7	6.2
160°-170°	369.7	4.0
170°-180°	127.2	1.4
0°-30°	1865.5	20.0
0°-40°	2896.8	31.1
0°-60°	4589.2	49.3
0°-90°	5389.2	57.9
90°-120°	644.2	6.9
90°-150°	2848.4	30.6
90°-180°	3919.0	42.1
0°-180°	9308.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	1	12	19	24	26	9
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914511

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.82	14.72	14.72	15.63	16.79	9.78	10.68	10.68	11.59	12.75
	3H	15.49	16.29	16.39	17.21	18.39	10.96	11.76	11.86	12.68	13.86
	4H	16.08	16.84	17.01	17.77	18.96	11.40	12.16	12.32	13.08	14.27
	6H	16.49	17.19	17.43	18.12	19.33	11.71	12.41	12.64	13.34	14.54
	8H	16.61	17.28	17.55	18.22	19.43	11.79	12.46	12.73	13.40	14.61
	12H	16.67	17.30	17.61	18.24	19.47	11.83	12.46	12.77	13.40	14.63
4H	2H	13.84	14.60	14.77	15.53	16.72	10.38	11.14	11.30	12.06	13.25
	3H	15.66	16.29	16.59	17.24	18.45	11.71	12.34	12.65	13.30	14.50
	4H	16.34	16.91	17.28	17.86	19.09	12.25	12.82	13.19	13.77	15.00
	6H	16.84	17.33	17.80	18.30	19.54	12.65	13.14	13.61	14.12	15.35
	8H	17.00	17.46	17.96	18.43	19.68	12.77	13.23	13.73	14.20	15.44
	12H	17.09	17.51	18.07	18.49	19.74	12.83	13.24	13.81	14.23	15.48
8H	4H	16.31	16.77	17.27	17.73	18.98	12.52	12.98	13.48	13.95	15.19
	6H	16.85	17.23	17.84	18.24	19.48	13.02	13.40	14.00	14.41	15.65
	8H	17.06	17.39	18.05	18.39	19.65	13.19	13.53	14.19	14.53	15.79
	12H	17.18	17.48	18.18	18.47	19.78	13.30	13.60	14.30	14.59	15.90
12H	4H	16.26	16.68	17.24	17.66	18.91	12.53	12.94	13.51	13.92	15.17
	6H	16.83	17.16	17.82	18.16	19.42	13.06	13.40	14.06	14.39	15.66
	8H	17.04	17.33	18.03	18.32	19.63	13.26	13.55	14.26	14.54	15.85

END OF REPORT