

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917143

Luminaire Tested: DFN2DIP-SQ2F0-040D050US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917143
REPORT IS A COMBINATION OF REPORTS P901318 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D050US930-RLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6807.8 lumens
Efficiency: N/A
Efficacy: 95.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLLONL

Luminous Intensity Polar Plot

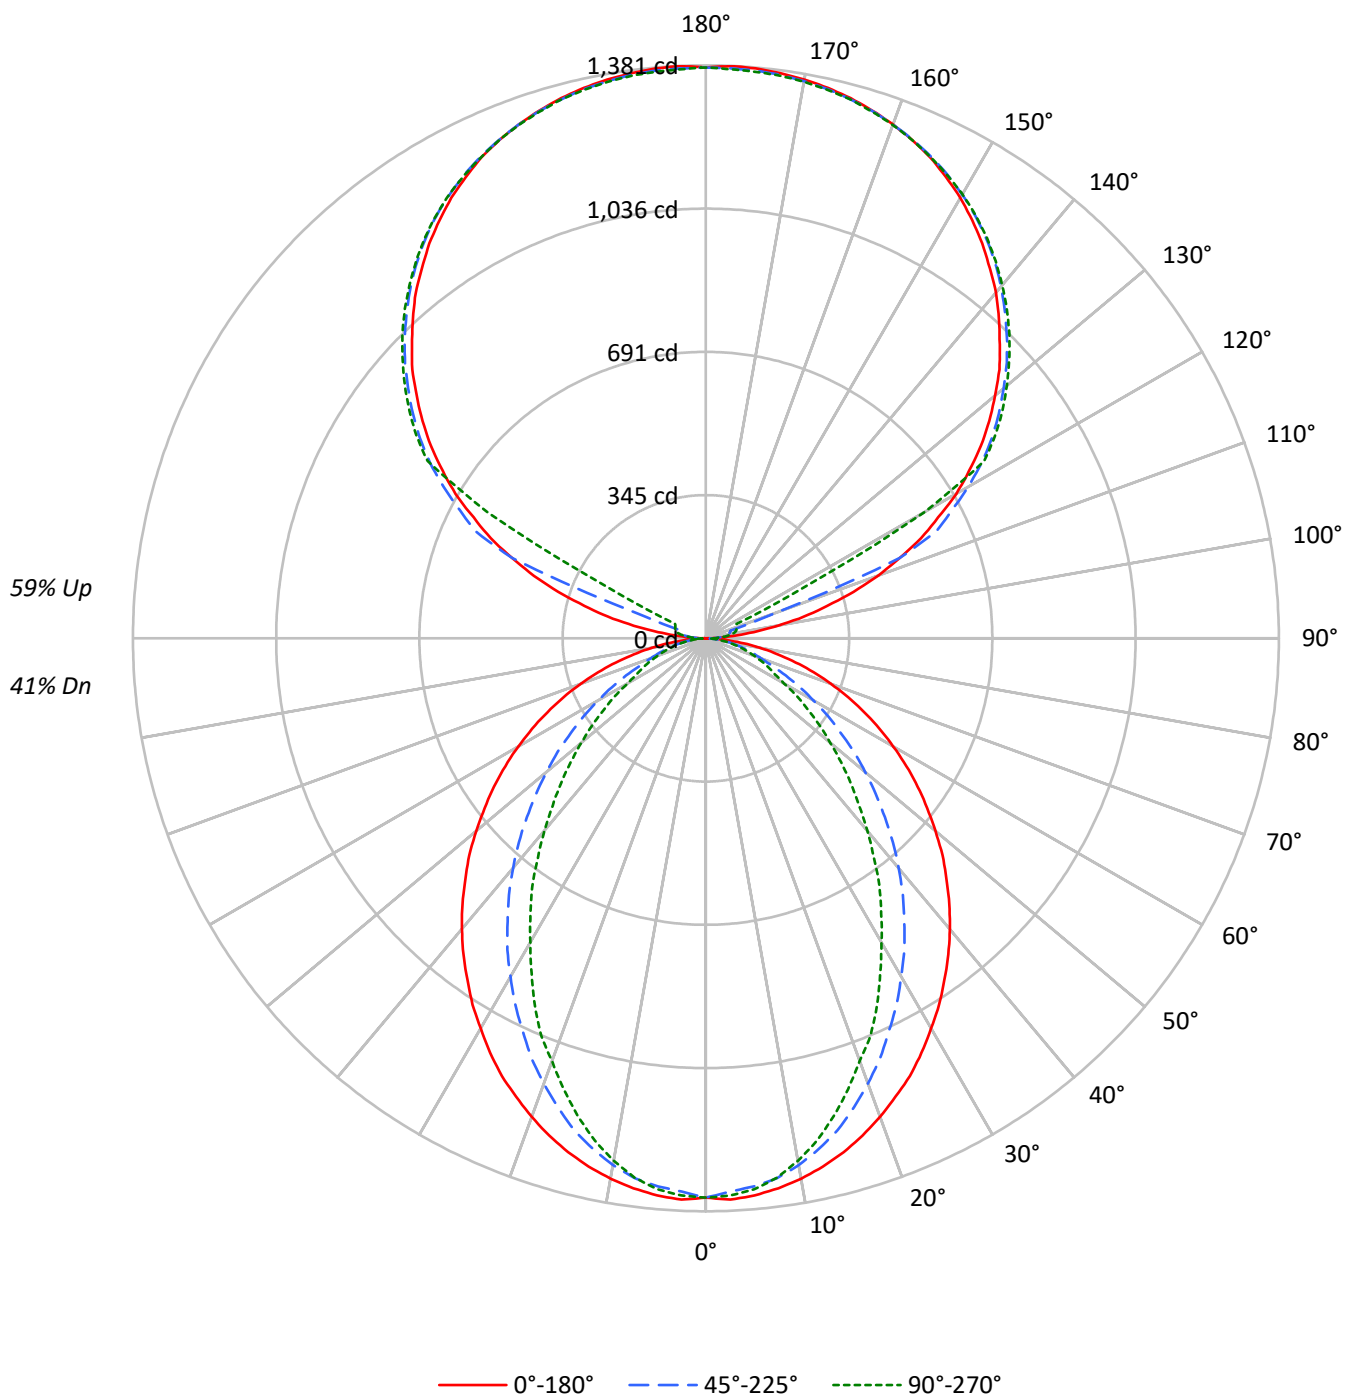

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2964	2964	2964
5°	2963	2910	2931
10°	2929	2847	2832
15°	2883	2746	2681
20°	2825	2611	2496
25°	2765	2460	2318
30°	2687	2306	2095
35°	2609	2141	1898
40°	2530	1971	1673
45°	2439	1783	1470
50°	2344	1593	1271
55°	2245	1393	1081
60°	2129	1183	886
65°	1996	971	793
70°	1835	774	711
75°	1631	669	639
80°	1340	544	541
85°	872	338	386

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2439 cd/sqm

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.3	1.9
10°-20°	346.8	5.1
20°-30°	486.9	7.2
30°-40°	530.7	7.8
40°-50°	487.8	7.2
50°-60°	383.1	5.6
60°-70°	249.3	3.7
70°-80°	128.4	1.9
80°-90°	35.2	0.5
90°-100°	45.4	0.7
100°-110°	169.1	2.5
110°-120°	448.5	6.6
120°-130°	743.9	10.9
130°-140°	790.2	11.6
140°-150°	734.4	10.8
150°-160°	590.4	8.7
160°-170°	380.5	5.6
170°-180°	130.9	1.9
0°-30°	960.0	14.1
0°-40°	1490.7	21.9
0°-60°	2361.5	34.7
0°-90°	2774.4	40.8
90°-120°	663.0	9.7
90°-150°	2931.5	43.1
90°-180°	4033.0	59.2
0°-180°	6807.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1348	1348	1348	1348	1348	
5°	1348	1342	1326	1337	1333	128
15°	1282	1268	1227	1204	1192	361
25°	1164	1125	1044	994	976	535
35°	1003	940	833	756	729	628
45°	820	738	610	523	494	633
55°	623	528	396	323	300	557
65°	421	322	212	171	167	417
75°	224	139	98	89	88	237
85°	52	27	23	23	23	60
90°	1	12	20	25	27	6
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1347.9	1347.9	1347.9	1347.9	1347.9
2.5°	1354.0	1347.9	1334.4	1346.7	1344.2
5°	1347.9	1341.7	1325.8	1336.8	1333.3
7.5°	1336.8	1329.6	1312.5	1317.3	1311.2
10°	1322.3	1313.7	1289.3	1285.6	1278.4
12.5°	1304.0	1293.0	1260.0	1252.7	1239.3
15°	1282.0	1268.5	1227.1	1204.0	1191.8
17.5°	1256.4	1236.8	1185.5	1158.8	1139.2
20°	1227.1	1202.6	1141.7	1111.3	1084.3
22.5°	1195.4	1167.3	1096.5	1055.1	1036.9
25°	1163.7	1124.6	1044.1	994.2	975.7
27.5°	1125.9	1084.3	995.3	938.0	909.9
30°	1085.7	1039.2	941.6	879.5	846.5
32.5°	1046.6	990.4	890.5	817.3	786.7
35°	1002.7	940.4	833.2	756.3	729.4
37.5°	960.0	892.8	779.4	695.2	664.8
40°	914.8	841.7	723.3	636.7	605.0
42.5°	868.5	790.4	667.2	576.9	546.5
45°	819.7	737.9	609.9	523.3	494.0
47.5°	773.4	686.8	555.1	468.4	441.6
50°	722.1	635.5	501.3	417.1	391.6
52.5°	672.1	580.6	450.1	369.6	346.4
55°	623.3	528.2	396.4	323.3	300.1
57.5°	573.3	475.7	348.9	280.5	261.1
60°	522.0	424.4	298.8	236.7	217.2
62.5°	472.1	374.5	256.1	197.6	187.9
65°	420.9	322.0	212.2	170.8	167.1
67.5°	372.1	273.2	170.8	150.0	146.3
70°	320.8	225.7	141.5	129.3	124.3
72.5°	272.1	181.7	118.3	108.6	106.2
75°	224.4	139.0	97.6	89.0	87.9
77.5°	176.9	98.7	76.9	72.0	69.5
80°	132.9	70.8	58.5	53.7	53.7
82.5°	92.7	47.6	40.3	37.7	37.7
85°	52.4	26.8	23.2	23.2	23.2
87.5°	19.6	9.7	9.7	8.6	8.6
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P917143

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.88	10.64	10.92	11.68	13.08	5.84	6.60	6.88	7.64	9.04
	3H	11.53	12.21	12.58	13.26	14.68	7.00	7.68	8.05	8.73	10.15
	4H	12.12	12.77	13.18	13.82	15.24	7.44	8.08	8.50	9.13	10.56
	6H	12.53	13.12	13.59	14.17	15.61	7.74	8.33	8.81	9.39	10.82
	8H	12.64	13.20	13.72	14.28	15.71	7.82	8.38	8.89	9.45	10.89
	12H	12.69	13.23	13.77	14.29	15.75	7.85	8.39	8.93	9.45	10.91
4H	2H	9.88	10.53	10.95	11.58	13.00	6.41	7.06	7.48	8.11	9.54
	3H	11.68	12.22	12.76	13.30	14.74	7.74	8.27	8.81	9.35	10.79
	4H	12.36	12.85	13.44	13.92	15.38	8.27	8.76	9.35	9.83	11.29
	6H	12.85	13.27	13.94	14.36	15.82	8.66	9.08	9.75	10.18	11.63
	8H	13.01	13.40	14.10	14.49	15.96	8.78	9.17	9.87	10.26	11.73
	12H	13.09	13.45	14.20	14.55	16.02	8.83	9.19	9.94	10.28	11.76
8H	4H	12.32	12.71	13.40	13.79	15.26	8.53	8.92	9.62	10.01	11.48
	6H	12.86	13.18	13.97	14.31	15.78	9.02	9.35	10.13	10.47	11.94
	8H	13.06	13.34	14.18	14.45	15.94	9.20	9.48	10.31	10.59	12.08
	12H	13.18	13.43	14.30	14.54	16.06	9.30	9.55	10.42	10.65	12.18
12H	4H	12.26	12.62	13.37	13.72	15.19	8.53	8.88	9.63	9.98	11.46
	6H	12.83	13.11	13.95	14.22	15.71	9.07	9.35	10.18	10.46	11.95
	8H	13.03	13.28	14.15	14.39	15.91	9.26	9.51	10.38	10.61	12.14

END OF REPORT