

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917184

Luminaire Tested: DFN2DIP-SQ2F0-060D040US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917184
REPORT IS A COMBINATION OF REPORTS P899789 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D040US930-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7729.0 lumens
Efficiency: N/A
Efficacy: 91.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 84.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFLL

Luminous Intensity Polar Plot

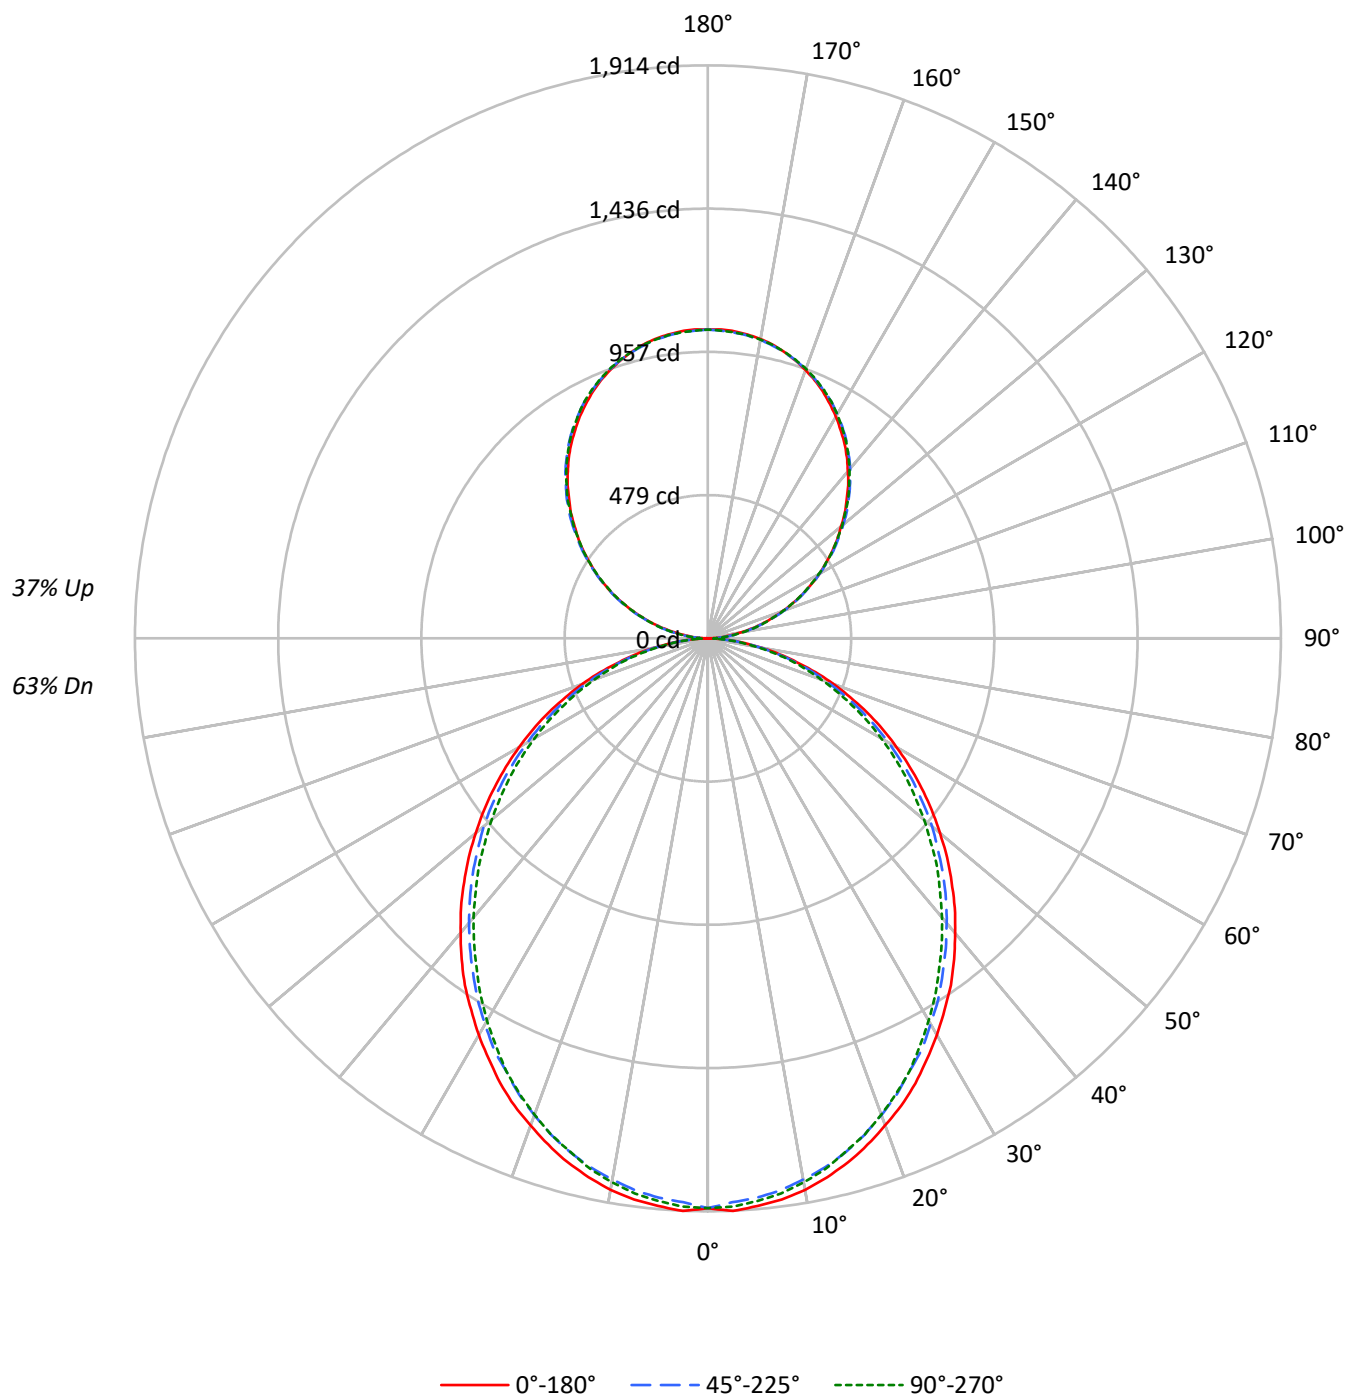

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4185	4185	4185
5°	4185	4118	4149
10°	4144	4053	4087
15°	4075	3978	3993
20°	3986	3876	3898
25°	3897	3756	3788
30°	3786	3644	3650
35°	3682	3513	3505
40°	3553	3381	3366
45°	3426	3247	3224
50°	3285	3107	3060
55°	3138	2945	2907
60°	2971	2754	2732
65°	2787	2555	2526
70°	2554	2312	2304
75°	2235	2021	2089
80°	1846	1650	1697
85°	1246	1041	1066

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3426 cd/sqm

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	2.3
10°-20°	504.1	6.5
20°-30°	740.8	9.6
30°-40°	860.4	11.1
40°-50°	859.3	11.1
50°-60°	749.3	9.7
60°-70°	553.9	7.2
70°-80°	313.4	4.1
80°-90°	85.6	1.1
90°-100°	63.8	0.8
100°-110°	202.8	2.6
110°-120°	347.0	4.5
120°-130°	456.4	5.9
130°-140°	512.3	6.6
140°-150°	502.4	6.5
150°-160°	421.4	5.5
160°-170°	279.5	3.6
170°-180°	97.7	1.3
0°-30°	1424.0	18.4
0°-40°	2284.3	29.6
0°-60°	3892.9	50.4
0°-90°	4845.8	62.7
90°-120°	613.6	7.9
90°-150°	2084.7	27.0
90°-180°	2883.0	37.3
0°-180°	7729.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	1	11	30	29	30	7
95°	45	54	56	56	54	51
105°	187	190	192	193	193	198
115°	348	353	352	351	348	344
125°	506	514	512	509	508	453
135°	655	665	667	666	663	506
145°	795	802	807	808	804	497
155°	910	912	915	919	916	419
165°	989	988	988	995	990	279
175°	1030	1027	1025	1031	1026	98
180°	1031	1031	1031	1031	1031	

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	0.9	11.2	30.5	28.6	29.5
92.5°	19.2	26.1	27.1	28.0	28.0
95°	45.4	54.1	55.7	55.7	54.1
97.5°	75.6	83.6	87.1	87.1	87.1
100°	110.4	117.6	120.0	120.0	119.1
102.5°	147.1	152.4	155.8	156.7	155.8
105°	187.2	189.6	191.5	193.1	193.1
107.5°	227.0	230.7	230.7	231.3	227.0
110°	265.5	270.5	270.5	270.5	268.1

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	307.2	312.5	311.5	309.1	307.2
115°	348.2	353.3	351.6	350.7	348.2
117.5°	389.0	395.8	391.5	389.0	386.5
120°	430.1	436.8	430.1	430.1	427.2
122.5°	467.3	476.1	471.7	469.2	467.3
125°	506.5	514.3	511.8	509.0	508.1
127.5°	544.8	554.4	551.0	547.2	544.8
130°	580.5	591.7	590.2	588.3	584.9
132.5°	620.6	629.3	630.0	625.6	623.1
135°	655.2	664.8	666.7	665.7	663.2
137.5°	693.7	701.5	703.0	702.4	698.7
140°	727.6	735.4	739.7	739.7	736.3
142.5°	762.5	770.2	772.7	773.6	770.2
145°	795.4	801.6	806.6	807.6	804.1
147.5°	824.9	832.7	836.4	838.0	834.5
150°	855.4	860.7	864.1	866.9	864.1
152.5°	882.5	887.7	892.1	895.5	892.1
155°	909.5	912.0	914.8	919.2	916.3
157.5°	932.9	934.7	936.2	942.5	938.1
160°	953.7	955.5	956.4	961.7	958.0
162.5°	972.9	972.9	973.9	979.7	975.4
165°	989.4	988.5	988.5	994.7	990.3
167.5°	1004.4	1001.5	1001.5	1007.8	1003.4
170°	1015.5	1013.0	1012.1	1018.3	1013.0
172.5°	1023.3	1020.8	1019.9	1026.1	1020.8
175°	1029.6	1027.0	1025.2	1031.4	1026.1
177.5°	1033.0	1030.5	1028.6	1033.9	1028.6
180°	1031.4	1031.4	1031.4	1031.4	1031.4

TEST NUMBER: P917184

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.23	14.21	14.07	15.08	16.15	12.78	13.77	13.62	14.63	15.71
	3H	14.88	15.76	15.73	16.64	17.74	14.39	15.27	15.24	16.14	17.25
	4H	15.46	16.30	16.33	17.17	18.29	14.96	15.80	15.83	16.68	17.79
	6H	15.85	16.62	16.73	17.51	18.63	15.35	16.12	16.23	17.01	18.14
	8H	15.95	16.69	16.84	17.59	18.72	15.45	16.18	16.34	17.09	18.22
	12H	15.99	16.70	16.89	17.59	18.75	15.49	16.19	16.38	17.08	18.24
4H	2H	13.69	14.53	14.56	15.41	16.52	13.34	14.17	14.21	15.05	16.17
	3H	15.55	16.25	16.43	17.16	18.29	15.14	15.84	16.02	16.75	17.88
	4H	16.25	16.89	17.15	17.79	18.95	15.82	16.46	16.72	17.37	18.53
	6H	16.75	17.30	17.66	18.24	19.39	16.32	16.87	17.23	17.80	18.96
	8H	16.90	17.41	17.81	18.34	19.51	16.46	16.97	17.37	17.90	19.07
	12H	16.97	17.43	17.90	18.37	19.55	16.52	16.98	17.45	17.93	19.10
8H	4H	16.44	16.96	17.36	17.88	19.06	16.07	16.58	16.98	17.51	18.68
	6H	17.06	17.48	18.00	18.45	19.62	16.67	17.10	17.61	18.07	19.24
	8H	17.27	17.64	18.22	18.60	19.79	16.87	17.25	17.82	18.21	19.40
	12H	17.39	17.72	18.34	18.67	19.91	16.98	17.31	17.93	18.26	19.50
12H	4H	16.43	16.90	17.37	17.84	19.02	16.06	16.53	17.00	17.47	18.65
	6H	17.08	17.46	18.03	18.42	19.61	16.71	17.09	17.66	18.05	19.23
	8H	17.32	17.65	18.27	18.60	19.84	16.93	17.27	17.89	18.22	19.46