

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917191

Luminaire Tested: DFN2DIP-SQ2F0-060D050US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917191
REPORT IS A COMBINATION OF REPORTS P901322 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D050US930-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8193.7 lumens
Efficiency: N/A
Efficacy: 88.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 92.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLLONL

Luminous Intensity Polar Plot

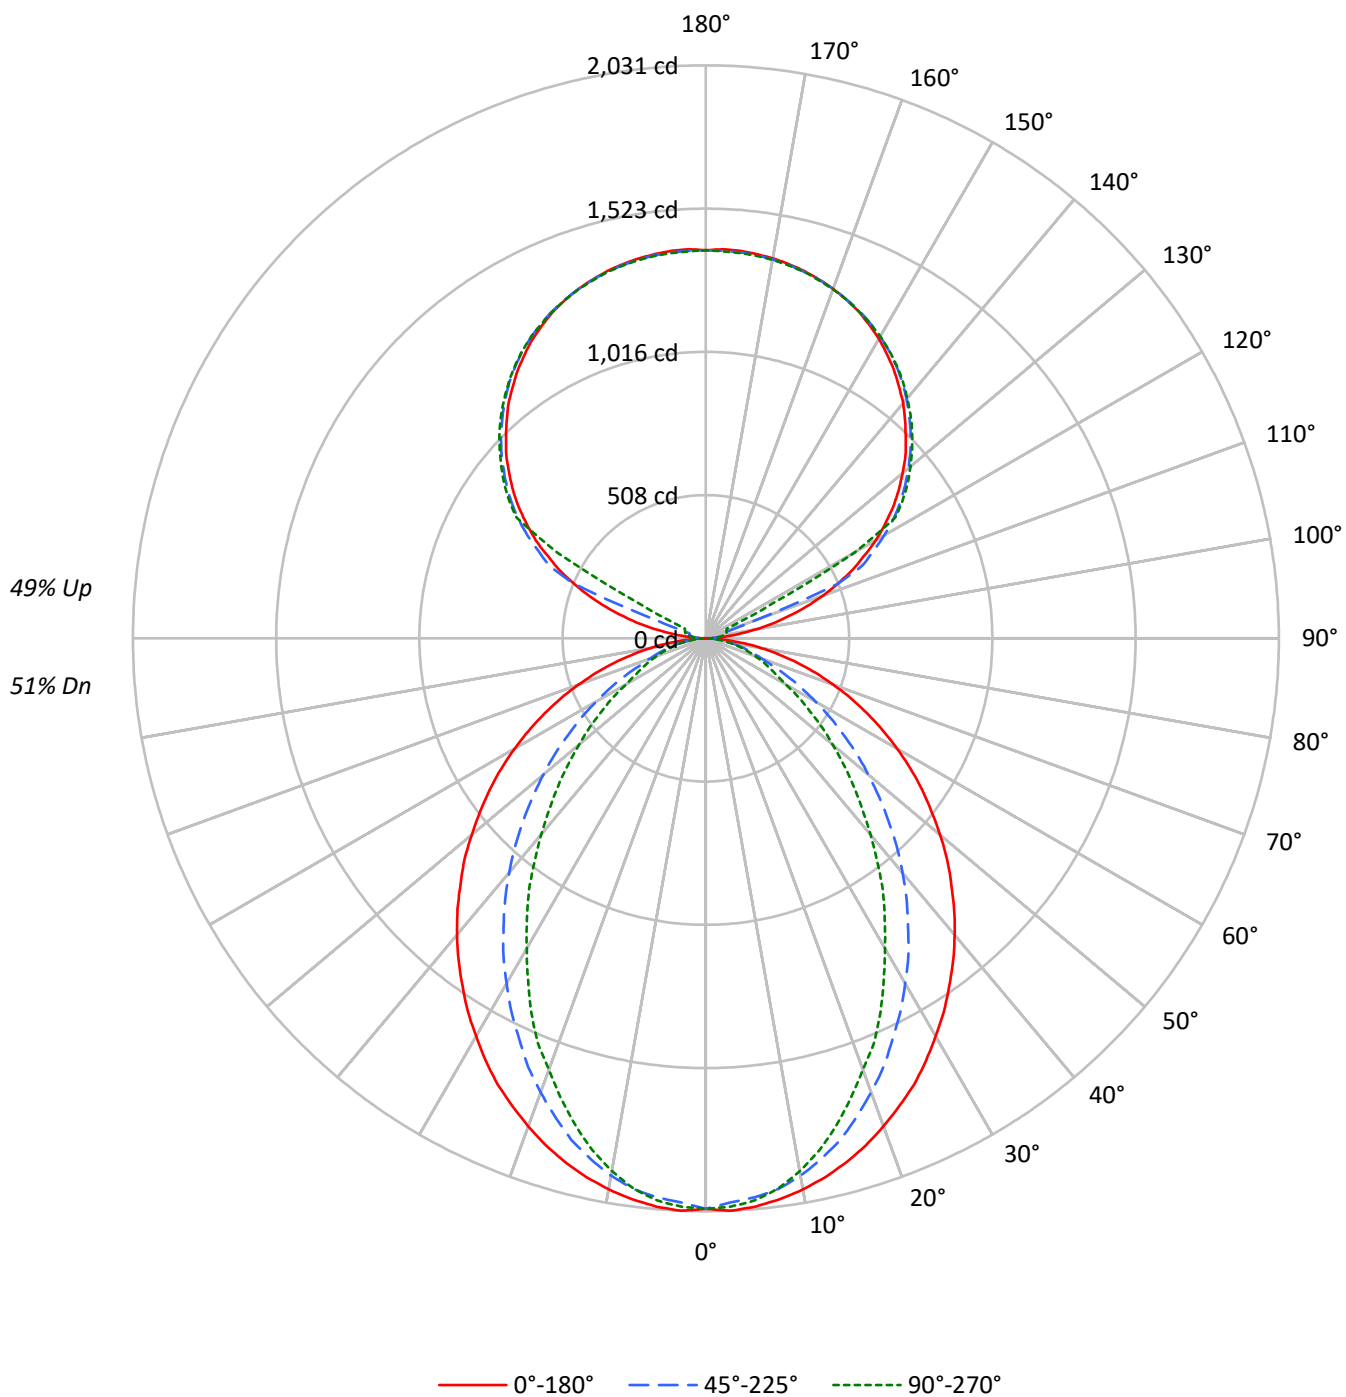

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4446	4446	4446
5°	4445	4365	4397
10°	4393	4270	4248
15°	4325	4119	4021
20°	4237	3916	3744
25°	4148	3690	3478
30°	4030	3459	3142
35°	3914	3211	2847
40°	3795	2956	2510
45°	3658	2674	2204
50°	3516	2390	1907
55°	3367	2089	1621
60°	3194	1775	1328
65°	2994	1457	1189
70°	2752	1160	1067
75°	2447	1004	958
80°	2009	815	812
85°	1308	506	577

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3658 cd/sqm

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	2.3
10°-20°	520.2	6.3
20°-30°	730.3	8.9
30°-40°	796.1	9.7
40°-50°	731.7	8.9
50°-60°	574.6	7.0
60°-70°	374.0	4.6
70°-80°	192.5	2.3
80°-90°	51.6	0.6
90°-100°	45.4	0.6
100°-110°	169.1	2.1
110°-120°	448.5	5.5
120°-130°	743.9	9.1
130°-140°	790.2	9.6
140°-150°	734.4	9.0
150°-160°	590.4	7.2
160°-170°	380.5	4.6
170°-180°	130.9	1.6
0°-30°	1439.9	17.6
0°-40°	2236.0	27.3
0°-60°	3542.3	43.2
0°-90°	4160.4	50.8
90°-120°	663.0	8.1
90°-150°	2931.5	35.8
90°-180°	4033.0	49.2
0°-180°	8193.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	1	12	20	25	27	8
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P917191

CATALOG NUMBER: DFN2DIP-SQ2F0-060D050US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.29	13.12	13.24	14.09	15.35	8.25	9.09	9.21	10.05	11.32
	3H	13.95	14.69	14.91	15.67	16.96	9.42	10.17	10.39	11.15	12.43
	4H	14.54	15.25	15.52	16.23	17.52	9.86	10.56	10.84	11.55	12.84
	6H	14.95	15.60	15.94	16.59	17.89	10.16	10.81	11.16	11.80	13.11
	8H	15.07	15.69	16.07	16.69	17.99	10.25	10.86	11.24	11.87	13.17
	12H	15.12	15.71	16.12	16.70	18.03	10.28	10.87	11.28	11.87	13.19
4H	2H	12.30	13.01	13.29	13.99	15.28	8.83	9.54	9.82	10.52	11.82
	3H	14.11	14.70	15.11	15.71	17.01	10.16	10.75	11.16	11.76	13.07
	4H	14.79	15.32	15.79	16.33	17.66	10.70	11.23	11.70	12.24	13.57
	6H	15.28	15.74	16.30	16.77	18.10	11.10	11.56	12.11	12.59	13.91
	8H	15.45	15.88	16.47	16.90	18.24	11.22	11.65	12.23	12.67	14.01
	12H	15.53	15.92	16.57	16.96	18.30	11.27	11.66	12.31	12.69	14.04
8H	4H	14.75	15.18	15.77	16.20	17.54	10.97	11.40	11.98	12.42	13.76
	6H	15.29	15.65	16.34	16.71	18.05	11.46	11.82	12.50	12.88	14.22
	8H	15.50	15.81	16.55	16.86	18.22	11.64	11.95	12.69	13.00	14.36
	12H	15.62	15.90	16.68	16.94	18.34	11.74	12.02	12.79	13.06	14.46
12H	4H	14.70	15.09	15.74	16.13	17.47	10.97	11.36	12.00	12.39	13.74
	6H	15.27	15.58	16.32	16.63	17.99	11.50	11.82	12.55	12.86	14.22
	8H	15.48	15.75	16.53	16.79	18.20	11.70	11.97	12.75	13.02	14.42

END OF REPORT