

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917220

Luminaire Tested: DFN2DIP-SQ2F0-070D070US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917220
REPORT IS A COMBINATION OF REPORTS P899827 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D070US930-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10700.8 lumens
Efficiency: N/A
Efficacy: 87.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFLL

Luminous Intensity Polar Plot

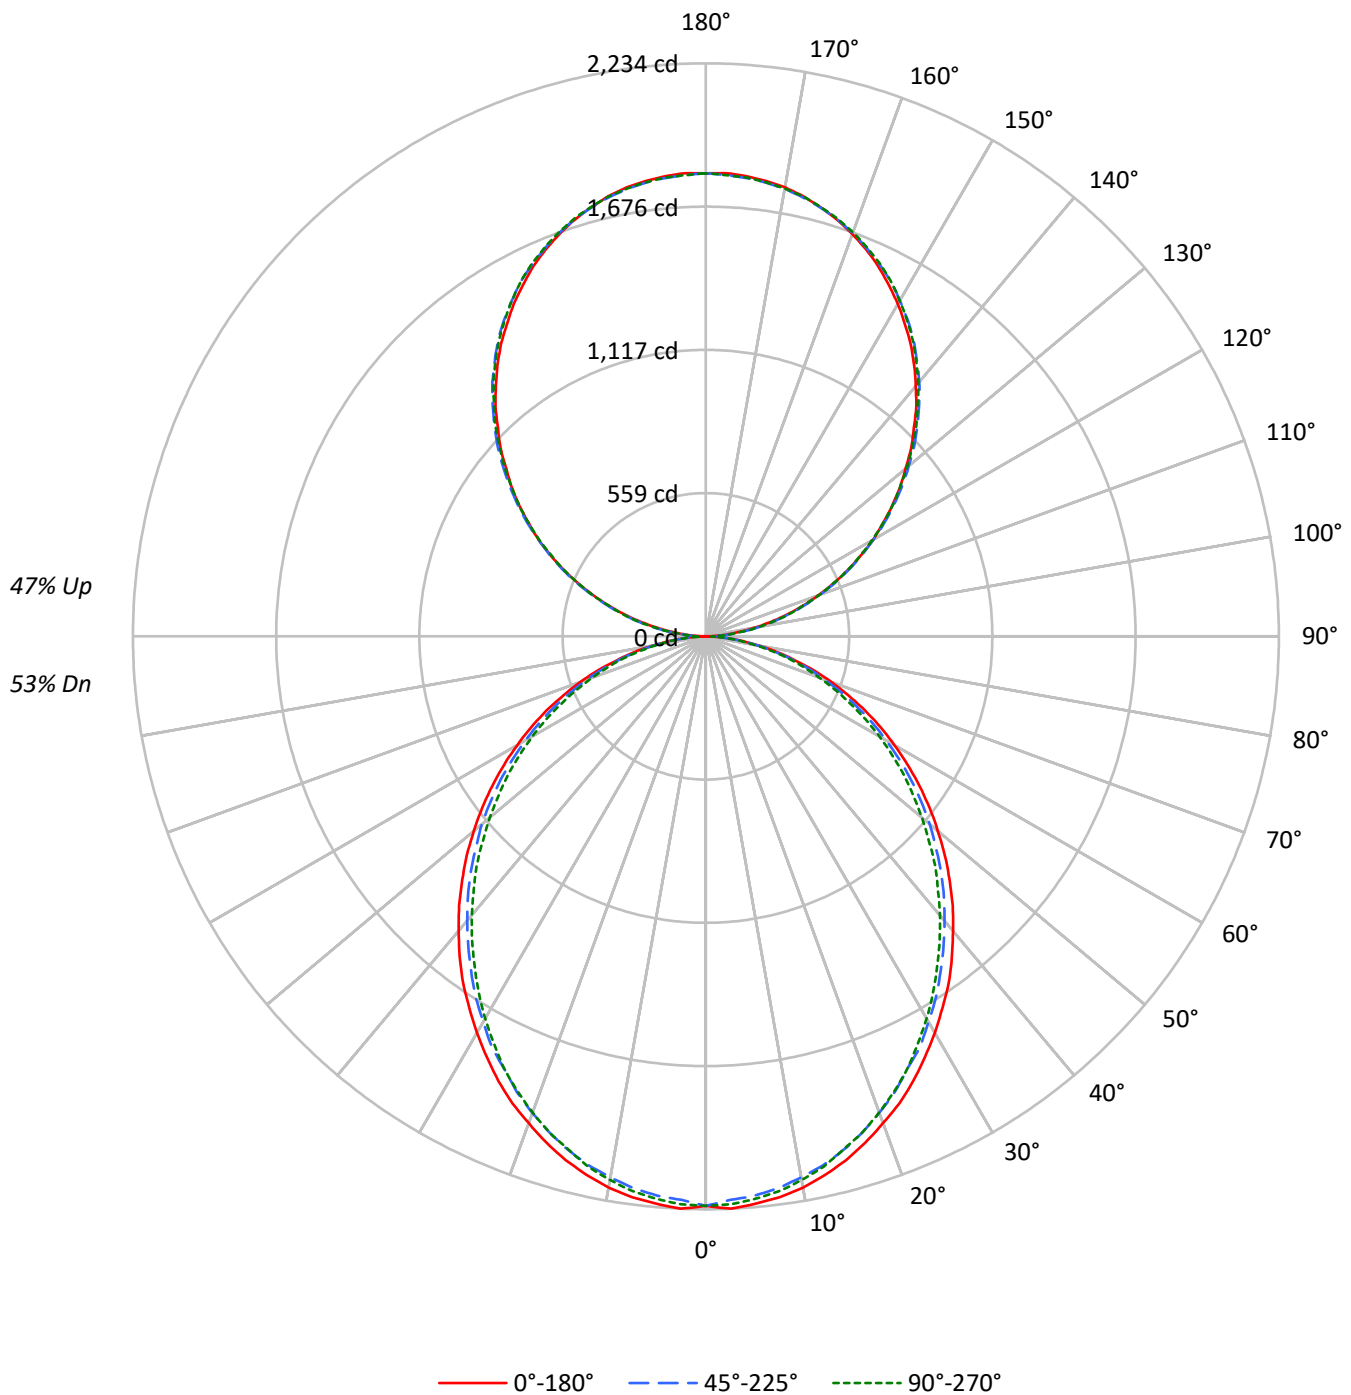

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4883	4883	4883
5°	4882	4804	4840
10°	4834	4729	4768
15°	4755	4641	4659
20°	4650	4522	4547
25°	4546	4382	4420
30°	4418	4251	4259
35°	4295	4098	4089
40°	4146	3944	3927
45°	3996	3788	3761
50°	3833	3624	3570
55°	3661	3436	3392
60°	3466	3213	3188
65°	3252	2980	2947
70°	2980	2697	2687
75°	2607	2357	2438
80°	2153	1925	1980
85°	1456	1216	1244

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3996 cd/sqm

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.0	2.0
10°-20°	588.1	5.5
20°-30°	864.2	8.1
30°-40°	1003.7	9.4
40°-50°	1002.5	9.4
50°-60°	874.2	8.2
60°-70°	646.2	6.0
70°-80°	365.6	3.4
80°-90°	101.6	0.9
90°-100°	111.7	1.0
100°-110°	354.9	3.3
110°-120°	607.3	5.7
120°-130°	798.7	7.5
130°-140°	896.5	8.4
140°-150°	879.1	8.2
150°-160°	737.5	6.9
160°-170°	489.1	4.6
170°-180°	170.9	1.6
0°-30°	1661.3	15.5
0°-40°	2665.1	24.9
0°-60°	4541.7	42.4
0°-90°	5655.2	52.8
90°-120°	1073.9	10.0
90°-150°	3648.2	34.1
90°-180°	5046.0	47.2
0°-180°	10700.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2221	2221	2221	2221	2221	
5°	2221	2212	2189	2206	2202	211
15°	2114	2101	2073	2082	2071	595
25°	1913	1896	1860	1864	1860	880
35°	1651	1629	1595	1582	1572	1031
45°	1343	1328	1296	1273	1264	1037
55°	1016	1004	978	952	942	909
65°	686	673	651	632	621	678
75°	359	355	344	331	335	383
85°	88	85	83	77	75	98
90°	2	20	53	50	52	10
95°	79	95	97	97	95	88
105°	328	332	335	338	338	346
115°	609	618	616	614	609	603
125°	886	900	896	891	889	792
135°	1147	1163	1167	1165	1161	886
145°	1392	1403	1412	1413	1407	870
155°	1592	1596	1601	1608	1604	733
165°	1731	1730	1730	1741	1733	488
175°	1802	1797	1794	1805	1796	171
180°	1805	1805	1805	1805	1805	

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2220.6	2220.6	2220.6	2220.6	2220.6
2.5°	2233.6	2222.9	2199.3	2220.6	2216.6
5°	2220.6	2212.3	2188.7	2205.7	2201.6
7.5°	2205.7	2193.0	2169.4	2186.7	2182.4
10°	2182.4	2167.4	2141.8	2158.8	2152.5
12.5°	2150.2	2137.5	2111.9	2122.5	2118.2
15°	2114.0	2101.3	2073.4	2082.0	2071.3
17.5°	2069.1	2056.4	2028.5	2039.2	2028.5
20°	2019.9	2007.3	1977.3	1983.7	1975.3
22.5°	1971.0	1951.7	1923.9	1923.9	1919.5
25°	1913.3	1896.2	1860.0	1864.1	1860.0
27.5°	1849.1	1834.2	1806.5	1800.2	1789.5
30°	1785.3	1768.0	1736.1	1729.7	1721.1
32.5°	1716.8	1704.1	1669.9	1657.0	1648.4
35°	1650.7	1629.4	1595.1	1582.2	1571.6
37.5°	1575.9	1556.6	1522.4	1507.5	1496.8
40°	1499.1	1481.9	1447.6	1428.6	1420.0
42.5°	1424.3	1407.1	1373.1	1351.6	1338.9
45°	1343.2	1328.3	1296.1	1272.8	1264.1
47.5°	1264.1	1249.2	1215.0	1191.4	1178.8
50°	1180.8	1170.1	1140.2	1110.4	1099.7
52.5°	1099.7	1084.8	1057.1	1033.6	1018.6
55°	1016.5	1003.6	978.0	952.4	941.8
57.5°	933.2	922.5	894.6	869.0	860.5
60°	849.8	841.4	811.5	788.0	781.6
62.5°	768.7	753.7	732.5	711.2	702.5
65°	685.6	672.6	651.3	632.1	621.4
67.5°	600.1	589.3	570.2	555.3	546.7
70°	521.1	512.5	493.2	478.3	469.9
72.5°	439.9	431.4	420.7	405.8	399.4
75°	358.6	354.6	343.6	331.0	335.3
77.5°	286.2	277.5	273.2	266.8	260.6
80°	213.6	211.4	207.1	200.7	196.4
82.5°	145.2	145.2	143.2	134.6	134.6
85°	87.5	85.4	83.4	76.8	74.8
87.5°	38.5	34.2	29.9	23.6	21.3
90°	1.6	19.6	53.3	50.1	51.7
92.5°	33.8	45.7	47.4	49.0	49.0
95°	79.4	94.7	97.4	97.4	94.7
97.5°	132.2	146.3	152.4	152.4	152.4
100°	193.1	205.7	210.0	210.0	208.4
102.5°	257.4	266.6	272.6	274.3	272.6
105°	327.6	331.9	335.2	337.9	337.9
107.5°	397.2	403.7	403.7	404.9	397.2
110°	464.7	473.4	473.4	473.4	469.0

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	537.6	546.9	545.3	540.9	537.6
115°	609.4	618.2	615.5	613.8	609.4
117.5°	680.7	692.7	685.1	680.7	676.4
120°	752.5	764.5	752.5	752.5	747.6
122.5°	817.8	833.1	825.5	821.1	817.8
125°	886.4	900.0	895.7	890.8	889.2
127.5°	953.3	970.2	964.3	957.7	953.3
130°	1015.9	1035.5	1032.8	1029.6	1023.5
132.5°	1086.1	1101.4	1102.4	1094.9	1090.5
135°	1146.6	1163.3	1166.7	1165.0	1160.7
137.5°	1214.0	1227.6	1230.3	1229.2	1222.7
140°	1273.3	1286.9	1294.5	1294.5	1288.6
142.5°	1334.2	1347.9	1352.2	1353.8	1347.9
145°	1392.0	1402.8	1411.5	1413.2	1407.2
147.5°	1443.6	1457.3	1463.8	1466.5	1460.5
150°	1497.0	1506.2	1512.2	1517.1	1512.2
152.5°	1544.3	1553.6	1561.1	1567.2	1561.1
155°	1591.6	1595.9	1600.9	1608.5	1603.6
157.5°	1632.5	1635.7	1638.4	1649.3	1641.7
160°	1668.9	1672.2	1673.8	1683.0	1676.5
162.5°	1702.7	1702.7	1704.3	1714.6	1707.0
165°	1731.4	1729.8	1729.8	1740.7	1733.1
167.5°	1757.6	1752.7	1752.7	1763.6	1756.0
170°	1777.2	1772.9	1771.2	1782.1	1772.9
172.5°	1790.8	1786.4	1784.8	1795.7	1786.4
175°	1801.6	1797.3	1794.1	1804.9	1795.7
177.5°	1807.7	1803.3	1800.0	1809.3	1800.0
180°	1804.9	1804.9	1804.9	1804.9	1804.9

TEST NUMBER: P917220

CATALOG NUMBER: DFN2DIP-SQ2F0-070D070US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.92	13.81	13.86	14.76	15.99	12.48	13.37	13.41	14.32	15.55
	3H	14.57	15.36	15.51	16.32	17.58	14.08	14.87	15.02	15.83	17.09
	4H	15.14	15.90	16.10	16.86	18.12	14.65	15.40	15.61	16.37	17.63
	6H	15.53	16.22	16.50	17.19	18.47	15.03	15.72	16.00	16.69	17.97
	8H	15.63	16.29	16.60	17.27	18.55	15.13	15.79	16.10	16.77	18.05
	12H	15.67	16.30	16.65	17.28	18.58	15.16	15.79	16.14	16.77	18.07
4H	2H	13.38	14.13	14.34	15.10	16.36	13.02	13.78	13.99	14.74	16.00
	3H	15.22	15.85	16.20	16.85	18.12	14.82	15.44	15.79	16.44	17.71
	4H	15.92	16.50	16.91	17.48	18.78	15.50	16.07	16.48	17.06	18.36
	6H	16.42	16.92	17.42	17.93	19.23	15.99	16.48	16.98	17.49	18.79
	8H	16.56	17.02	17.56	18.03	19.34	16.13	16.59	17.12	17.59	18.90
	12H	16.63	17.05	17.64	18.06	19.38	16.18	16.60	17.19	17.62	18.94
8H	4H	16.11	16.57	17.11	17.58	18.89	15.73	16.20	16.73	17.20	18.51
	6H	16.72	17.10	17.74	18.15	19.46	16.33	16.72	17.36	17.76	19.07
	8H	16.93	17.26	17.96	18.30	19.63	16.53	16.87	17.56	17.90	19.23
	12H	17.05	17.34	18.08	18.37	19.74	16.64	16.93	17.67	17.96	19.33
12H	4H	16.09	16.51	17.11	17.53	18.85	15.72	16.14	16.74	17.16	18.48
	6H	16.74	17.08	17.77	18.11	19.44	16.37	16.71	17.40	17.74	19.07
	8H	16.97	17.27	18.00	18.30	19.67	16.59	16.89	17.62	17.91	19.29

END OF REPORT