

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917239

Luminaire Tested: DFN2DIP-SQ2F0-080D050US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917239
REPORT IS A COMBINATION OF REPORTS P901326 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D050US930-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9579.8 lumens
Efficiency: N/A
Efficacy: 82.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 116.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLLONL

Luminous Intensity Polar Plot

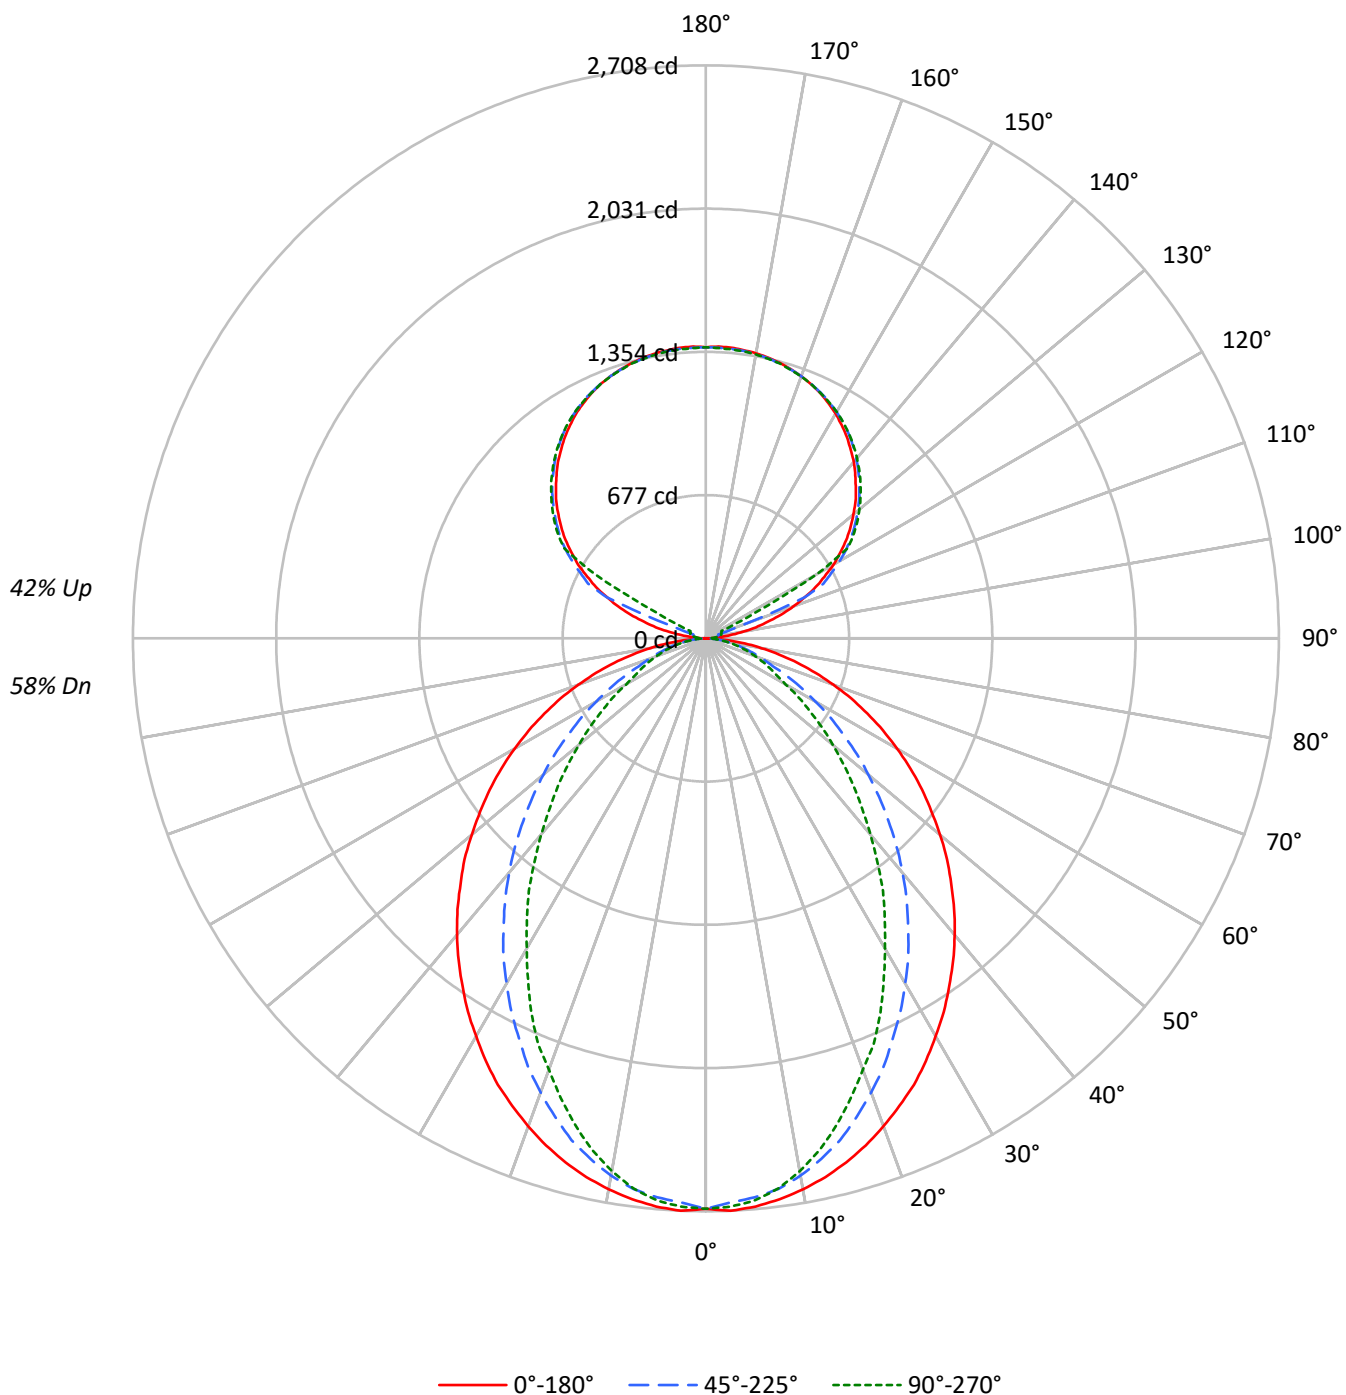

TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	63	63	63
1	100	96	92	89	93	90	86	83	78	75	73	67	65	64	57	56	55
2	92	84	79	74	85	79	74	69	69	65	62	59	57	54	51	49	47
3	84	75	68	62	78	70	64	59	61	56	52	53	49	46	45	43	41
4	77	67	59	53	72	62	56	50	55	49	45	48	44	40	41	38	35
5	71	60	52	46	66	56	49	44	49	44	39	43	39	35	37	34	31
6	66	54	46	40	61	51	43	38	45	39	35	39	35	31	34	31	28
7	61	49	41	35	57	46	39	34	41	35	31	36	31	28	31	28	25
8	57	44	37	32	53	42	35	30	37	32	28	33	28	25	29	25	23
9	53	41	33	28	49	39	32	27	34	29	25	30	26	23	27	23	20
10	49	38	30	26	46	36	29	25	32	26	23	28	24	21	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5928	5928	5928
5°	5927	5821	5862
10°	5858	5694	5663
15°	5767	5493	5361
20°	5650	5222	4993
25°	5530	4920	4637
30°	5373	4612	4189
35°	5218	4281	3796
40°	5060	3941	3346
45°	4878	3565	2940
50°	4688	3187	2542
55°	4489	2785	2161
60°	4258	2366	1771
65°	3992	1942	1585
70°	3669	1547	1422
75°	3263	1339	1278
80°	2679	1087	1083
85°	1743	675	770

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4878 cd/sqm

TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.6	2.6
10°-20°	693.6	7.2
20°-30°	973.7	10.2
30°-40°	1061.4	11.1
40°-50°	975.6	10.2
50°-60°	766.2	8.0
60°-70°	498.7	5.2
70°-80°	256.7	2.7
80°-90°	68.0	0.7
90°-100°	45.4	0.5
100°-110°	169.1	1.8
110°-120°	448.5	4.7
120°-130°	743.9	7.8
130°-140°	790.2	8.2
140°-150°	734.4	7.7
150°-160°	590.4	6.2
160°-170°	380.5	4.0
170°-180°	130.9	1.4
0°-30°	1919.9	20.0
0°-40°	2981.4	31.1
0°-60°	4723.1	49.3
0°-90°	5546.4	57.9
90°-120°	663.0	6.9
90°-150°	2931.5	30.6
90°-180°	4033.0	42.1
0°-180°	9579.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2696	2696	2696	2696	2696	
5°	2696	2684	2652	2674	2666	256
15°	2564	2537	2454	2408	2384	722
25°	2327	2249	2088	1988	1952	1070
35°	2005	1881	1666	1513	1459	1255
45°	1639	1476	1220	1046	988	1266
55°	1246	1056	793	646	600	1114
65°	842	644	424	342	334	834
75°	449	278	195	178	176	475
85°	105	54	46	46	46	120
90°	1	12	20	25	27	9
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	



TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2695.7	2695.7	2695.7	2695.7	2695.7
2.5°	2707.9	2695.7	2668.8	2693.3	2688.4
5°	2695.7	2683.6	2651.7	2673.7	2666.4
7.5°	2673.7	2659.2	2625.0	2634.6	2622.4
10°	2644.4	2627.4	2578.7	2571.2	2556.7
12.5°	2608.0	2586.0	2519.9	2505.4	2478.5
15°	2563.9	2537.0	2454.2	2407.9	2383.5
17.5°	2512.7	2473.6	2371.1	2317.6	2278.4
20°	2454.2	2405.3	2283.4	2222.6	2168.7
22.5°	2390.8	2334.6	2193.1	2110.2	2073.7
25°	2327.4	2249.2	2088.2	1988.3	1951.6
27.5°	2251.8	2168.7	1990.6	1876.0	1819.8
30°	2171.3	2078.4	1883.3	1759.0	1693.0
32.5°	2093.1	1980.8	1781.0	1634.5	1573.4
35°	2005.4	1880.9	1666.3	1512.6	1458.7
37.5°	1919.9	1785.7	1558.9	1390.4	1329.6
40°	1829.7	1683.4	1446.6	1273.4	1210.0
42.5°	1737.0	1580.9	1334.5	1153.9	1093.0
45°	1639.4	1475.9	1219.8	1046.4	988.0
47.5°	1546.8	1373.6	1110.1	936.7	883.1
50°	1444.2	1271.1	1002.7	834.2	783.2
52.5°	1344.1	1161.1	900.2	739.2	692.9
55°	1246.5	1056.3	792.8	646.5	600.2
57.5°	1146.6	951.5	697.8	561.2	522.0
60°	1044.1	849.0	597.6	473.4	434.3
62.5°	944.2	749.0	512.3	395.3	375.9
65°	841.7	643.9	424.4	341.7	334.1
67.5°	744.1	546.4	341.7	299.9	292.8
70°	641.6	451.4	282.9	258.5	248.7
72.5°	544.0	363.4	236.6	217.2	212.2
75°	448.8	278.0	195.2	178.1	175.8
77.5°	353.8	197.5	153.8	143.9	139.0
80°	265.8	141.6	117.0	107.4	107.4
82.5°	185.3	95.2	80.5	75.6	75.6
85°	104.8	53.6	46.3	46.3	46.3
87.5°	39.1	19.4	19.4	17.1	17.1
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6



TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P917239

CATALOG NUMBER: DFN2DIP-SQ2F0-080D050US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.92	14.82	14.82	15.73	16.89	9.88	10.78	10.78	11.69	12.85
	3H	15.59	16.39	16.49	17.31	18.49	11.06	11.86	11.96	12.78	13.96
	4H	16.18	16.94	17.11	17.87	19.06	11.50	12.26	12.42	13.18	14.37
	6H	16.59	17.29	17.53	18.22	19.43	11.81	12.51	12.74	13.44	14.64
	8H	16.71	17.38	17.65	18.32	19.53	11.89	12.56	12.83	13.50	14.71
	12H	16.77	17.40	17.71	18.34	19.57	11.93	12.56	12.87	13.50	14.73
4H	2H	13.94	14.70	14.87	15.63	16.82	10.48	11.24	11.40	12.16	13.35
	3H	15.76	16.39	16.69	17.34	18.55	11.81	12.44	12.75	13.40	14.60
	4H	16.44	17.01	17.38	17.96	19.19	12.35	12.92	13.29	13.87	15.10
	6H	16.94	17.43	17.90	18.40	19.64	12.75	13.24	13.71	14.22	15.45
	8H	17.10	17.56	18.06	18.53	19.77	12.87	13.33	13.83	14.30	15.54
	12H	17.19	17.61	18.17	18.59	19.84	12.93	13.34	13.91	14.33	15.58
8H	4H	16.41	16.87	17.37	17.83	19.08	12.62	13.08	13.58	14.05	15.29
	6H	16.95	17.33	17.94	18.34	19.58	13.12	13.50	14.10	14.51	15.75
	8H	17.16	17.49	18.15	18.49	19.75	13.29	13.63	14.29	14.63	15.89
	12H	17.28	17.58	18.28	18.57	19.88	13.40	13.70	14.40	14.69	16.00
12H	4H	16.36	16.78	17.34	17.76	19.01	12.63	13.04	13.61	14.02	15.27
	6H	16.93	17.26	17.92	18.26	19.52	13.16	13.50	14.16	14.49	15.76
	8H	17.14	17.43	18.13	18.42	19.73	13.36	13.65	14.36	14.64	15.95