

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919871

Luminaire Tested: DFN2DIP-SQ2F0-040D050US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919871
REPORT IS A COMBINATION OF REPORTS P901318 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D050US935-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7189.3 lumens
Efficiency: N/A
Efficacy: 101.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 71.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLLONL

Luminous Intensity Polar Plot

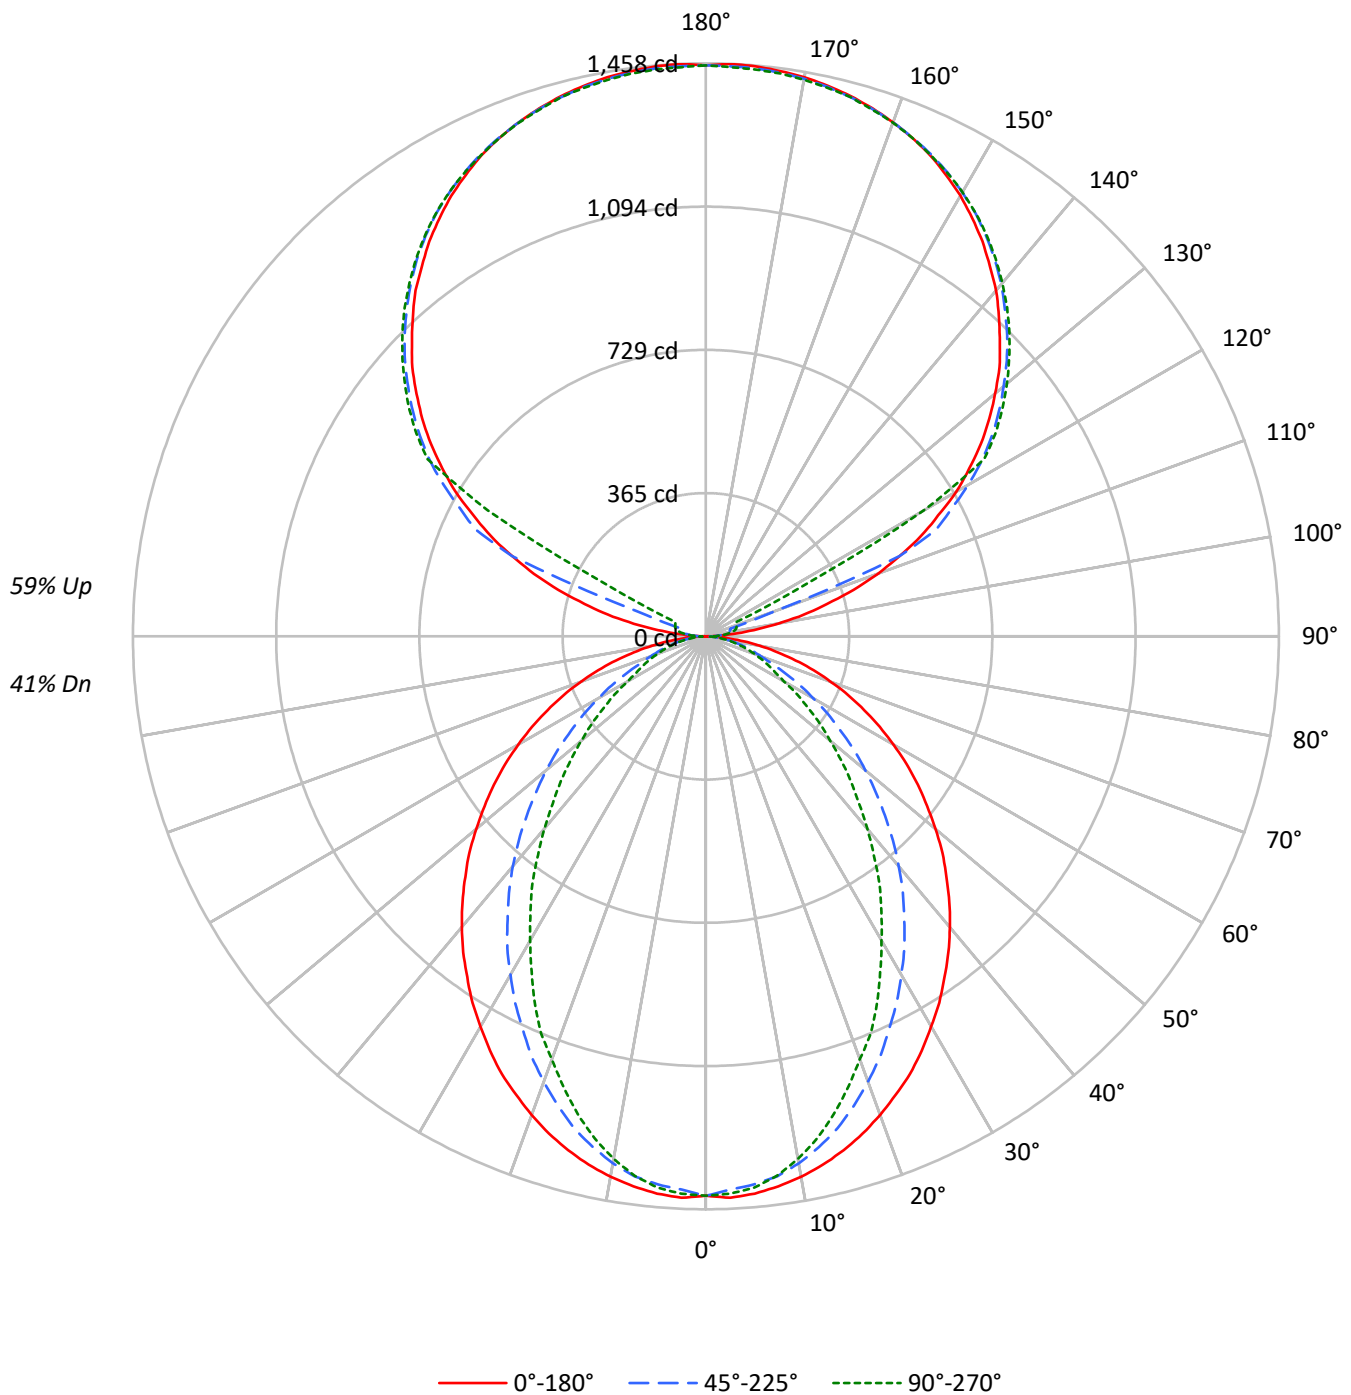

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3130	3130	3130
5°	3129	3073	3096
10°	3093	3006	2990
15°	3045	2900	2831
20°	2983	2757	2636
25°	2920	2598	2448
30°	2837	2435	2212
35°	2755	2261	2004
40°	2672	2081	1767
45°	2575	1883	1552
50°	2475	1683	1342
55°	2370	1471	1141
60°	2248	1250	936
65°	2108	1025	837
70°	1938	817	751
75°	1722	707	675
80°	1414	573	571
85°	922	357	408

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2575 cd/sqm

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	1.9
10°-20°	366.2	5.1
20°-30°	514.2	7.2
30°-40°	560.5	7.8
40°-50°	515.1	7.2
50°-60°	404.5	5.6
60°-70°	263.3	3.7
70°-80°	135.6	1.9
80°-90°	37.2	0.5
90°-100°	47.9	0.7
100°-110°	178.6	2.5
110°-120°	473.7	6.6
120°-130°	785.6	10.9
130°-140°	834.5	11.6
140°-150°	775.6	10.8
150°-160°	623.5	8.7
160°-170°	401.8	5.6
170°-180°	138.3	1.9
0°-30°	1013.8	14.1
0°-40°	1574.2	21.9
0°-60°	2493.9	34.7
0°-90°	2929.9	40.8
90°-120°	700.2	9.7
90°-150°	3095.8	43.1
90°-180°	4259.0	59.2
0°-180°	7189.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	1	13	21	26	28	7
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	622
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.2	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.7	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.6	1074.5	1083.8	1094.5	1092.3
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.4	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.3	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1372.9	1364.6	1374.1	1381.5	1372.9
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.0	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.6	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.7
180°	1452.8	1452.8	1452.8	1452.8	1452.8

TEST NUMBER: P919871

CATALOG NUMBER: DFN2DIP-SQ2F0-040D050US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.07	10.83	11.11	11.87	13.27	6.03	6.79	7.07	7.83	9.23
	3H	11.72	12.40	12.77	13.45	14.87	7.19	7.87	8.24	8.92	10.34
	4H	12.31	12.96	13.37	14.01	15.43	7.63	8.27	8.69	9.32	10.75
	6H	12.71	13.31	13.78	14.36	15.80	7.93	8.52	9.00	9.58	11.01
	8H	12.83	13.39	13.90	14.46	15.90	8.01	8.57	9.08	9.64	11.08
	12H	12.88	13.42	13.96	14.48	15.94	8.04	8.58	9.12	9.64	11.10
4H	2H	10.07	10.72	11.14	11.77	13.19	6.60	7.25	7.67	8.30	9.73
	3H	11.87	12.41	12.95	13.49	14.93	7.93	8.46	9.00	9.54	10.98
	4H	12.55	13.04	13.63	14.11	15.57	8.46	8.95	9.54	10.02	11.48
	6H	13.04	13.46	14.13	14.55	16.01	8.85	9.27	9.94	10.37	11.82
	8H	13.20	13.59	14.29	14.68	16.15	8.97	9.36	10.06	10.45	11.92
	12H	13.28	13.64	14.39	14.74	16.21	9.02	9.38	10.13	10.47	11.95
8H	4H	12.51	12.90	13.59	13.98	15.45	8.72	9.11	9.81	10.20	11.67
	6H	13.05	13.37	14.16	14.50	15.96	9.21	9.53	10.32	10.66	12.13
	8H	13.25	13.53	14.37	14.64	16.13	9.39	9.67	10.50	10.78	12.27
	12H	13.37	13.62	14.49	14.73	16.25	9.49	9.74	10.61	10.84	12.37
12H	4H	12.45	12.81	13.56	13.91	15.38	8.72	9.07	9.82	10.17	11.65
	6H	13.02	13.30	14.14	14.41	15.90	9.25	9.54	10.37	10.65	12.14
	8H	13.22	13.47	14.34	14.58	16.10	9.45	9.70	10.57	10.80	12.33

END OF REPORT