

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919881

Luminaire Tested: DFN2DIP-SQ2F0-040D080US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919881
REPORT IS A COMBINATION OF REPORTS P901353 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D080US935-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10228.6 lumens
Efficiency: N/A
Efficacy: 103.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 98.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

Luminous Intensity Polar Plot

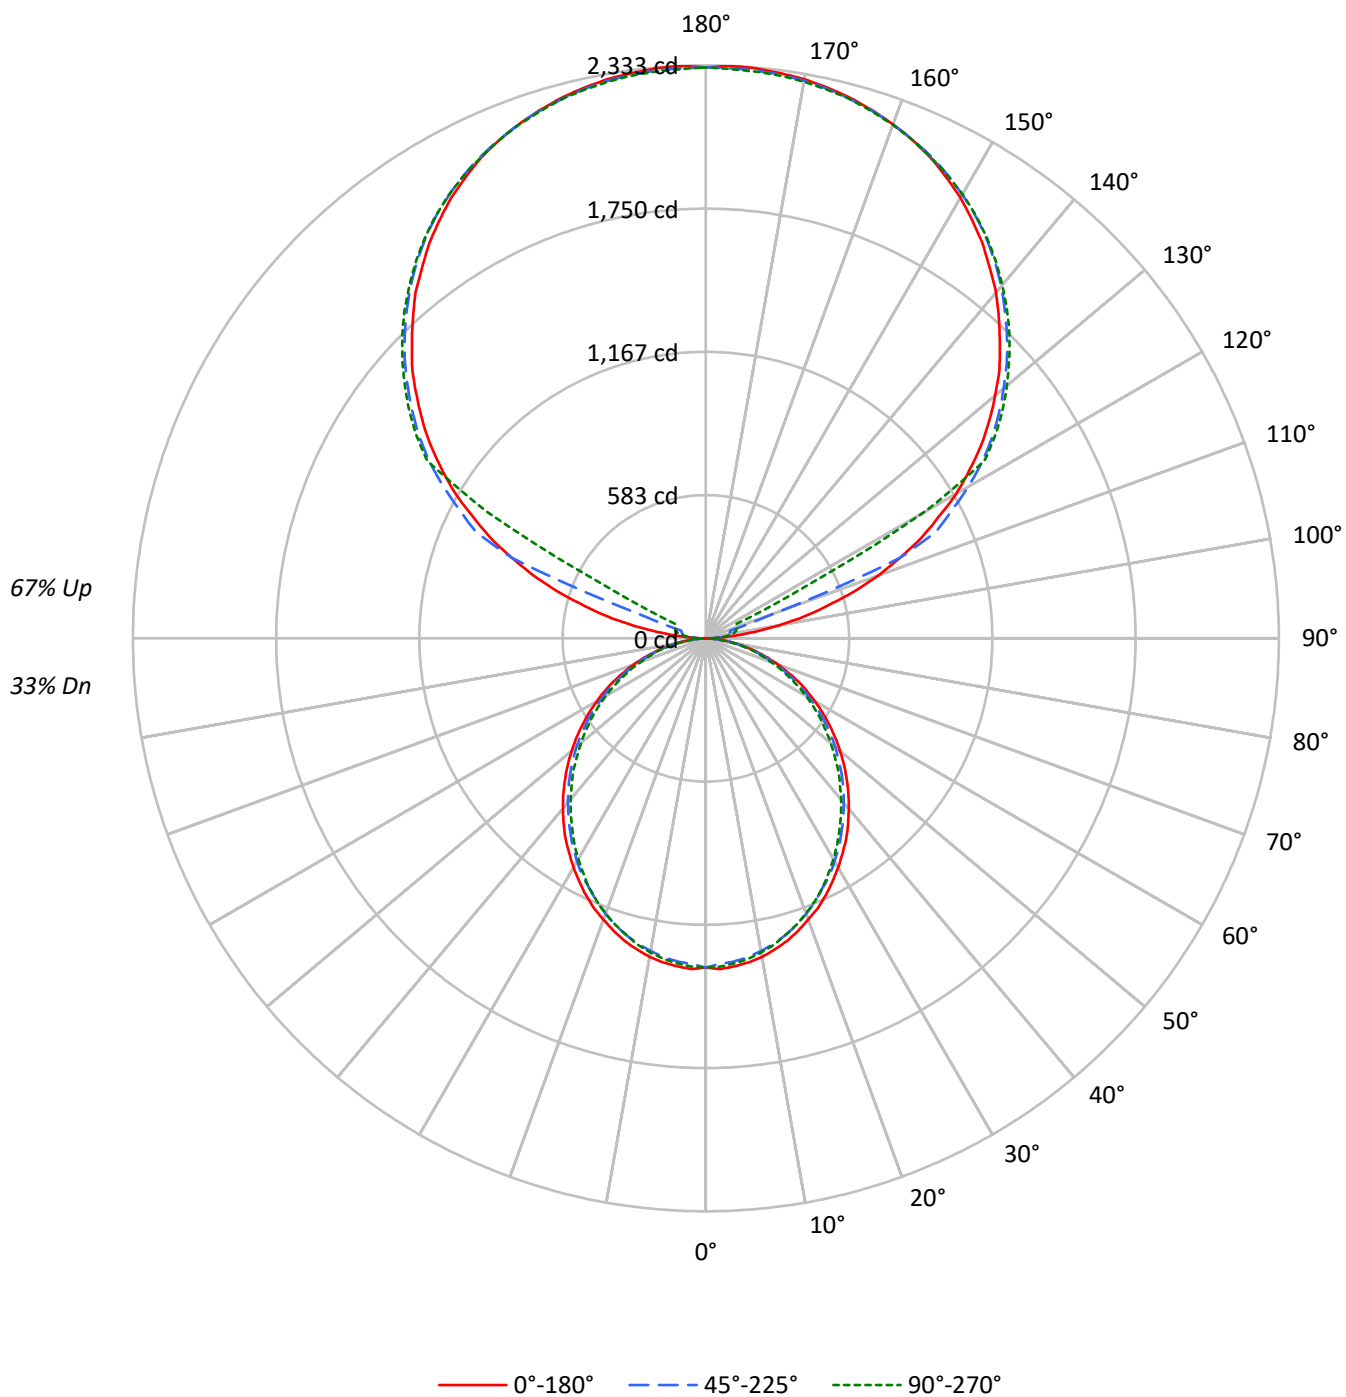

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2947	2947	2947
5°	2946	2899	2921
10°	2917	2854	2877
15°	2869	2800	2812
20°	2806	2729	2744
25°	2743	2644	2667
30°	2666	2565	2570
35°	2592	2473	2468
40°	2502	2380	2370
45°	2411	2286	2270
50°	2313	2187	2154
55°	2209	2073	2047
60°	2091	1939	1924
65°	1962	1798	1779
70°	1798	1627	1621
75°	1574	1423	1471
80°	1299	1161	1195
85°	878	733	750

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2411 cd/sqm

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.1	1.2
10°-20°	354.9	3.5
20°-30°	521.5	5.1
30°-40°	605.7	5.9
40°-50°	605.0	5.9
50°-60°	527.5	5.2
60°-70°	389.9	3.8
70°-80°	220.6	2.2
80°-90°	62.3	0.6
90°-100°	76.7	0.7
100°-110°	285.7	2.8
110°-120°	757.9	7.4
120°-130°	1256.9	12.3
130°-140°	1335.2	13.1
140°-150°	1240.9	12.1
150°-160°	997.6	9.8
160°-170°	642.8	6.3
170°-180°	221.3	2.2
0°-30°	1002.5	9.8
0°-40°	1608.3	15.7
0°-60°	2740.7	26.8
0°-90°	3413.6	33.4
90°-120°	1120.2	11.0
90°-150°	4953.3	48.4
90°-180°	6815.0	66.6
0°-180°	10228.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1340	1340	1340	1340	1340	
5°	1340	1335	1321	1331	1329	127
15°	1276	1268	1251	1256	1250	359
25°	1154	1144	1122	1125	1122	531
35°	996	983	963	955	948	622
45°	810	802	782	768	763	626
55°	614	606	590	575	568	548
65°	414	406	393	381	375	409
75°	216	214	207	200	202	231
85°	53	52	50	46	45	59
90°	2	20	34	42	45	9
95°	109	54	66	74	72	129
105°	511	562	103	121	128	546
115°	967	996	1038	259	138	952
125°	1367	1389	1421	1433	1438	1220
135°	1692	1719	1734	1751	1748	1307
145°	1963	1961	1990	2002	1993	1228
155°	2161	2146	2167	2177	2163	996
165°	2278	2268	2272	2284	2272	643
175°	2330	2318	2321	2333	2316	222
180°	2325	2325	2325	2325	2325	

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1340.1	1340.1	1340.1	1340.1	1340.1
2.5°	1347.9	1341.4	1327.2	1340.1	1337.6
5°	1340.1	1335.0	1320.8	1331.0	1328.6
7.5°	1331.0	1323.4	1309.1	1319.6	1317.0
10°	1317.0	1307.9	1292.5	1302.8	1298.9
12.5°	1297.5	1289.9	1274.4	1280.9	1278.2
15°	1275.7	1268.0	1251.2	1256.4	1250.0
17.5°	1248.6	1241.0	1224.2	1230.5	1224.2
20°	1218.9	1211.3	1193.3	1197.0	1192.1
22.5°	1189.4	1177.8	1161.0	1161.0	1158.4
25°	1154.5	1144.3	1122.4	1124.9	1122.4
27.5°	1115.9	1106.8	1090.2	1086.3	1079.9
30°	1077.3	1066.9	1047.7	1043.8	1038.6
32.5°	1036.0	1028.4	1007.7	1000.0	994.7
35°	996.1	983.3	962.6	954.8	948.4
37.5°	951.0	939.3	918.7	909.7	903.3
40°	904.7	894.2	873.6	862.1	857.0
42.5°	859.5	849.1	828.6	815.6	808.0
45°	810.5	801.6	782.1	768.1	762.8
47.5°	762.8	753.8	733.2	719.0	711.4
50°	712.6	706.1	688.1	670.0	663.6
52.5°	663.6	654.6	637.9	623.7	614.7
55°	613.5	605.6	590.2	574.7	568.3
57.5°	563.1	556.7	539.8	524.4	519.3
60°	512.8	507.7	489.7	475.5	471.7
62.5°	463.9	454.9	442.0	429.1	424.0
65°	413.7	405.9	393.0	381.4	375.1
67.5°	362.1	355.6	344.1	335.1	329.9
70°	314.4	309.3	297.6	288.6	283.5
72.5°	265.5	260.3	253.9	244.9	241.0
75°	216.5	214.0	207.4	199.8	202.3
77.5°	172.6	167.5	164.9	161.0	157.2
80°	128.9	127.5	124.9	121.1	118.6
82.5°	87.6	87.6	86.4	81.2	81.2
85°	52.8	51.6	50.3	46.3	45.1
87.5°	23.2	20.7	18.1	14.2	12.8
90°	1.6	20.1	33.6	42.1	45.4
92.5°	42.1	35.4	40.4	43.7	45.4
95°	109.3	53.7	65.5	74.1	72.3
97.5°	196.7	58.9	85.7	90.9	92.5
100°	297.8	67.3	95.9	109.3	112.6
102.5°	408.7	405.4	99.3	117.6	122.9
105°	511.3	561.9	102.6	121.1	127.9
107.5°	630.8	672.7	106.1	124.4	131.2
110°	745.3	780.4	294.5	126.2	132.9

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	852.9	883.0	854.5	129.4	134.7
115°	967.2	995.7	1037.8	259.1	138.0
117.5°	1066.4	1100.0	1128.8	888.0	447.5
120°	1177.5	1202.6	1233.0	1253.2	1026.1
122.5°	1271.5	1298.6	1332.3	1342.3	1344.1
125°	1367.4	1389.4	1421.3	1433.1	1438.1
127.5°	1454.9	1478.5	1503.9	1520.6	1522.2
130°	1537.4	1564.3	1582.8	1601.4	1599.7
132.5°	1621.5	1643.5	1661.9	1677.1	1675.4
135°	1692.2	1719.2	1734.1	1751.2	1747.7
137.5°	1766.2	1786.3	1803.3	1820.1	1815.1
140°	1838.4	1852.0	1870.4	1885.6	1877.1
142.5°	1899.2	1910.9	1932.7	1946.1	1937.7
145°	1963.1	1961.3	1989.9	2001.6	1993.2
147.5°	2018.4	2013.4	2041.9	2050.4	2043.8
150°	2072.3	2060.5	2087.5	2097.5	2089.1
152.5°	2117.7	2104.3	2129.4	2139.7	2127.9
155°	2161.4	2146.5	2166.6	2176.6	2163.3
157.5°	2196.7	2183.4	2198.6	2210.4	2196.7
160°	2227.1	2217.0	2227.1	2237.1	2225.3
162.5°	2253.9	2243.9	2252.3	2264.1	2248.9
165°	2277.5	2267.5	2272.5	2284.2	2272.5
167.5°	2296.0	2285.9	2291.0	2302.8	2287.7
170°	2311.3	2301.0	2304.5	2316.3	2301.0
172.5°	2321.3	2311.3	2314.6	2326.4	2311.3
175°	2329.6	2317.8	2321.3	2333.0	2316.3
177.5°	2333.0	2321.3	2323.0	2334.8	2319.6
180°	2324.6	2324.6	2324.6	2324.6	2324.6

TEST NUMBER: P919881

CATALOG NUMBER: DFN2DIP-SQ2F0-040D080US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.14	9.87	10.23	10.95	12.45	8.69	9.42	9.78	10.51	12.00
	3H	10.77	11.42	11.87	12.52	14.03	10.28	10.93	11.38	12.03	13.54
	4H	11.34	11.96	12.45	13.06	14.57	10.84	11.46	11.95	12.56	14.07
	6H	11.72	12.29	12.83	13.39	14.91	11.22	11.79	12.33	12.89	14.41
	8H	11.81	12.35	12.93	13.47	14.99	11.31	11.85	12.43	12.97	14.49
	12H	11.85	12.36	12.97	13.47	15.01	11.34	11.85	12.46	12.96	14.50
4H	2H	9.57	10.19	10.69	11.29	12.80	9.22	9.84	10.33	10.93	12.45
	3H	11.40	11.92	12.52	13.04	14.57	11.00	11.51	12.12	12.64	14.16
	4H	12.10	12.57	13.22	13.68	15.23	11.67	12.15	12.80	13.26	14.81
	6H	12.59	12.99	13.72	14.13	15.67	12.15	12.56	13.29	13.70	15.23
	8H	12.72	13.10	13.85	14.23	15.79	12.29	12.67	13.42	13.79	15.35
	12H	12.78	13.13	13.93	14.26	15.82	12.33	12.68	13.48	13.82	15.38
8H	4H	12.27	12.65	13.40	13.78	15.33	11.89	12.27	13.02	13.40	14.96
	6H	12.87	13.19	14.03	14.36	15.91	12.49	12.80	13.64	13.97	15.52
	8H	13.08	13.35	14.24	14.50	16.07	12.69	12.96	13.84	14.11	15.68
	12H	13.19	13.43	14.35	14.58	16.19	12.78	13.02	13.94	14.17	15.77
12H	4H	12.25	12.59	13.40	13.73	15.29	11.88	12.22	13.03	13.36	14.92
	6H	12.90	13.17	14.05	14.32	15.89	12.52	12.80	13.68	13.95	15.52
	8H	13.12	13.36	14.28	14.50	16.11	12.74	12.98	13.90	14.12	15.73