

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919892

Luminaire Tested: DFN2DIP-SQ2F0-050D050US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919892
REPORT IS A COMBINATION OF REPORTS P899799 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US935-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8071.8 lumens
Efficiency: N/A
Efficacy: 98.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

Luminous Intensity Polar Plot

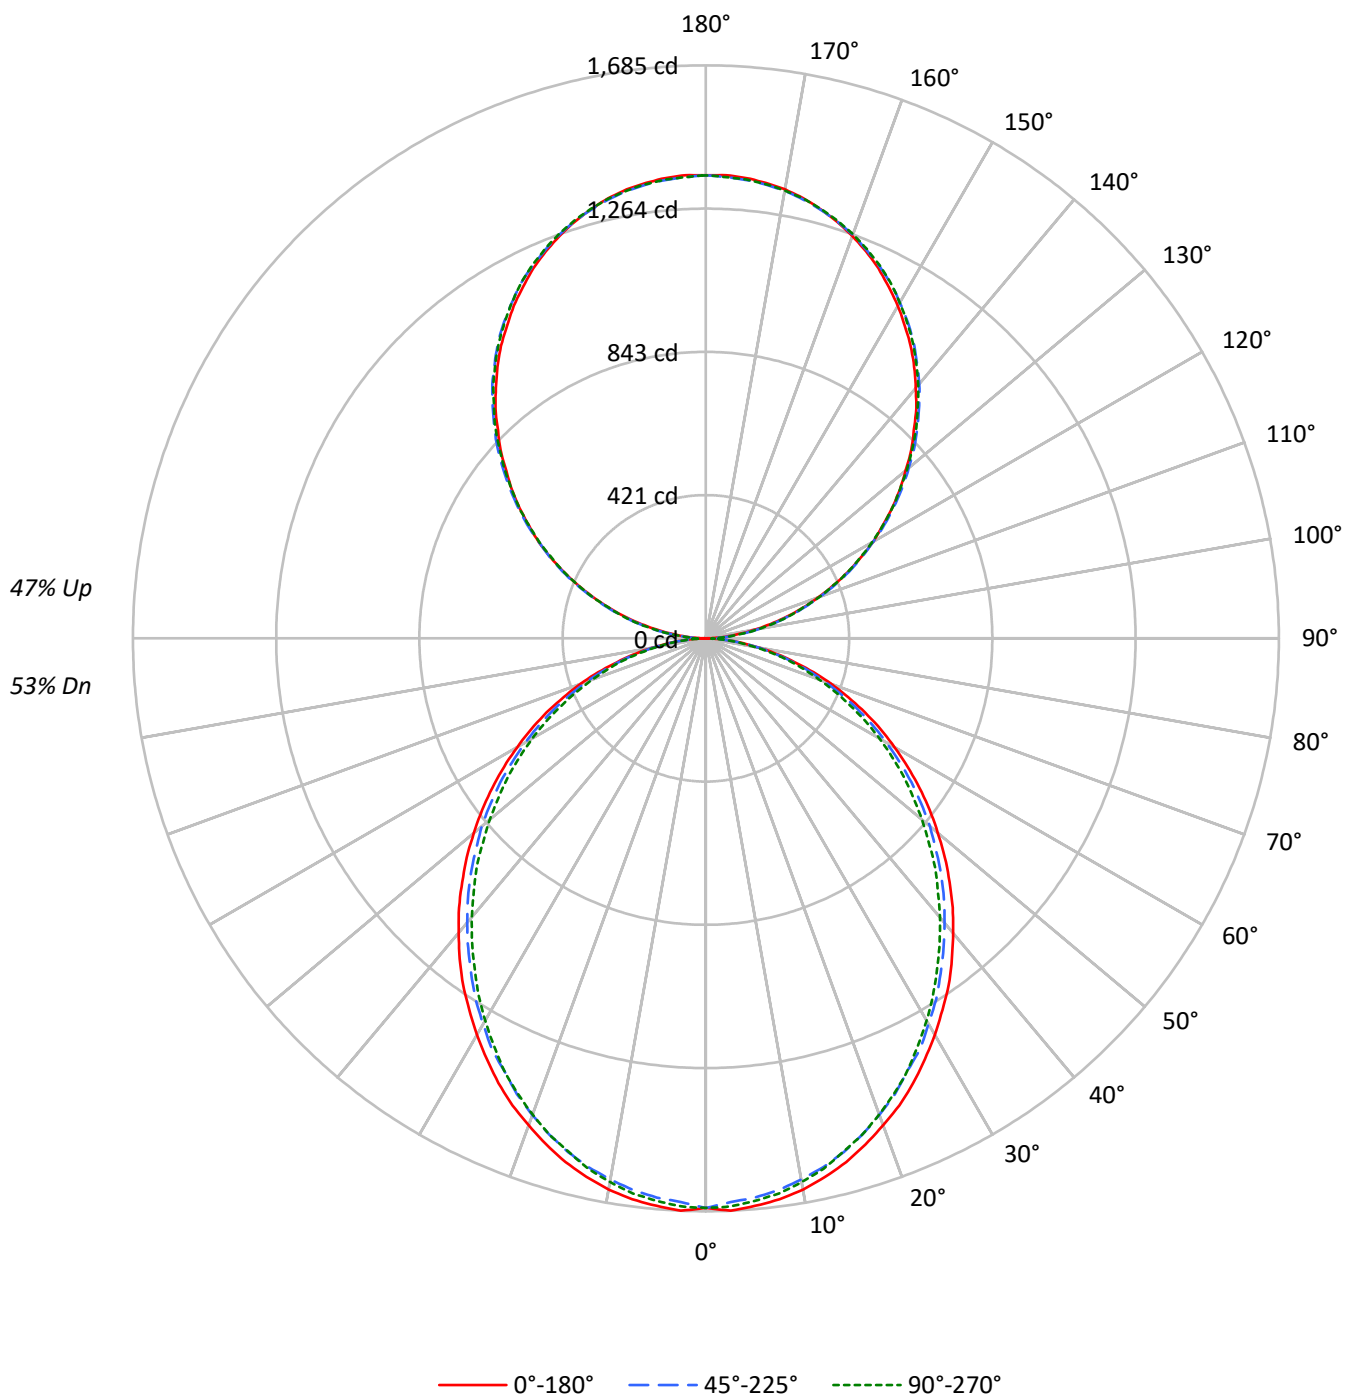

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3683	3683	3683
5°	3683	3624	3651
10°	3647	3567	3597
15°	3587	3500	3514
20°	3508	3411	3430
25°	3429	3305	3334
30°	3332	3207	3213
35°	3240	3091	3085
40°	3127	2975	2962
45°	3015	2858	2837
50°	2891	2734	2693
55°	2761	2592	2558
60°	2614	2424	2405
65°	2453	2248	2223
70°	2248	2034	2027
75°	1966	1778	1839
80°	1625	1452	1494
85°	1098	917	938

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3015 cd/sqm

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	2.0
10°-20°	443.6	5.5
20°-30°	651.9	8.1
30°-40°	757.2	9.4
40°-50°	756.2	9.4
50°-60°	659.4	8.2
60°-70°	487.4	6.0
70°-80°	275.8	3.4
80°-90°	76.7	0.9
90°-100°	84.2	1.0
100°-110°	267.7	3.3
110°-120°	458.1	5.7
120°-130°	602.5	7.5
130°-140°	676.3	8.4
140°-150°	663.1	8.2
150°-160°	556.3	6.9
160°-170°	368.9	4.6
170°-180°	128.9	1.6
0°-30°	1253.2	15.5
0°-40°	2010.3	24.9
0°-60°	3425.9	42.4
0°-90°	4265.8	52.8
90°-120°	810.0	10.0
90°-150°	2751.9	34.1
90°-180°	3806.0	47.2
0°-180°	8071.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	1	15	40	38	39	8
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P919892

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.95	12.83	12.88	13.78	15.01	11.50	12.39	12.43	13.34	14.57
	3H	13.59	14.38	14.53	15.34	16.60	13.10	13.89	14.04	14.85	16.11
	4H	14.16	14.92	15.12	15.88	17.14	13.67	14.42	14.63	15.39	16.65
	6H	14.55	15.24	15.52	16.21	17.49	14.05	14.75	15.02	15.71	16.99
	8H	14.65	15.31	15.62	16.30	17.57	14.15	14.81	15.12	15.79	17.07
	12H	14.69	15.32	15.67	16.30	17.60	14.18	14.81	15.16	15.79	17.09
4H	2H	12.40	13.15	13.36	14.12	15.38	12.04	12.80	13.01	13.76	15.02
	3H	14.24	14.87	15.22	15.87	17.14	13.84	14.46	14.81	15.46	16.73
	4H	14.94	15.52	15.93	16.51	17.81	14.52	15.09	15.50	16.08	17.38
	6H	15.44	15.94	16.44	16.95	18.25	15.01	15.51	16.00	16.52	17.81
	8H	15.58	16.05	16.58	17.05	18.36	15.15	15.61	16.14	16.61	17.93
	12H	15.65	16.07	16.66	17.09	18.40	15.20	15.62	16.22	16.64	17.96
8H	4H	15.13	15.59	16.13	16.60	17.91	14.75	15.22	15.75	16.22	17.53
	6H	15.74	16.12	16.76	17.17	18.48	15.35	15.74	16.38	16.78	18.09
	8H	15.95	16.28	16.98	17.32	18.65	15.55	15.89	16.58	16.92	18.25
	12H	16.07	16.36	17.10	17.39	18.76	15.66	15.95	16.69	16.98	18.35
12H	4H	15.12	15.53	16.13	16.55	17.87	14.75	15.16	15.76	16.18	17.50
	6H	15.76	16.10	16.79	17.13	18.46	15.39	15.73	16.42	16.76	18.09
	8H	15.99	16.29	17.03	17.32	18.69	15.61	15.91	16.64	16.93	18.31