

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919903

Luminaire Tested: DFN2DIP-SQ2F0-050D070US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919903
REPORT IS A COMBINATION OF REPORTS P901344 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D070US935-RLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9626.0 lumens
Efficiency: N/A
Efficacy: 97.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 98.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLONL

Luminous Intensity Polar Plot

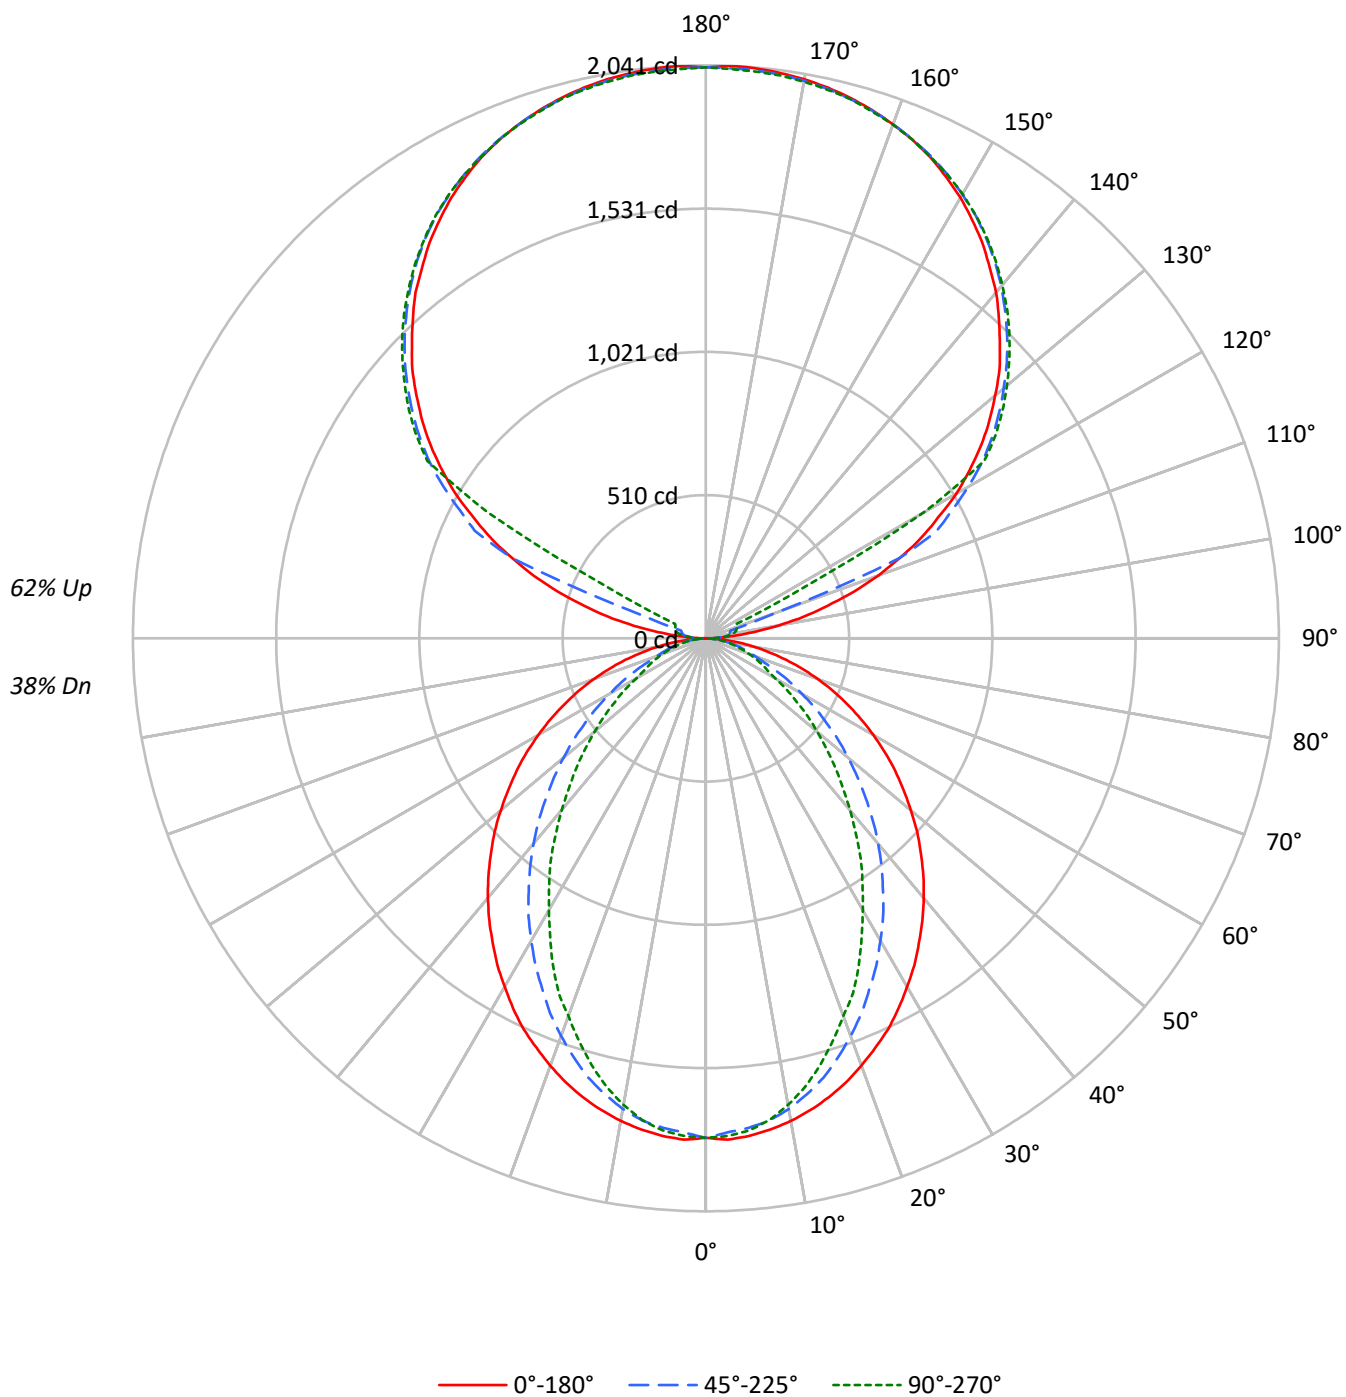

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	95	91	88	84	87	83	80	77	68	66	64	54	52	51	40	40	39
2	87	80	74	69	79	73	68	64	60	56	53	47	45	43	36	35	33
3	80	71	64	58	72	65	59	54	53	49	45	42	39	37	32	30	29
4	73	63	55	50	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	43	61	51	45	40	42	37	34	34	31	28	26	24	22
6	62	50	43	37	56	46	39	34	38	33	29	31	27	24	24	22	20
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	18
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	50	38	31	26	45	35	28	24	29	24	21	24	20	18	19	16	14
10	46	35	28	23	42	32	26	22	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3912	3912	3912
5°	3912	3842	3870
10°	3866	3758	3738
15°	3806	3626	3538
20°	3729	3446	3295
25°	3650	3247	3061
30°	3546	3044	2765
35°	3444	2826	2505
40°	3340	2601	2209
45°	3219	2353	1940
50°	3094	2104	1678
55°	2963	1838	1426
60°	2810	1562	1169
65°	2635	1282	1046
70°	2422	1022	939
75°	2154	884	843
80°	1769	717	715
85°	1151	446	509

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3219 cd/sqm

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.8	1.7
10°-20°	457.8	4.8
20°-30°	642.7	6.7
30°-40°	700.6	7.3
40°-50°	643.9	6.7
50°-60°	505.7	5.3
60°-70°	329.2	3.4
70°-80°	169.5	1.8
80°-90°	46.8	0.5
90°-100°	67.1	0.7
100°-110°	250.0	2.6
110°-120°	663.1	6.9
120°-130°	1099.8	11.4
130°-140°	1168.3	12.1
140°-150°	1085.8	11.3
150°-160°	872.9	9.1
160°-170°	562.5	5.8
170°-180°	193.6	2.0
0°-30°	1267.2	13.2
0°-40°	1967.8	20.4
0°-60°	3117.4	32.4
0°-90°	3662.8	38.1
90°-120°	980.2	10.2
90°-150°	4334.1	45.0
90°-180°	5963.0	61.9
0°-180°	9626.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1779	1779	1779	1779	1779	
5°	1779	1771	1750	1765	1760	169
15°	1692	1675	1620	1589	1573	477
25°	1536	1484	1378	1312	1288	706
35°	1324	1242	1100	998	963	828
45°	1082	974	805	691	652	836
55°	823	697	523	427	396	735
65°	556	425	280	226	221	551
75°	296	184	129	118	116	313
85°	69	35	31	31	31	79
90°	1	18	29	37	40	9
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1779.3	1779.3	1779.3	1779.3	1779.3
2.5°	1787.3	1779.3	1761.5	1777.7	1774.4
5°	1779.3	1771.2	1750.2	1764.7	1760.0
7.5°	1764.7	1755.1	1732.6	1739.0	1730.9
10°	1745.4	1734.1	1702.0	1697.1	1687.5
12.5°	1721.3	1706.8	1663.3	1653.7	1635.9
15°	1692.3	1674.6	1619.9	1589.3	1573.2
17.5°	1658.5	1632.7	1565.0	1529.6	1503.8
20°	1619.9	1587.6	1507.1	1467.0	1431.4
22.5°	1578.0	1540.9	1447.5	1392.8	1368.7
25°	1536.1	1484.5	1378.3	1312.3	1288.1
27.5°	1486.3	1431.4	1313.9	1238.2	1201.2
30°	1433.1	1371.8	1243.0	1161.0	1117.4
32.5°	1381.6	1307.4	1175.5	1078.8	1038.5
35°	1323.6	1241.5	1099.8	998.3	962.9
37.5°	1267.2	1178.6	1029.0	917.7	877.6
40°	1207.6	1111.1	954.8	840.5	798.7
42.5°	1146.5	1043.4	880.8	761.6	721.4
45°	1082.1	974.1	805.1	690.7	652.0
47.5°	1020.9	906.6	732.7	618.3	582.9
50°	953.3	839.0	661.8	550.6	516.9
52.5°	887.2	766.4	594.2	487.9	457.4
55°	822.8	697.1	523.2	426.7	396.1
57.5°	756.8	628.0	460.5	370.4	344.6
60°	689.1	560.3	394.4	312.5	286.6
62.5°	623.2	494.4	338.1	260.9	248.1
65°	555.5	425.1	280.2	225.5	220.6
67.5°	491.1	360.7	225.5	198.0	193.2
70°	423.5	297.9	186.8	170.6	164.2
72.5°	359.1	239.9	156.2	143.4	140.1
75°	296.3	183.5	128.8	117.5	116.0
77.5°	233.5	130.4	101.5	95.0	91.7
80°	175.5	93.4	77.2	70.9	70.9
82.5°	122.3	62.9	53.1	49.9	49.9
85°	69.2	35.4	30.6	30.6	30.6
87.5°	25.8	12.8	12.8	11.3	11.3
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P919903

CATALOG NUMBER: DFN2DIP-SQ2F0-050D070US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.54	11.28	11.60	12.34	13.78	6.50	7.25	7.56	8.30	9.74
	3H	12.19	12.86	13.26	13.92	15.38	7.67	8.33	8.74	9.40	10.85
	4H	12.79	13.41	13.87	14.48	15.94	8.10	8.73	9.18	9.80	11.26
	6H	13.19	13.76	14.28	14.84	16.31	8.40	8.98	9.49	10.05	11.52
	8H	13.30	13.85	14.40	14.94	16.41	8.48	9.03	9.57	10.12	11.58
	12H	13.35	13.87	14.45	14.96	16.45	8.51	9.03	9.61	10.12	11.61
4H	2H	10.55	11.17	11.63	12.24	13.70	7.08	7.71	8.17	8.78	10.24
	3H	12.34	12.87	13.44	13.96	15.43	8.40	8.92	9.49	10.02	11.49
	4H	13.02	13.50	14.12	14.58	16.08	8.93	9.41	10.03	10.49	11.99
	6H	13.51	13.92	14.62	15.03	16.52	9.32	9.73	10.43	10.84	12.33
	8H	13.67	14.05	14.78	15.16	16.66	9.44	9.82	10.54	10.92	12.43
	12H	13.75	14.10	14.87	15.21	16.72	9.49	9.84	10.61	10.95	12.46
8H	4H	12.97	13.36	14.08	14.46	15.96	9.19	9.57	10.30	10.67	12.18
	6H	13.52	13.83	14.64	14.98	16.47	9.68	10.00	10.81	11.14	12.64
	8H	13.72	14.00	14.85	15.12	16.64	9.86	10.13	10.99	11.26	12.78
	12H	13.84	14.08	14.98	15.20	16.76	9.96	10.20	11.09	11.32	12.88
12H	4H	12.92	13.27	14.04	14.38	15.89	9.19	9.53	10.31	10.65	12.16
	6H	13.49	13.77	14.62	14.89	16.41	9.72	10.00	10.86	11.13	12.64
	8H	13.69	13.93	14.83	15.06	16.61	9.91	10.16	11.05	11.28	12.83

END OF REPORT