

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919913

Luminaire Tested: DFN2DIP-SQ2F0-060D040US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919913
REPORT IS A COMBINATION OF REPORTS P901309 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D040US935-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8523.8 lumens
Efficiency: N/A
Efficacy: 100.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 84.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

Luminous Intensity Polar Plot

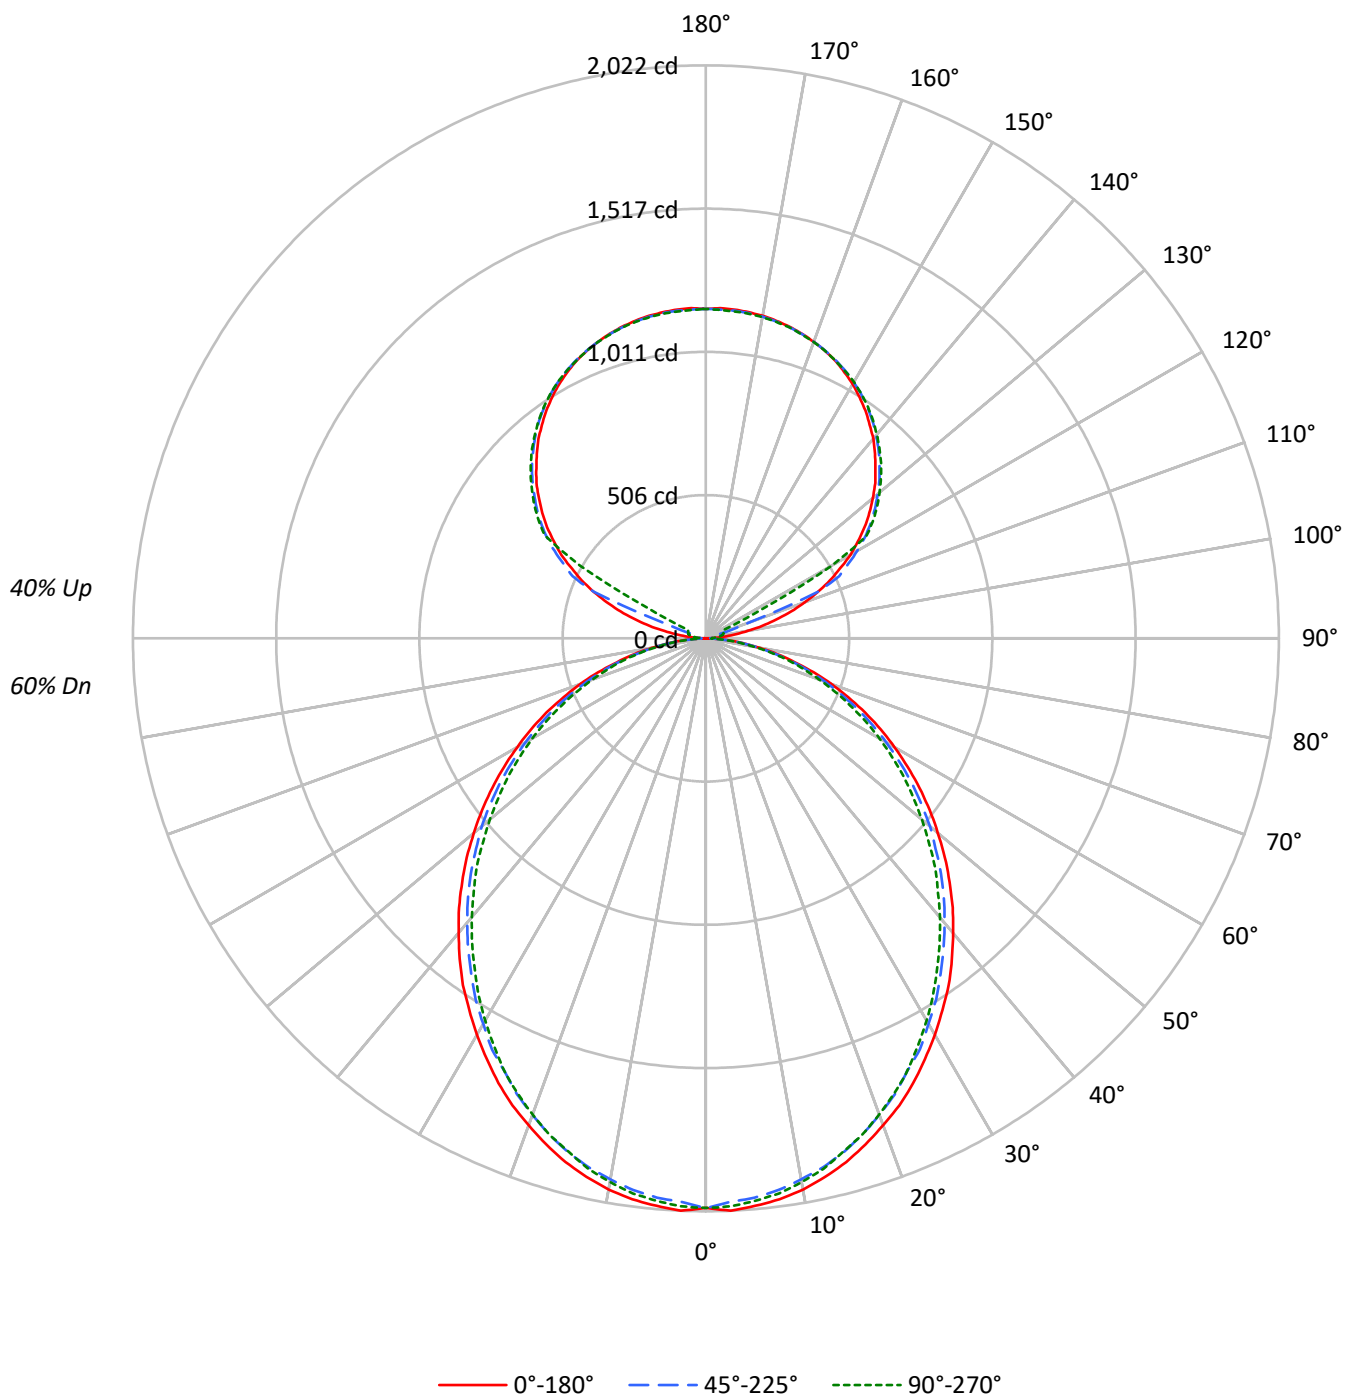

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4420	4420	4420
5°	4419	4349	4382
10°	4376	4281	4316
15°	4304	4201	4217
20°	4209	4093	4116
25°	4115	3967	4000
30°	3999	3848	3855
35°	3888	3710	3701
40°	3753	3570	3555
45°	3618	3429	3405
50°	3469	3281	3231
55°	3313	3110	3070
60°	3137	2909	2886
65°	2943	2698	2668
70°	2698	2441	2432
75°	2360	2134	2206
80°	1949	1742	1792
85°	1316	1099	1126

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3618 cd/sqm

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.2
10°-20°	532.3	6.2
20°-30°	782.3	9.2
30°-40°	908.6	10.7
40°-50°	907.5	10.6
50°-60°	791.3	9.3
60°-70°	584.9	6.9
70°-80°	330.9	3.9
80°-90°	89.4	1.0
90°-100°	38.3	0.4
100°-110°	142.9	1.7
110°-120°	378.9	4.4
120°-130°	628.5	7.4
130°-140°	667.6	7.8
140°-150°	620.4	7.3
150°-160°	498.8	5.9
160°-170°	321.4	3.8
170°-180°	110.6	1.3
0°-30°	1503.8	17.6
0°-40°	2412.4	28.3
0°-60°	4111.1	48.2
0°-90°	5116.4	60.0
90°-120°	560.1	6.6
90°-150°	2476.6	29.1
90°-180°	3407.0	40.0
0°-180°	8523.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	10	17	21	23	8
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P919913

CATALOG NUMBER: DFN2DIP-SQ2F0-060D040US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.20	14.16	14.06	15.04	16.16	12.75	13.71	13.62	14.60	15.72
	3H	14.85	15.71	15.72	16.60	17.75	14.36	15.22	15.23	16.11	17.26
	4H	15.42	16.24	16.32	17.14	18.30	14.93	15.74	15.83	16.65	17.80
	6H	15.81	16.57	16.72	17.47	18.64	15.31	16.07	16.22	16.97	18.14
	8H	15.91	16.63	16.83	17.56	18.73	15.41	16.13	16.33	17.06	18.22
	12H	15.96	16.64	16.88	17.56	18.76	15.45	16.13	16.37	17.05	18.25
4H	2H	13.66	14.47	14.56	15.38	16.53	13.30	14.12	14.20	15.02	16.18
	3H	15.51	16.19	16.42	17.12	18.30	15.10	15.78	16.01	16.72	17.89
	4H	16.21	16.83	17.14	17.76	18.96	15.79	16.41	16.71	17.34	18.54
	6H	16.72	17.25	17.65	18.20	19.40	16.28	16.82	17.22	17.77	18.97
	8H	16.86	17.36	17.80	18.31	19.52	16.42	16.92	17.36	17.87	19.08
	12H	16.93	17.38	17.88	18.34	19.56	16.48	16.93	17.44	17.90	19.11
8H	4H	16.41	16.91	17.34	17.85	19.07	16.03	16.53	16.97	17.48	18.69
	6H	17.02	17.43	17.98	18.42	19.63	16.63	17.05	17.60	18.04	19.25
	8H	17.23	17.59	18.20	18.57	19.80	16.83	17.20	17.81	18.18	19.41
	12H	17.35	17.67	18.33	18.64	19.92	16.94	17.26	17.92	18.23	19.51
12H	4H	16.39	16.85	17.35	17.81	19.03	16.02	16.48	16.98	17.44	18.66
	6H	17.04	17.41	18.02	18.39	19.62	16.67	17.04	17.64	18.02	19.24
	8H	17.28	17.60	18.25	18.57	19.85	16.89	17.22	17.87	18.19	19.46