

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919928

Luminaire Tested: DFN2DIP-SQ2F0-060D080US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919928
REPORT IS A COMBINATION OF REPORTS P899837 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D080US935-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11210.2 lumens
Efficiency: N/A
Efficacy: 93.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 120
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFLL

Luminous Intensity Polar Plot

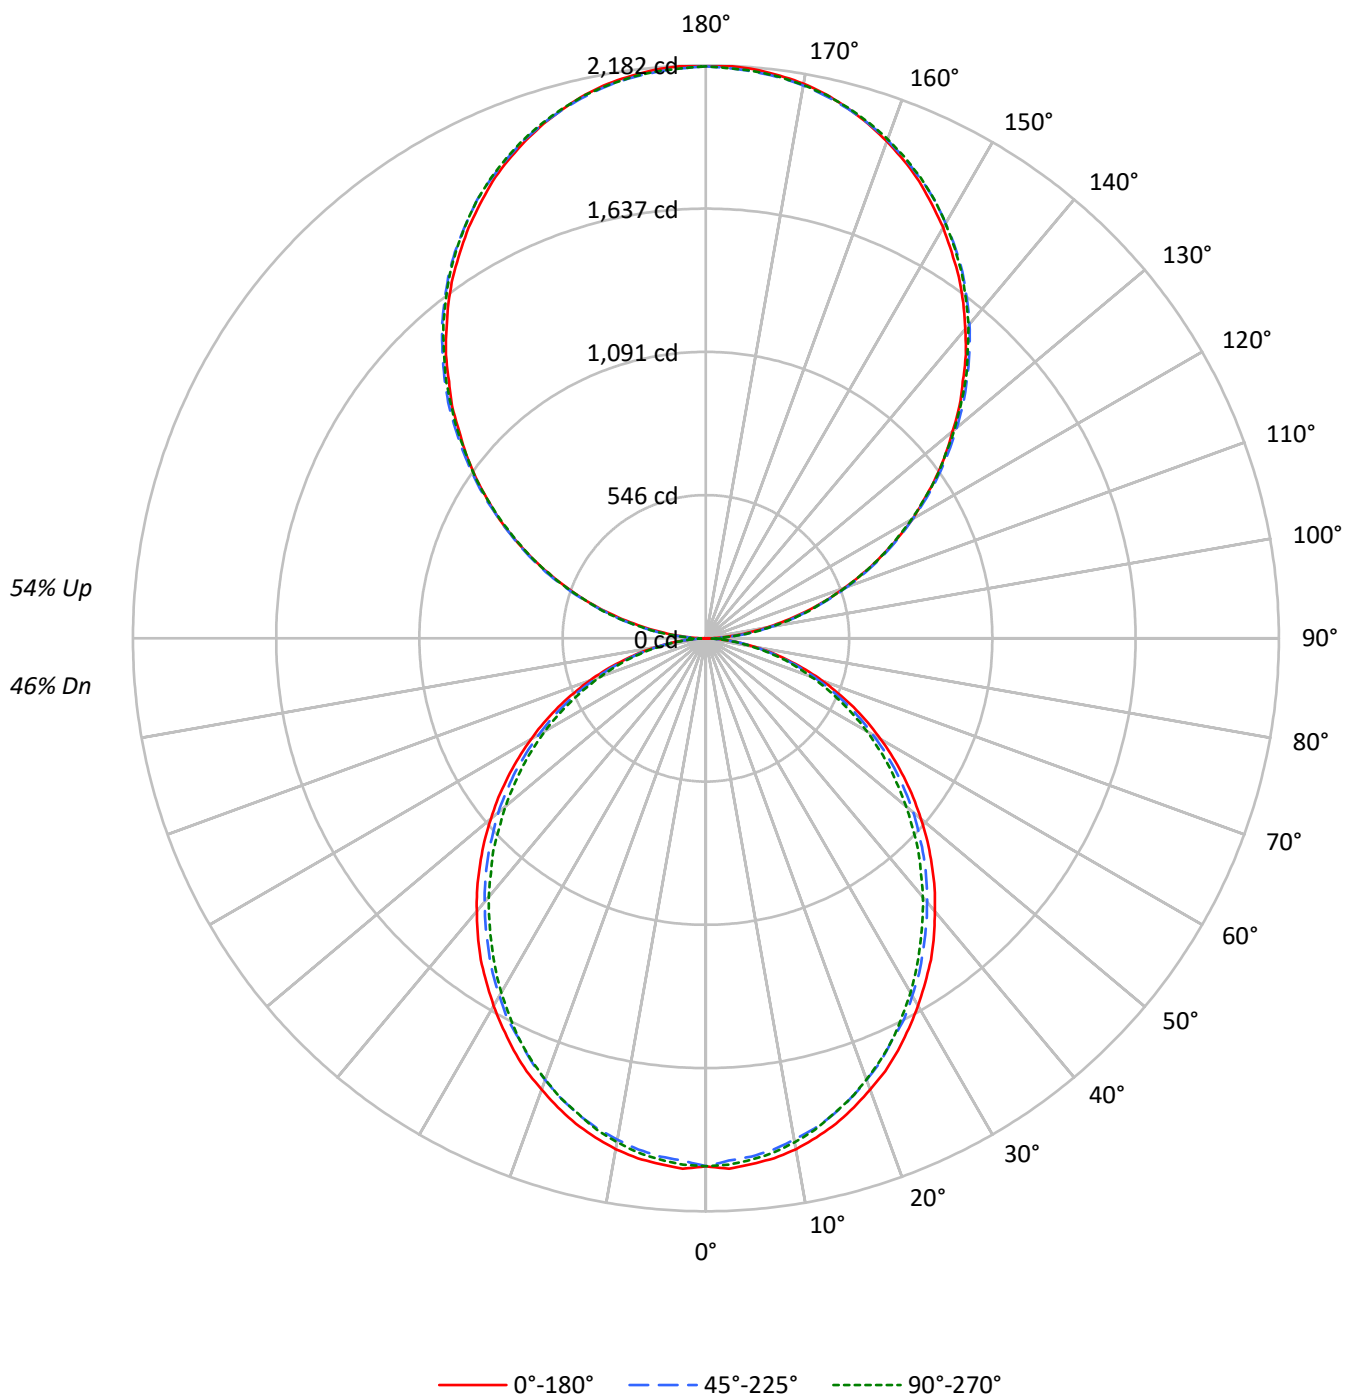

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4420	4420	4420
5°	4419	4349	4382
10°	4376	4281	4316
15°	4304	4201	4217
20°	4209	4093	4116
25°	4115	3967	4000
30°	3999	3848	3855
35°	3888	3710	3701
40°	3753	3570	3555
45°	3618	3429	3405
50°	3469	3281	3231
55°	3313	3110	3070
60°	3137	2909	2886
65°	2943	2698	2668
70°	2698	2441	2432
75°	2360	2134	2206
80°	1949	1742	1792
85°	1316	1099	1126

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3618 cd/sqm

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.7
10°-20°	532.3	4.7
20°-30°	782.3	7.0
30°-40°	908.6	8.1
40°-50°	907.5	8.1
50°-60°	791.3	7.1
60°-70°	584.9	5.2
70°-80°	330.9	3.0
80°-90°	93.5	0.8
90°-100°	134.8	1.2
100°-110°	428.3	3.8
110°-120°	733.0	6.5
120°-130°	964.0	8.6
130°-140°	1082.0	9.7
140°-150°	1061.0	9.5
150°-160°	890.1	7.9
160°-170°	590.3	5.3
170°-180°	206.3	1.8
0°-30°	1503.8	13.4
0°-40°	2412.4	21.5
0°-60°	4111.1	36.7
0°-90°	5120.5	45.7
90°-120°	1296.1	11.6
90°-150°	4403.1	39.3
90°-180°	6090.0	54.3
0°-180°	11210.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	2	24	64	60	62	11
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P919928

CATALOG NUMBER: DFN2DIP-SQ2F0-060D080US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.91	12.73	12.90	13.73	15.07	11.46	12.28	12.45	13.29	14.62
	3H	13.54	14.28	14.55	15.30	16.65	13.05	13.79	14.06	14.81	16.16
	4H	14.12	14.82	15.13	15.83	17.19	13.62	14.32	14.64	15.34	16.70
	6H	14.50	15.14	15.53	16.17	17.54	14.00	14.64	15.03	15.67	17.04
	8H	14.60	15.21	15.63	16.25	17.62	14.09	14.71	15.13	15.75	17.11
	12H	14.64	15.22	15.67	16.25	17.64	14.13	14.71	15.16	15.74	17.14
4H	2H	12.35	13.05	13.37	14.07	15.43	12.00	12.70	13.02	13.71	15.07
	3H	14.19	14.77	15.22	15.82	17.19	13.78	14.37	14.81	15.41	16.79
	4H	14.89	15.42	15.93	16.46	17.86	14.46	15.00	15.50	16.04	17.43
	6H	15.38	15.84	16.43	16.90	18.29	14.95	15.41	16.00	16.47	17.86
	8H	15.52	15.95	16.57	17.00	18.41	15.08	15.51	16.13	16.57	17.97
	12H	15.58	15.97	16.65	17.04	18.45	15.14	15.52	16.20	16.59	18.00
8H	4H	15.07	15.50	16.12	16.55	17.96	14.69	15.12	15.74	16.17	17.58
	6H	15.68	16.03	16.75	17.13	18.53	15.29	15.65	16.36	16.74	18.15
	8H	15.88	16.19	16.96	17.27	18.70	15.49	15.80	16.57	16.88	18.30
	12H	16.00	16.27	17.08	17.35	18.81	15.59	15.86	16.67	16.94	18.40
12H	4H	15.05	15.44	16.12	16.51	17.92	14.68	15.07	15.75	16.14	17.55
	6H	15.70	16.01	16.78	17.09	18.52	15.33	15.64	16.41	16.72	18.14
	8H	15.92	16.20	17.01	17.27	18.74	15.54	15.82	16.63	16.89	18.36