

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919940

Luminaire Tested: DFN2DIP-SQ2F0-070D050US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919940
REPORT IS A COMBINATION OF REPORTS P899803 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-070D050US935-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9776.6 lumens
Efficiency: N/A
Efficacy: 92.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 105.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

Luminous Intensity Polar Plot

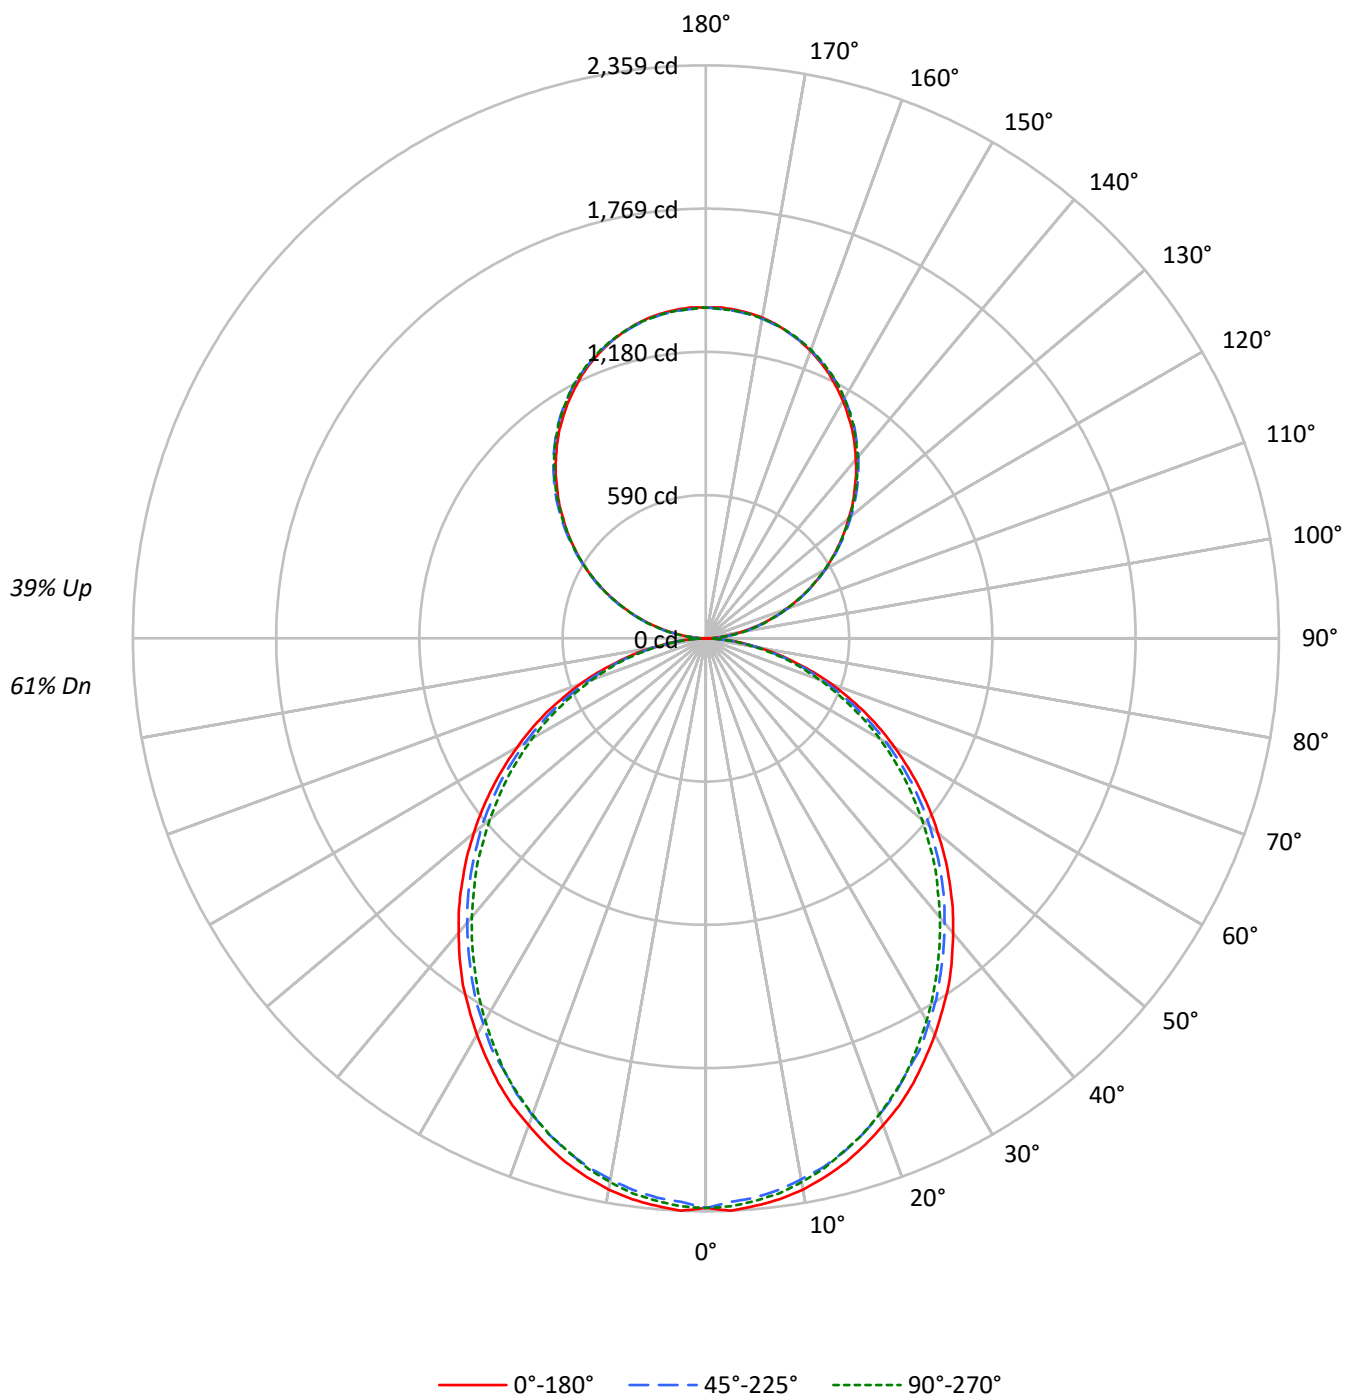

TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	100	96	92	88	94	90	86	83	79	76	74	68	66	65	59	57	56
2	91	84	77	72	85	79	73	68	69	65	61	60	57	54	52	49	47
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	37	35
5	70	58	50	44	65	55	47	42	48	42	38	42	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	38	34	30	33	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	26	31	27	24
8	56	43	35	30	52	41	33	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	48	37	30	25	33	27	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5157	5157	5157
5°	5156	5074	5112
10°	5105	4994	5035
15°	5021	4901	4920
20°	4911	4775	4802
25°	4801	4628	4667
30°	4665	4489	4498
35°	4536	4328	4319
40°	4378	4165	4147
45°	4220	4001	3972
50°	4048	3828	3770
55°	3866	3629	3581
60°	3660	3393	3366
65°	3434	3148	3113
70°	3147	2848	2838
75°	2754	2489	2574
80°	2274	2033	2090
85°	1537	1284	1314

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4220 cd/sqm

TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	2.3
10°-20°	621.0	6.4
20°-30°	912.7	9.3
30°-40°	1060.0	10.8
40°-50°	1058.7	10.8
50°-60°	923.2	9.4
60°-70°	682.4	7.0
70°-80°	386.1	3.9
80°-90°	105.8	1.1
90°-100°	84.2	0.9
100°-110°	267.7	2.7
110°-120°	458.1	4.7
120°-130°	602.5	6.2
130°-140°	676.3	6.9
140°-150°	663.1	6.8
150°-160°	556.3	5.7
160°-170°	368.9	3.8
170°-180°	128.9	1.3
0°-30°	1754.4	17.9
0°-40°	2814.4	28.8
0°-60°	4796.3	49.1
0°-90°	5970.6	61.1
90°-120°	810.0	8.3
90°-150°	2751.9	28.1
90°-180°	3806.0	38.9
0°-180°	9776.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	1	15	40	38	39	9
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8



TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P919940

CATALOG NUMBER: DFN2DIP-SQ2F0-070D050US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.82	14.79	14.67	15.67	16.77	13.37	14.34	14.23	15.22	16.33
	3H	15.47	16.34	16.34	17.23	18.36	14.98	15.85	15.85	16.74	17.87
	4H	16.05	16.87	16.93	17.76	18.90	15.55	16.38	16.44	17.27	18.41
	6H	16.44	17.20	17.33	18.10	19.25	15.94	16.70	16.83	17.60	18.75
	8H	16.54	17.26	17.44	18.18	19.33	16.04	16.76	16.94	17.68	18.83
	12H	16.58	17.27	17.49	18.18	19.36	16.07	16.76	16.98	17.67	18.85
4H	2H	14.28	15.10	15.17	16.00	17.14	13.93	14.75	14.81	15.64	16.78
	3H	16.13	16.82	17.03	17.75	18.90	15.73	16.41	16.63	17.34	18.49
	4H	16.84	17.46	17.75	18.39	19.57	16.41	17.04	17.32	17.96	19.14
	6H	17.34	17.88	18.27	18.83	20.01	16.91	17.45	17.83	18.39	19.58
	8H	17.48	17.99	18.41	18.93	20.12	17.05	17.55	17.97	18.49	19.69
	12H	17.55	18.01	18.50	18.97	20.17	17.10	17.56	18.05	18.52	19.72
8H	4H	17.03	17.54	17.96	18.48	19.67	16.65	17.16	17.58	18.10	19.29
	6H	17.64	18.06	18.60	19.04	20.24	17.26	17.68	18.21	18.66	19.85
	8H	17.85	18.22	18.82	19.19	20.41	17.46	17.83	18.42	18.80	20.01
	12H	17.97	18.30	18.94	19.27	20.53	17.57	17.89	18.53	18.86	20.12
12H	4H	17.02	17.48	17.97	18.43	19.63	16.65	17.11	17.60	18.06	19.26
	6H	17.67	18.04	18.63	19.01	20.22	17.30	17.67	18.26	18.64	19.85
	8H	17.90	18.23	18.87	19.19	20.45	17.52	17.85	18.49	18.81	20.07