

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919973

Luminaire Tested: DFN2DIP-SQ2F0-080D070US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919973
REPORT IS A COMBINATION OF REPORTS P901349 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-080D070US935-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12785.8 lumens
Efficiency: N/A
Efficacy: 95.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 133.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

Luminous Intensity Polar Plot

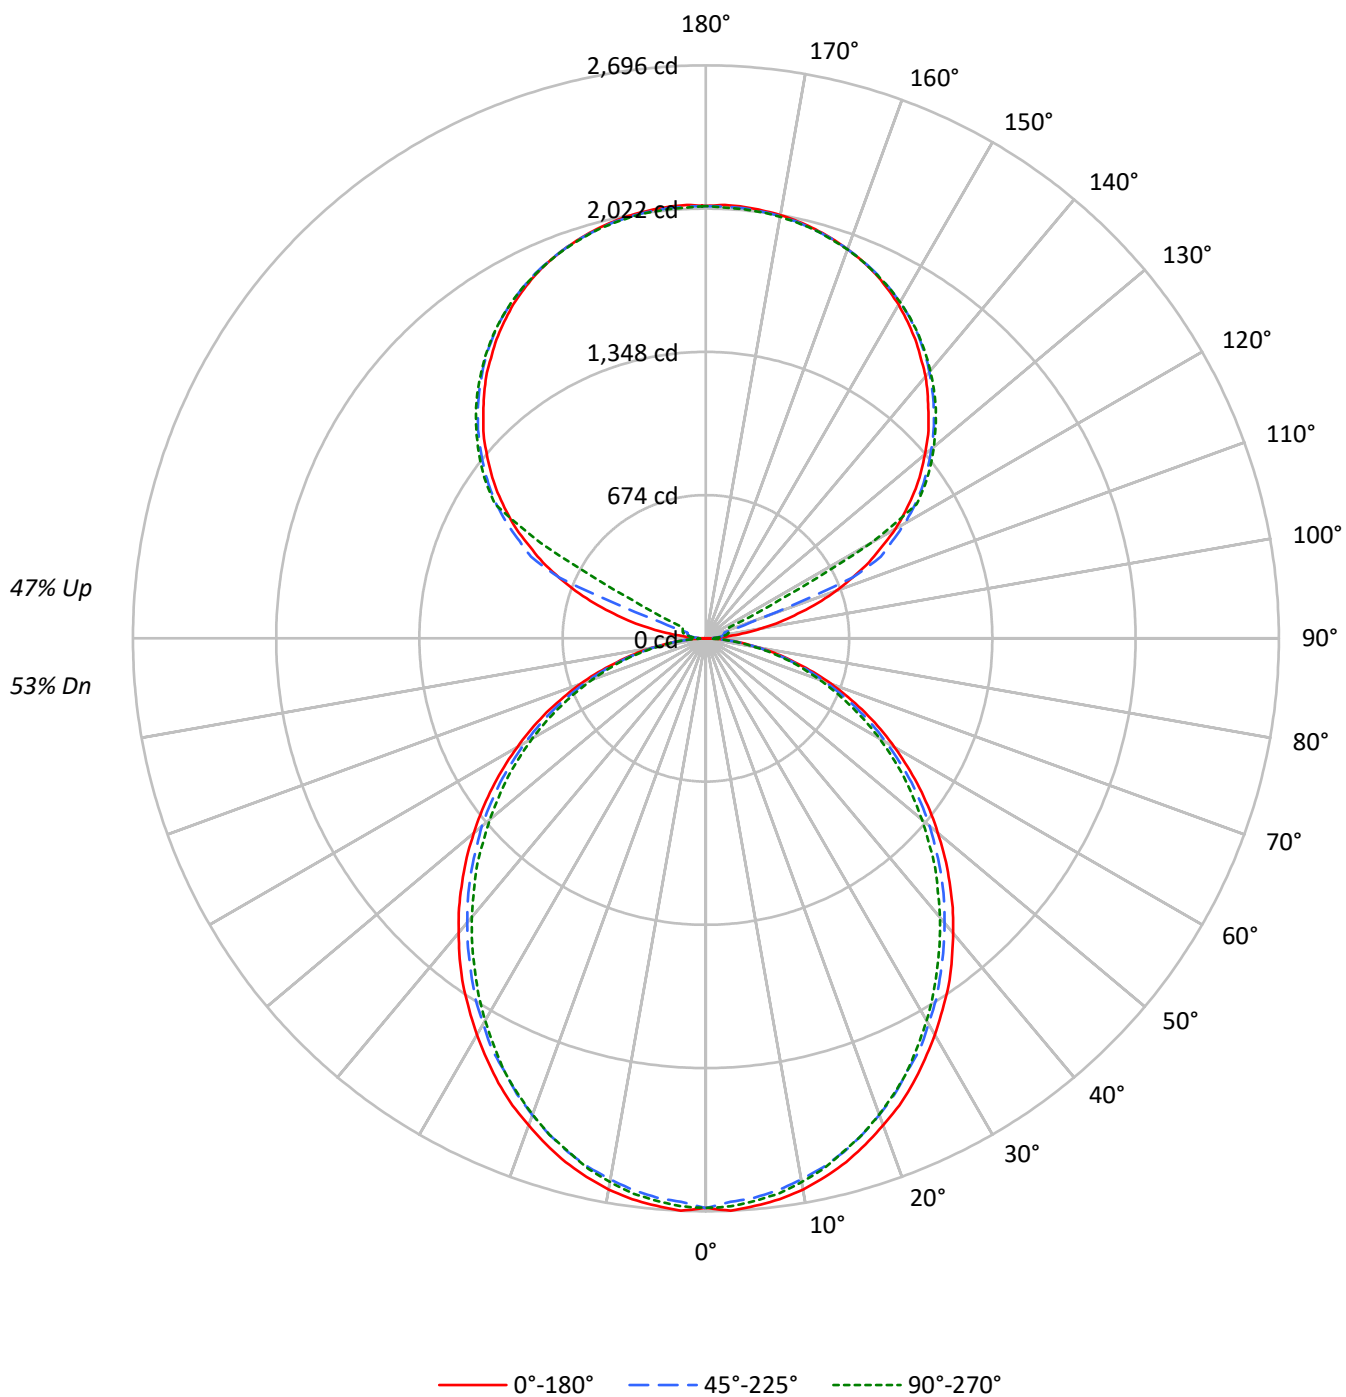

TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	94	90	87	91	87	84	81	75	72	70	63	61	60	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	53	47	51	46	42	44	40	36	37	33	31
5	69	57	49	43	63	53	46	41	46	40	36	39	35	31	33	30	27
6	63	51	43	37	59	48	41	35	41	36	31	35	31	28	30	26	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	31	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	26	22	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5893	5893	5893
5°	5892	5798	5842
10°	5835	5707	5755
15°	5739	5601	5623
20°	5612	5457	5488
25°	5487	5289	5334
30°	5332	5131	5140
35°	5184	4947	4935
40°	5004	4760	4740
45°	4823	4572	4540
50°	4626	4374	4308
55°	4418	4147	4093
60°	4183	3878	3847
65°	3925	3597	3557
70°	3597	3256	3243
75°	3146	2845	2942
80°	2599	2323	2389
85°	1757	1468	1501

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4823 cd/sqm

TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	2.0
10°-20°	709.8	5.6
20°-30°	1043.1	8.2
30°-40°	1211.4	9.5
40°-50°	1209.9	9.5
50°-60°	1055.0	8.3
60°-70°	779.9	6.1
70°-80°	441.2	3.5
80°-90°	120.1	0.9
90°-100°	67.1	0.5
100°-110°	250.0	2.0
110°-120°	663.1	5.2
120°-130°	1099.8	8.6
130°-140°	1168.3	9.1
140°-150°	1085.8	8.5
150°-160°	872.9	6.8
160°-170°	562.5	4.4
170°-180°	193.6	1.5
0°-30°	2005.1	15.7
0°-40°	3216.5	25.2
0°-60°	5481.5	42.9
0°-90°	6822.7	53.4
90°-120°	980.2	7.7
90°-150°	4334.1	33.9
90°-180°	5963.0	46.6
0°-180°	12785.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	1	18	29	37	40	12
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2



TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P919973

CATALOG NUMBER: DFN2DIP-SQ2F0-080D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.63	14.52	14.55	15.46	16.69	13.18	14.07	14.11	15.02	16.24
	3H	15.27	16.07	16.21	17.02	18.27	14.78	15.58	15.72	16.53	17.78
	4H	15.84	16.60	16.80	17.56	18.82	15.35	16.11	16.30	17.07	18.32
	6H	16.23	16.93	17.20	17.89	19.16	15.73	16.43	16.70	17.39	18.66
	8H	16.33	16.99	17.30	17.98	19.24	15.83	16.49	16.80	17.47	18.74
	12H	16.37	17.00	17.35	17.98	19.27	15.86	16.50	16.84	17.47	18.76
4H	2H	14.08	14.84	15.04	15.80	17.05	13.72	14.48	14.68	15.44	16.70
	3H	15.93	16.56	16.89	17.55	18.82	15.52	16.15	16.49	17.14	18.41
	4H	16.63	17.20	17.60	18.19	19.48	16.20	16.78	17.18	17.76	19.05
	6H	17.12	17.62	18.11	18.63	19.92	16.69	17.19	17.68	18.20	19.49
	8H	17.26	17.73	18.26	18.73	20.04	16.83	17.29	17.82	18.29	19.60
	12H	17.33	17.75	18.34	18.77	20.08	16.88	17.30	17.89	18.32	19.63
8H	4H	16.81	17.28	17.80	18.28	19.58	16.43	16.90	17.43	17.90	19.21
	6H	17.42	17.81	18.44	18.85	20.15	17.04	17.42	18.05	18.46	19.77
	8H	17.63	17.97	18.65	19.00	20.32	17.24	17.58	18.26	18.60	19.93
	12H	17.75	18.05	18.78	19.07	20.44	17.34	17.64	18.37	18.66	20.03
12H	4H	16.80	17.22	17.81	18.23	19.54	16.43	16.85	17.44	17.86	19.17
	6H	17.45	17.79	18.47	18.81	20.14	17.07	17.41	18.10	18.44	19.76
	8H	17.67	17.97	18.70	19.00	20.36	17.29	17.59	18.32	18.61	19.98