

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922567

Luminaire Tested: DFN2DIP-SQ2F0-030D030US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922567
REPORT IS A COMBINATION OF REPORTS P901292 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D030US940-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4922.3 lumens
Efficiency: N/A
Efficacy: 107.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 45.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLLONL

Luminous Intensity Polar Plot

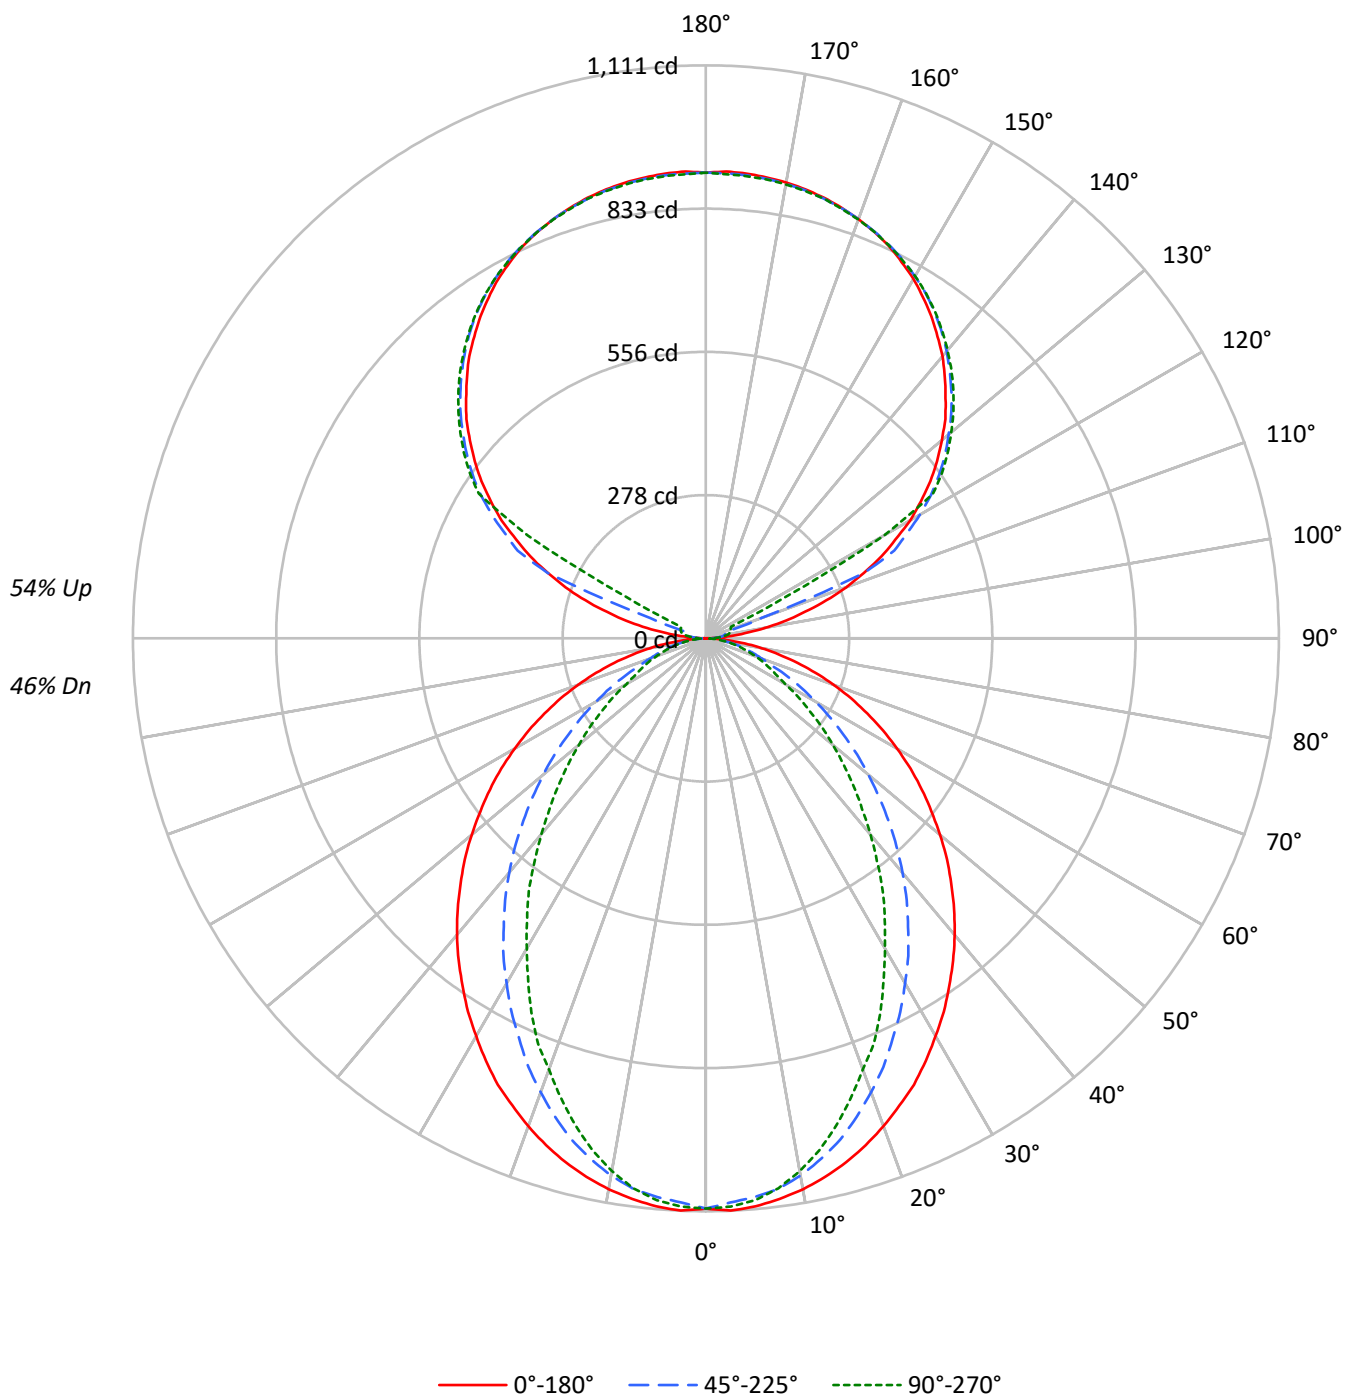

TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2431	2431	2431
5°	2431	2387	2404
10°	2403	2335	2323
15°	2365	2253	2199
20°	2317	2142	2048
25°	2268	2018	1902
30°	2204	1891	1718
35°	2140	1756	1557
40°	2076	1616	1373
45°	2001	1462	1206
50°	1923	1307	1043
55°	1841	1142	887
60°	1746	970	727
65°	1637	797	650
70°	1505	634	583
75°	1338	549	524
80°	1100	446	444
85°	715	277	316

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2001 cd/sqm

TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	2.1
10°-20°	284.5	5.8
20°-30°	399.4	8.1
30°-40°	435.3	8.8
40°-50°	400.1	8.1
50°-60°	314.2	6.4
60°-70°	204.5	4.2
70°-80°	105.3	2.1
80°-90°	28.5	0.6
90°-100°	29.8	0.6
100°-110°	111.0	2.3
110°-120°	294.3	6.0
120°-130°	488.2	9.9
130°-140°	518.5	10.5
140°-150°	481.9	9.8
150°-160°	387.5	7.9
160°-170°	249.7	5.1
170°-180°	85.9	1.7
0°-30°	787.5	16.0
0°-40°	1222.8	24.8
0°-60°	1937.2	39.4
0°-90°	2275.4	46.2
90°-120°	435.1	8.8
90°-150°	1923.7	39.1
90°-180°	2647.0	53.8
0°-180°	4922.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1106	1106	1106	1106	1106	
5°	1106	1101	1088	1097	1094	105
15°	1052	1040	1007	988	978	296
25°	955	922	856	816	800	439
35°	822	771	683	620	598	515
45°	672	605	500	429	405	519
55°	511	433	325	265	246	457
65°	345	264	174	140	137	342
75°	184	114	80	73	72	195
85°	43	22	19	19	19	49
90°	1	8	13	16	18	5
95°	42	21	25	29	28	50
105°	199	218	40	47	50	212
115°	376	387	403	101	54	370
125°	531	540	552	557	559	474
135°	657	668	674	680	679	508
145°	762	762	773	777	774	477
155°	840	834	841	845	840	387
165°	884	881	883	887	883	250
175°	905	900	902	906	900	86
180°	903	903	903	903	903	

TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1105.6	1105.6	1105.6	1105.6	1105.6
2.5°	1110.6	1105.6	1094.6	1104.7	1102.7
5°	1105.6	1100.6	1087.6	1096.6	1093.6
7.5°	1096.6	1090.7	1076.7	1080.6	1075.6
10°	1084.6	1077.6	1057.7	1054.5	1048.7
12.5°	1069.6	1060.6	1033.6	1027.6	1016.5
15°	1051.6	1040.5	1006.6	987.6	977.6
17.5°	1030.5	1014.6	972.5	950.6	934.5
20°	1006.6	986.5	936.5	911.6	889.5
22.5°	980.6	957.5	899.5	865.5	850.5
25°	954.6	922.5	856.5	815.5	800.4
27.5°	923.5	889.5	816.5	769.5	746.4
30°	890.6	852.5	772.4	721.5	694.4
32.5°	858.4	812.4	730.5	670.4	645.3
35°	822.5	771.4	683.4	620.4	598.3
37.5°	787.5	732.4	639.4	570.2	545.4
40°	750.5	690.5	593.3	522.3	496.3
42.5°	712.4	648.5	547.3	473.2	448.3
45°	672.4	605.3	500.3	429.2	405.2
47.5°	634.4	563.4	455.3	384.1	362.2
50°	592.4	521.3	411.3	342.1	321.2
52.5°	551.3	476.3	369.3	303.2	284.2
55°	511.2	433.2	325.1	265.2	246.2
57.5°	470.3	390.2	286.2	230.2	214.1
60°	428.2	348.2	245.1	194.1	178.2
62.5°	387.3	307.2	210.1	162.1	154.2
65°	345.2	264.1	174.1	140.1	137.1
67.5°	305.2	224.1	140.1	123.1	120.0
70°	263.1	185.1	116.0	106.0	102.0
72.5°	223.1	149.0	97.0	89.1	87.0
75°	184.0	114.0	80.1	73.0	72.1
77.5°	145.1	81.0	63.0	59.0	57.0
80°	109.1	58.1	48.0	44.1	44.1
82.5°	76.0	39.1	33.0	31.0	31.0
85°	43.0	21.9	19.0	19.0	19.0
87.5°	16.1	7.9	7.9	7.0	7.0
90°	0.6	7.8	13.0	16.4	17.6
92.5°	16.4	13.7	15.7	17.0	17.6
95°	42.4	20.9	25.4	28.8	28.1
97.5°	76.4	22.9	33.3	35.3	35.9
100°	115.7	26.1	37.3	42.4	43.8
102.5°	158.7	157.5	38.5	45.7	47.7
105°	198.6	218.2	39.9	47.0	49.7
107.5°	245.0	261.3	41.2	48.3	51.0
110°	289.4	303.1	114.3	49.0	51.6



TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	331.3	343.0	331.9	50.3	52.3
115°	375.6	386.7	403.1	100.6	53.6
117.5°	414.2	427.2	438.4	344.9	173.8
120°	457.3	467.1	478.8	486.7	398.5
122.5°	493.8	504.4	517.5	521.3	522.0
125°	531.1	539.6	552.1	556.6	558.6
127.5°	565.1	574.2	584.1	590.6	591.2
130°	597.1	607.6	614.7	621.9	621.3
132.5°	629.7	638.3	645.4	651.3	650.7
135°	657.2	667.7	673.5	680.1	678.8
137.5°	685.9	693.8	700.3	706.9	704.9
140°	714.0	719.3	726.4	732.3	729.1
142.5°	737.6	742.2	750.6	755.8	752.6
145°	762.4	761.7	772.8	777.4	774.1
147.5°	783.9	781.9	793.1	796.3	793.7
150°	804.9	800.3	810.7	814.6	811.4
152.5°	822.4	817.3	827.1	831.0	826.4
155°	839.5	833.7	841.4	845.3	840.2
157.5°	853.2	848.0	853.9	858.4	853.2
160°	865.0	861.0	865.0	868.9	864.2
162.5°	875.4	871.5	874.8	879.3	873.4
165°	884.5	880.7	882.6	887.2	882.6
167.5°	891.7	887.8	889.7	894.4	888.5
170°	897.6	893.7	895.0	899.6	893.7
172.5°	901.5	897.6	898.9	903.5	897.6
175°	904.7	900.2	901.5	906.1	899.6
177.5°	906.1	901.5	902.2	906.8	900.9
180°	902.9	902.9	902.9	902.9	902.9

TEST NUMBER: P922567

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.75	10.56	10.75	11.56	12.88	5.72	6.52	6.71	7.52	8.85
	3H	11.41	12.13	12.42	13.14	14.49	6.88	7.60	7.89	8.61	9.96
	4H	12.00	12.68	13.02	13.70	15.05	7.32	8.00	8.34	9.01	10.37
	6H	12.41	13.03	13.44	14.05	15.42	7.62	8.25	8.65	9.27	10.63
	8H	12.53	13.12	13.56	14.15	15.52	7.71	8.30	8.74	9.33	10.70
	12H	12.58	13.14	13.62	14.17	15.56	7.74	8.30	8.78	9.33	10.72
4H	2H	9.76	10.44	10.79	11.46	12.81	6.30	6.98	7.32	7.99	9.35
	3H	11.57	12.13	12.60	13.17	14.54	7.62	8.19	8.66	9.23	10.60
	4H	12.24	12.76	13.28	13.79	15.19	8.15	8.67	9.19	9.70	11.10
	6H	12.74	13.18	13.79	14.24	15.63	8.55	8.99	9.60	10.05	11.44
	8H	12.90	13.32	13.95	14.37	15.77	8.67	9.08	9.72	10.13	11.54
	12H	12.99	13.36	14.05	14.42	15.83	8.72	9.10	9.79	10.16	11.57
8H	4H	12.21	12.62	13.26	13.67	15.07	8.42	8.83	9.47	9.88	11.29
	6H	12.75	13.09	13.82	14.18	15.58	8.91	9.25	9.99	10.35	11.75
	8H	12.95	13.25	14.03	14.33	15.75	9.09	9.39	10.17	10.47	11.89
	12H	13.08	13.34	14.16	14.41	15.87	9.19	9.46	10.28	10.53	11.99
12H	4H	12.15	12.53	13.22	13.59	15.00	8.42	8.79	9.49	9.86	11.27
	6H	12.72	13.02	13.80	14.10	15.52	8.96	9.26	10.04	10.33	11.75
	8H	12.93	13.19	14.01	14.26	15.72	9.15	9.41	10.24	10.49	11.95

END OF REPORT