

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922589

Luminaire Tested: DFN2DIP-SQ2F0-040D030US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922589
REPORT IS A COMBINATION OF REPORTS P901293 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-040D030US940-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6179.6 lumens
Efficiency: N/A
Efficacy: 109.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 56.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLLONL

Luminous Intensity Polar Plot

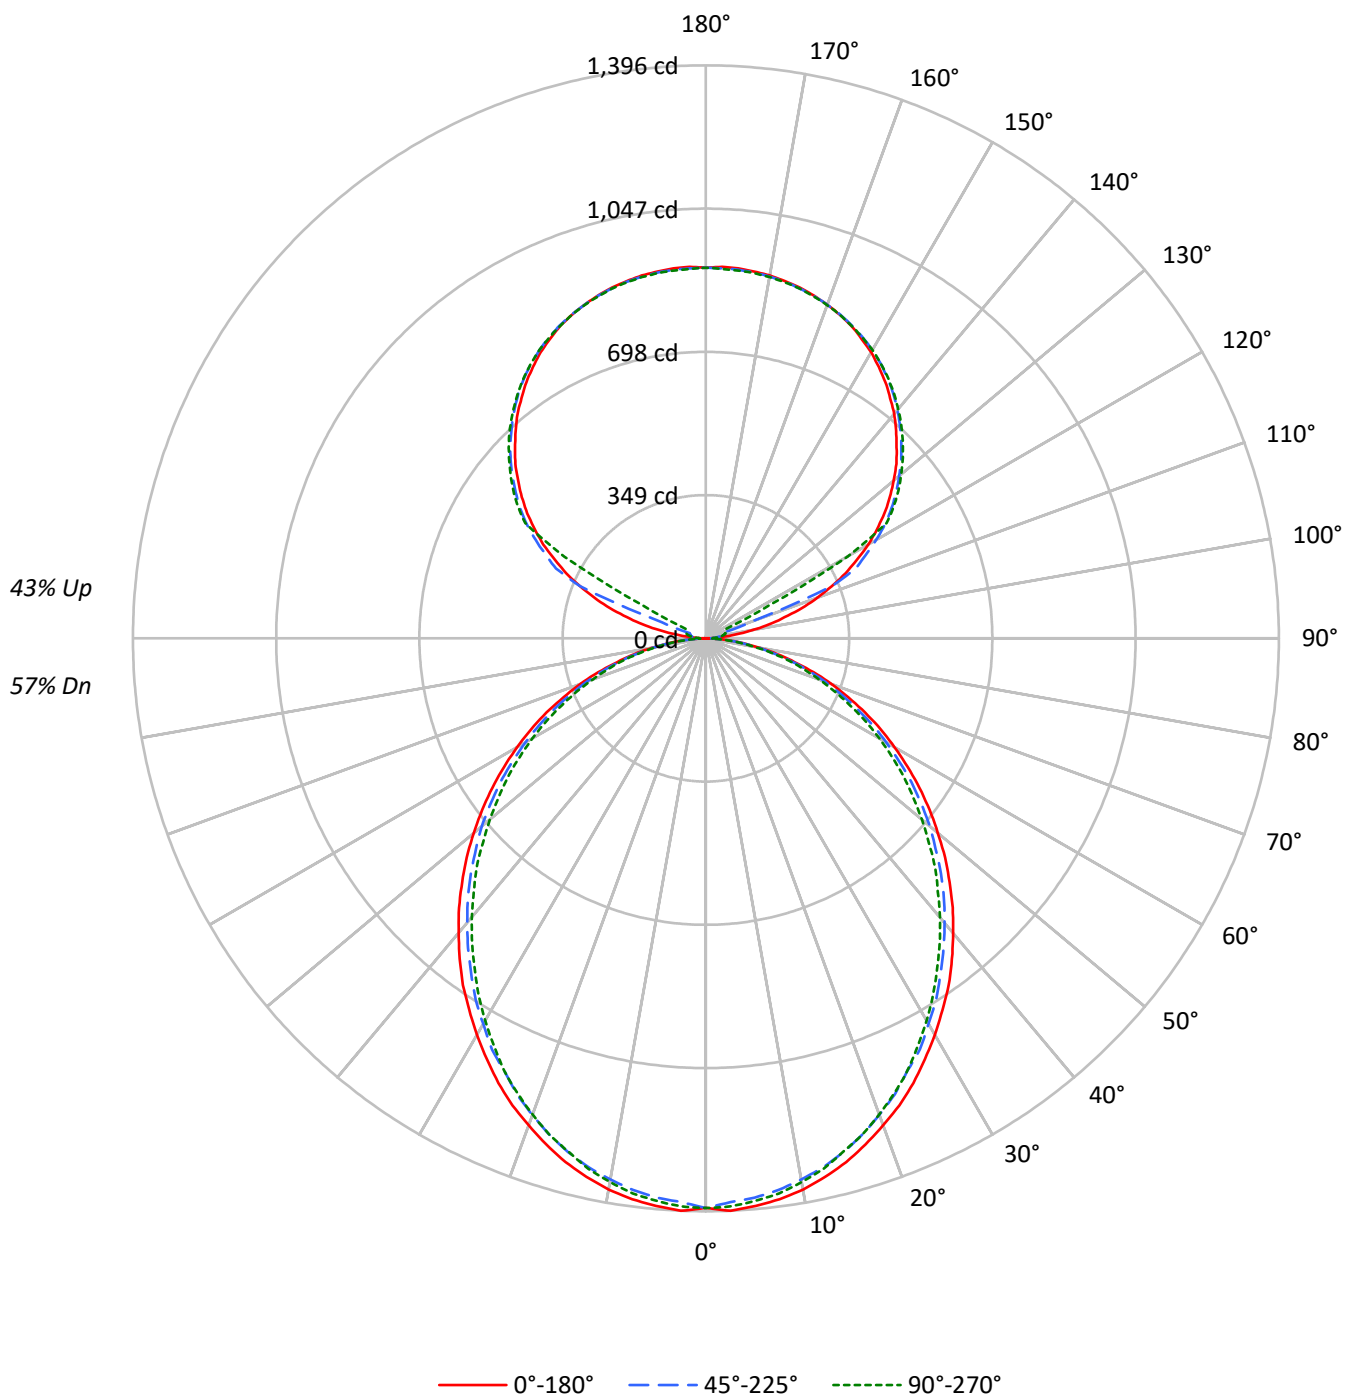

TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	31	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3052	3052	3052
5°	3051	3003	3025
10°	3021	2956	2980
15°	2972	2900	2912
20°	2906	2826	2842
25°	2841	2739	2762
30°	2761	2657	2662
35°	2684	2561	2556
40°	2591	2465	2454
45°	2498	2368	2351
50°	2396	2265	2231
55°	2288	2147	2120
60°	2166	2008	1992
65°	2032	1863	1842
70°	1863	1686	1679
75°	1630	1473	1524
80°	1346	1203	1238
85°	910	760	777

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2498 cd/sqm

TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	2.1
10°-20°	367.5	5.9
20°-30°	540.1	8.7
30°-40°	627.3	10.2
40°-50°	626.6	10.1
50°-60°	546.3	8.8
60°-70°	403.9	6.5
70°-80°	228.5	3.7
80°-90°	61.9	1.0
90°-100°	29.8	0.5
100°-110°	111.0	1.8
110°-120°	294.3	4.8
120°-130°	488.2	7.9
130°-140°	518.5	8.4
140°-150°	481.9	7.8
150°-160°	387.5	6.3
160°-170°	249.7	4.0
170°-180°	85.9	1.4
0°-30°	1038.3	16.8
0°-40°	1665.6	27.0
0°-60°	2838.5	45.9
0°-90°	3532.8	57.2
90°-120°	435.1	7.0
90°-150°	1923.7	31.1
90°-180°	2647.0	42.8
0°-180°	6179.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	8	13	16	18	6
95°	42	21	25	29	28	50
105°	199	218	40	47	50	212
115°	376	387	403	101	54	370
125°	531	540	552	557	559	474
135°	657	668	674	680	679	508
145°	762	762	773	777	774	477
155°	840	834	841	845	840	387
165°	884	881	883	887	883	250
175°	905	900	902	906	900	86
180°	903	903	903	903	903	

TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	0.6	7.8	13.0	16.4	17.6
92.5°	16.4	13.7	15.7	17.0	17.6
95°	42.4	20.9	25.4	28.8	28.1
97.5°	76.4	22.9	33.3	35.3	35.9
100°	115.7	26.1	37.3	42.4	43.8
102.5°	158.7	157.5	38.5	45.7	47.7
105°	198.6	218.2	39.9	47.0	49.7
107.5°	245.0	261.3	41.2	48.3	51.0
110°	289.4	303.1	114.3	49.0	51.6



TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	331.3	343.0	331.9	50.3	52.3
115°	375.6	386.7	403.1	100.6	53.6
117.5°	414.2	427.2	438.4	344.9	173.8
120°	457.3	467.1	478.8	486.7	398.5
122.5°	493.8	504.4	517.5	521.3	522.0
125°	531.1	539.6	552.1	556.6	558.6
127.5°	565.1	574.2	584.1	590.6	591.2
130°	597.1	607.6	614.7	621.9	621.3
132.5°	629.7	638.3	645.4	651.3	650.7
135°	657.2	667.7	673.5	680.1	678.8
137.5°	685.9	693.8	700.3	706.9	704.9
140°	714.0	719.3	726.4	732.3	729.1
142.5°	737.6	742.2	750.6	755.8	752.6
145°	762.4	761.7	772.8	777.4	774.1
147.5°	783.9	781.9	793.1	796.3	793.7
150°	804.9	800.3	810.7	814.6	811.4
152.5°	822.4	817.3	827.1	831.0	826.4
155°	839.5	833.7	841.4	845.3	840.2
157.5°	853.2	848.0	853.9	858.4	853.2
160°	865.0	861.0	865.0	868.9	864.2
162.5°	875.4	871.5	874.8	879.3	873.4
165°	884.5	880.7	882.6	887.2	882.6
167.5°	891.7	887.8	889.7	894.4	888.5
170°	897.6	893.7	895.0	899.6	893.7
172.5°	901.5	897.6	898.9	903.5	897.6
175°	904.7	900.2	901.5	906.1	899.6
177.5°	906.1	901.5	902.2	906.8	900.9
180°	902.9	902.9	902.9	902.9	902.9

TEST NUMBER: P922589

CATALOG NUMBER: DFN2DIP-SQ2F0-040D030US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.67	12.60	12.56	13.51	14.68	11.23	12.15	12.12	13.07	14.23
	3H	13.32	14.15	14.22	15.07	16.26	12.83	13.66	13.73	14.58	15.77
	4H	13.89	14.68	14.81	15.61	16.81	13.40	14.19	14.32	15.12	16.32
	6H	14.28	15.01	15.21	15.94	17.16	13.78	14.51	14.71	15.44	16.66
	8H	14.38	15.07	15.32	16.03	17.24	13.88	14.57	14.82	15.52	16.74
	12H	14.43	15.09	15.37	16.03	17.27	13.92	14.58	14.86	15.52	16.76
4H	2H	12.13	12.92	13.05	13.85	15.05	11.77	12.56	12.70	13.49	14.69
	3H	13.98	14.64	14.91	15.60	16.81	13.57	14.23	14.51	15.19	16.40
	4H	14.68	15.28	15.63	16.23	17.47	14.26	14.86	15.20	15.81	17.05
	6H	15.18	15.70	16.14	16.68	17.91	14.75	15.27	15.71	16.24	17.48
	8H	15.32	15.81	16.28	16.78	18.03	14.88	15.37	15.85	16.34	17.59
	12H	15.39	15.83	16.37	16.81	18.07	14.94	15.38	15.92	16.37	17.62
8H	4H	14.87	15.36	15.83	16.33	17.58	14.49	14.98	15.45	15.95	17.20
	6H	15.48	15.88	16.47	16.89	18.15	15.10	15.50	16.08	16.51	17.76
	8H	15.69	16.04	16.68	17.04	18.31	15.30	15.65	16.29	16.65	17.92
	12H	15.81	16.12	16.81	17.12	18.43	15.40	15.71	16.40	16.71	18.02
12H	4H	14.86	15.29	15.84	16.28	17.54	14.49	14.92	15.47	15.91	17.17
	6H	15.51	15.86	16.50	16.86	18.13	15.13	15.49	16.13	16.49	17.76
	8H	15.74	16.05	16.74	17.04	18.36	15.35	15.67	16.35	16.66	17.98

END OF REPORT