

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922623

Luminaire Tested: DFN2DIP-SQ2F0-050D050US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922623
REPORT IS A COMBINATION OF REPORTS P901320 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US940-RLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8203.8 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLLONL

Luminous Intensity Polar Plot

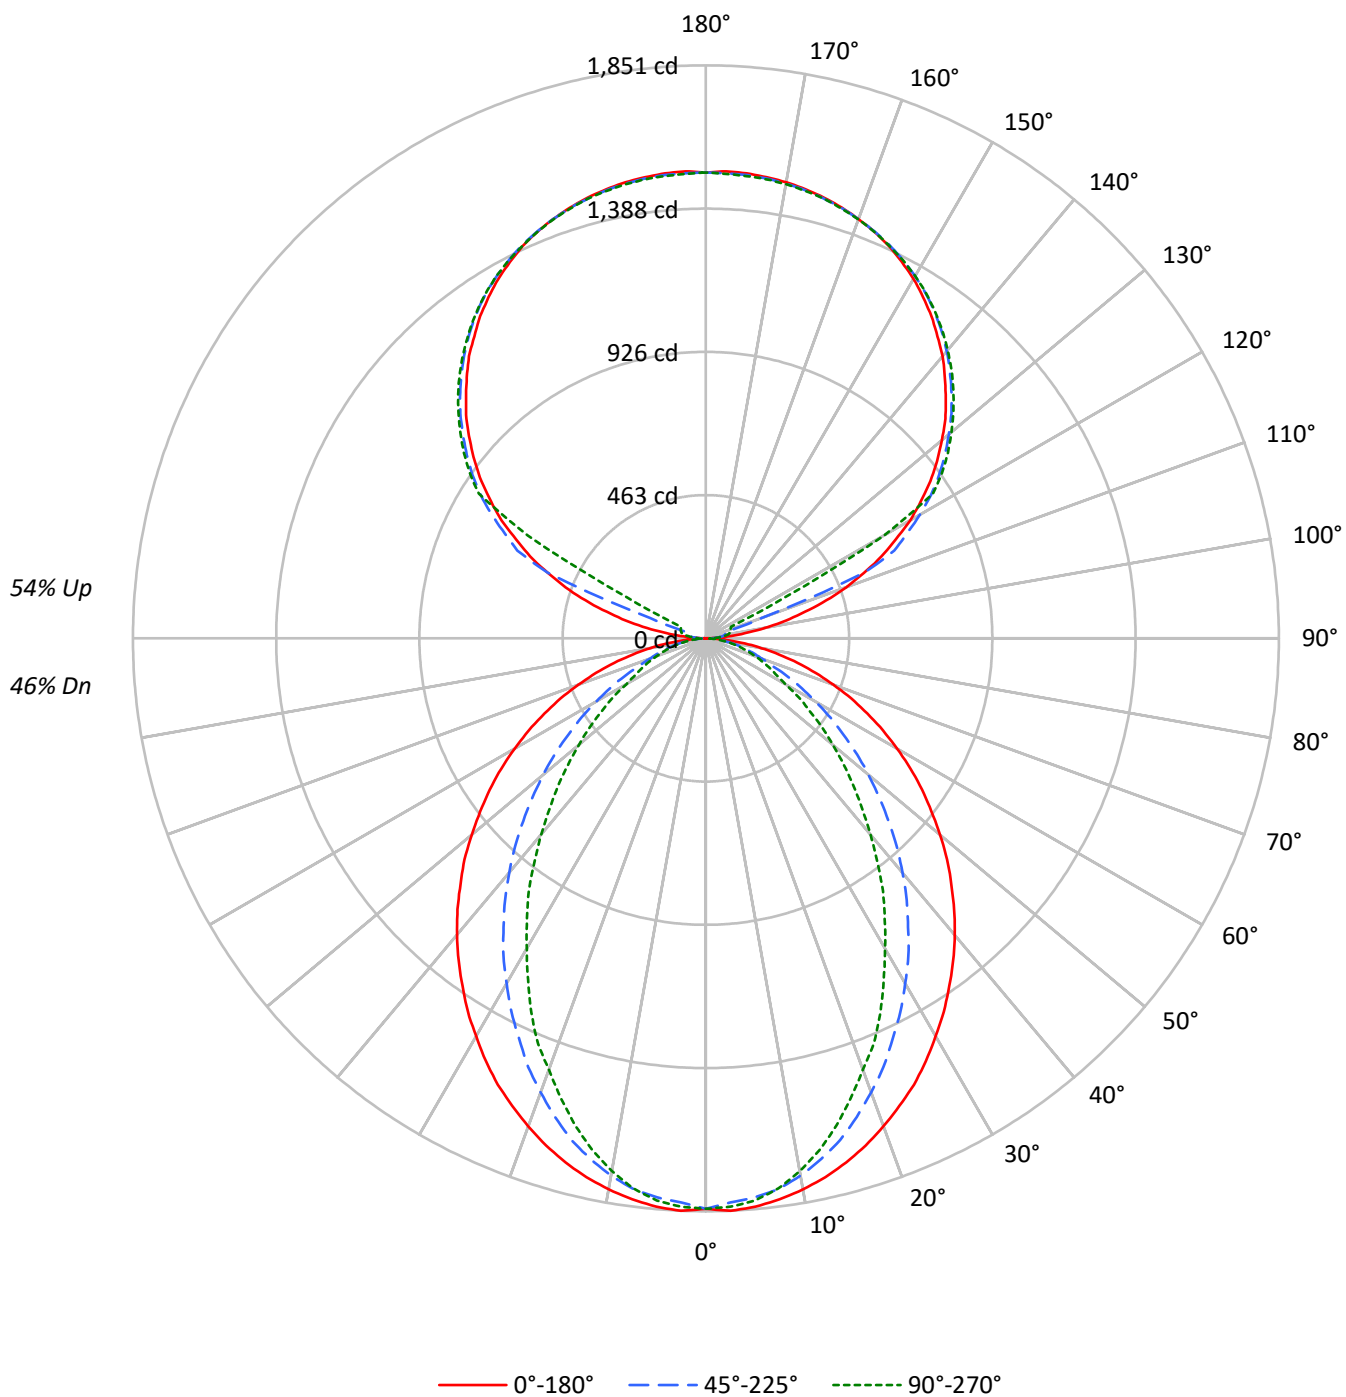

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4052	4052	4052
5°	4051	3979	4007
10°	4004	3892	3871
15°	3942	3755	3665
20°	3862	3569	3413
25°	3780	3363	3170
30°	3673	3152	2864
35°	3567	2927	2595
40°	3459	2694	2288
45°	3334	2437	2009
50°	3205	2179	1738
55°	3069	1904	1478
60°	2911	1617	1211
65°	2729	1328	1084
70°	2508	1058	972
75°	2230	915	873
80°	1831	744	740
85°	1193	462	527

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3334 cd/sqm

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	2.1
10°-20°	474.1	5.8
20°-30°	665.6	8.1
30°-40°	725.6	8.8
40°-50°	666.9	8.1
50°-60°	523.7	6.4
60°-70°	340.9	4.2
70°-80°	175.5	2.1
80°-90°	47.5	0.6
90°-100°	49.6	0.6
100°-110°	185.0	2.3
110°-120°	490.6	6.0
120°-130°	813.6	9.9
130°-140°	864.3	10.5
140°-150°	803.2	9.8
150°-160°	645.8	7.9
160°-170°	416.1	5.1
170°-180°	143.2	1.7
0°-30°	1312.4	16.0
0°-40°	2038.0	24.8
0°-60°	3228.6	39.4
0°-90°	3792.4	46.2
90°-120°	725.2	8.8
90°-150°	3206.2	39.1
90°-180°	4411.0	53.8
0°-180°	8203.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	1	13	22	27	29	8
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P922623

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.53	12.33	12.53	13.33	14.66	7.49	8.29	8.49	9.29	10.62
	3H	13.19	13.90	14.19	14.91	16.26	8.66	9.37	9.67	10.39	11.73
	4H	13.78	14.46	14.80	15.47	16.83	9.09	9.77	10.11	10.79	12.14
	6H	14.18	14.81	15.21	15.83	17.19	9.40	10.02	10.43	11.04	12.41
	8H	14.30	14.89	15.34	15.93	17.29	9.48	10.07	10.51	11.11	12.47
	12H	14.35	14.92	15.39	15.95	17.33	9.51	10.08	10.55	11.11	12.49
4H	2H	11.54	12.22	12.57	13.23	14.59	8.07	8.75	9.10	9.76	11.12
	3H	13.34	13.91	14.38	14.95	16.32	9.40	9.96	10.43	11.00	12.37
	4H	14.02	14.53	15.06	15.57	16.96	9.93	10.44	10.97	11.48	12.87
	6H	14.51	14.96	15.56	16.01	17.40	10.33	10.77	11.38	11.83	13.22
	8H	14.68	15.09	15.73	16.14	17.54	10.45	10.86	11.50	11.91	13.31
	12H	14.76	15.13	15.83	16.20	17.61	10.50	10.87	11.57	11.94	13.34
8H	4H	13.98	14.39	15.03	15.44	16.85	10.20	10.61	11.25	11.66	13.06
	6H	14.52	14.86	15.60	15.96	17.36	10.69	11.03	11.76	12.12	13.52
	8H	14.73	15.03	15.81	16.10	17.52	10.87	11.16	11.95	12.24	13.66
	12H	14.85	15.11	15.94	16.19	17.65	10.97	11.23	12.05	12.30	13.76
12H	4H	13.93	14.30	15.00	15.37	16.78	10.20	10.57	11.26	11.63	13.04
	6H	14.50	14.80	15.58	15.87	17.29	10.73	11.03	11.81	12.11	13.53
	8H	14.70	14.97	15.79	16.04	17.50	10.93	11.19	12.01	12.26	13.72

END OF REPORT