

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922649

Luminaire Tested: DFN2DIP-SQ2F0-060D060US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922649
REPORT IS A COMBINATION OF REPORTS P901333 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-060D060US940-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10593.5 lumens
Efficiency: N/A
Efficacy: 105.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 100.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLLONL

Luminous Intensity Polar Plot

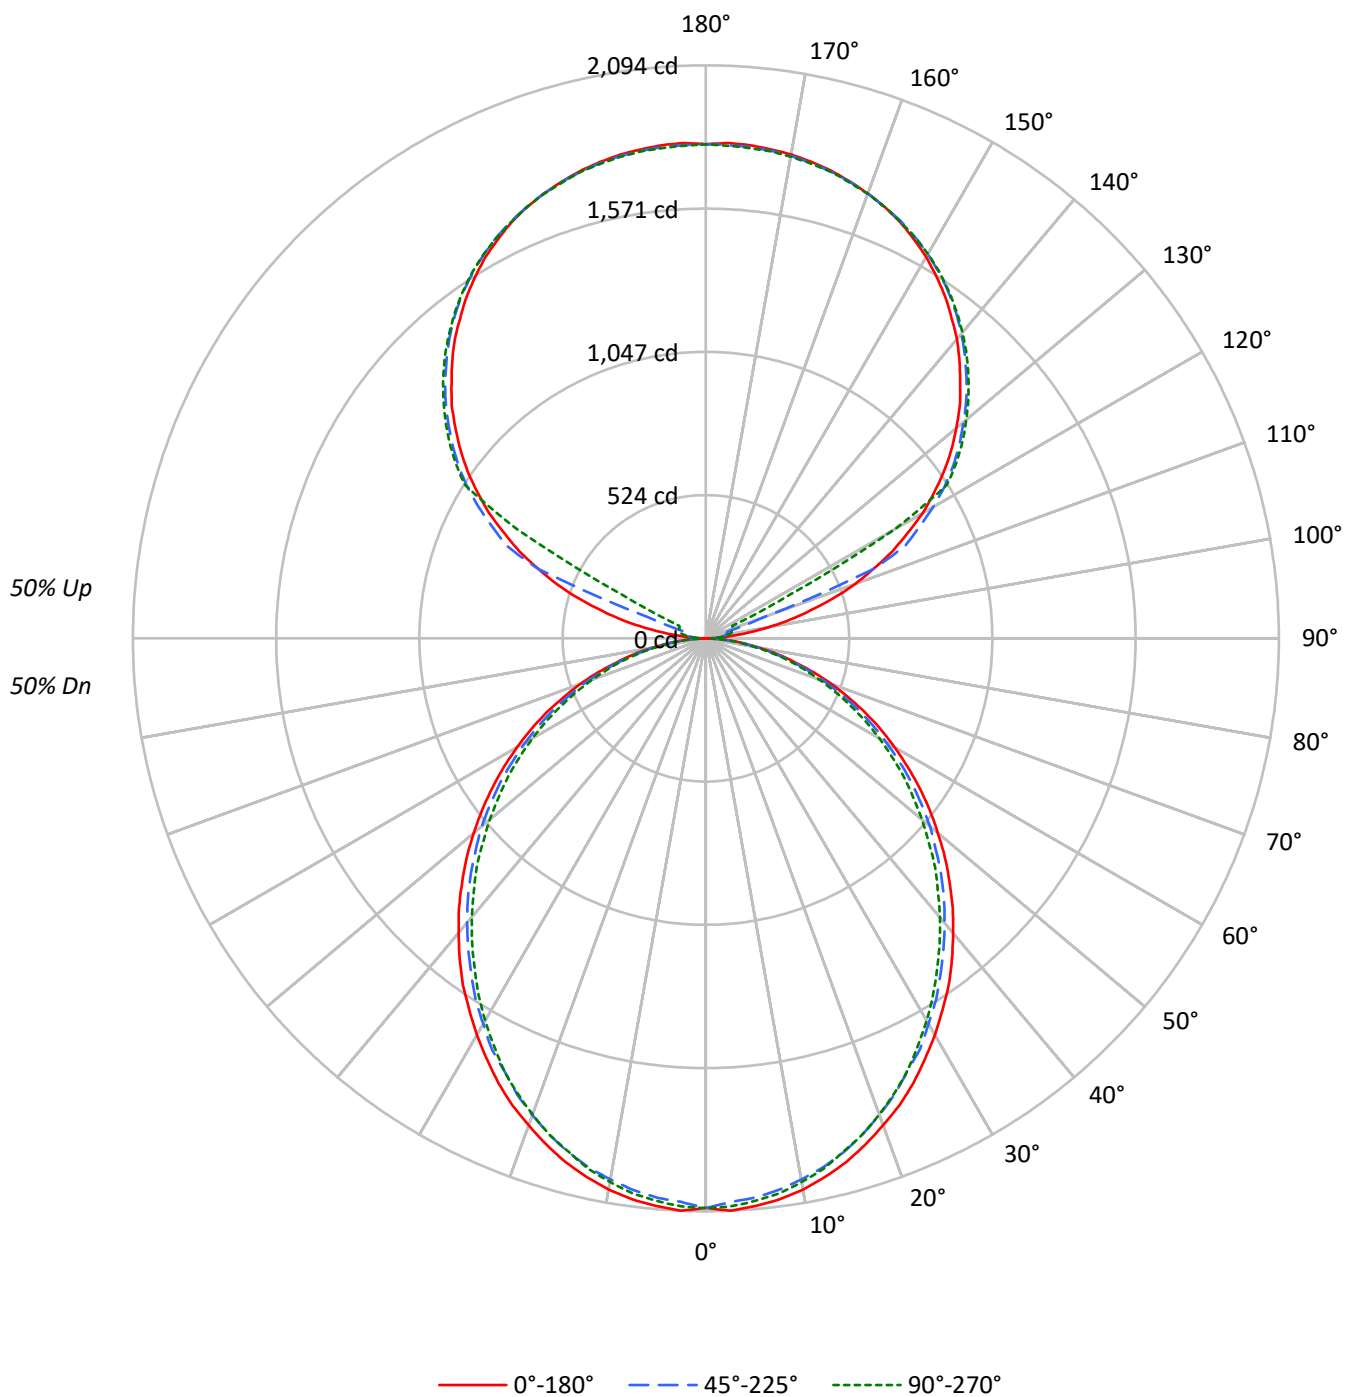

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4578	4578	4578
5°	4577	4504	4538
10°	4532	4433	4470
15°	4457	4350	4368
20°	4359	4239	4263
25°	4262	4108	4143
30°	4142	3985	3993
35°	4027	3842	3834
40°	3886	3697	3682
45°	3747	3551	3526
50°	3593	3398	3346
55°	3432	3221	3179
60°	3249	3012	2988
65°	3048	2794	2763
70°	2794	2529	2519
75°	2444	2210	2285
80°	2019	1804	1856
85°	1362	1139	1166

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3747 cd/sqm

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.8
10°-20°	551.3	5.2
20°-30°	810.2	7.6
30°-40°	941.0	8.9
40°-50°	939.8	8.9
50°-60°	819.5	7.7
60°-70°	605.8	5.7
70°-80°	342.7	3.2
80°-90°	93.6	0.9
90°-100°	59.5	0.6
100°-110°	222.0	2.1
110°-120°	588.7	5.6
120°-130°	976.3	9.2
130°-140°	1037.1	9.8
140°-150°	963.9	9.1
150°-160°	774.9	7.3
160°-170°	499.3	4.7
170°-180°	171.9	1.6
0°-30°	1557.4	14.7
0°-40°	2498.4	23.6
0°-60°	4257.8	40.2
0°-90°	5300.0	50.0
90°-120°	870.2	8.2
90°-150°	3847.4	36.3
90°-180°	5294.0	50.0
0°-180°	10593.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	1	16	26	33	35	10
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P922649

CATALOG NUMBER: DFN2DIP-SQ2F0-060D060US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.45	13.31	13.40	14.28	15.55	12.00	12.86	12.96	13.83	15.11
	3H	14.09	14.86	15.05	15.84	17.13	13.60	14.37	14.56	15.35	16.64
	4H	14.66	15.39	15.64	16.38	17.68	14.17	14.90	15.15	15.88	17.19
	6H	15.05	15.72	16.04	16.71	18.02	14.55	15.22	15.54	16.21	17.52
	8H	15.14	15.78	16.14	16.79	18.10	14.64	15.28	15.64	16.29	17.60
	12H	15.18	15.79	16.19	16.80	18.13	14.68	15.29	15.68	16.29	17.62
4H	2H	12.90	13.63	13.88	14.61	15.91	12.54	13.27	13.53	14.26	15.56
	3H	14.74	15.35	15.74	16.36	17.68	14.33	14.94	15.33	15.96	17.27
	4H	15.44	16.00	16.44	17.00	18.34	15.01	15.57	16.02	16.58	17.92
	6H	15.93	16.41	16.95	17.45	18.78	15.50	15.98	16.52	17.01	18.35
	8H	16.07	16.52	17.09	17.55	18.90	15.64	16.09	16.66	17.11	18.46
	12H	16.14	16.54	17.17	17.58	18.94	15.69	16.10	16.73	17.13	18.49
8H	4H	15.62	16.07	16.64	17.10	18.45	15.24	15.69	16.26	16.72	18.07
	6H	16.23	16.60	17.27	17.67	19.02	15.84	16.22	16.89	17.28	18.63
	8H	16.44	16.76	17.49	17.82	19.18	16.04	16.37	17.09	17.42	18.79
	12H	16.56	16.84	17.61	17.89	19.30	16.15	16.43	17.20	17.48	18.89
12H	4H	15.61	16.01	16.64	17.05	18.41	15.24	15.64	16.27	16.68	18.04
	6H	16.25	16.58	17.30	17.63	19.00	15.88	16.21	16.93	17.26	18.63
	8H	16.48	16.77	17.54	17.81	19.23	16.10	16.39	17.15	17.43	18.84