

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925292

Luminaire Tested: DFN2DIP-SQ2F0-030D030US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925292
REPORT IS A COMBINATION OF REPORTS P899771 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-030D030US950-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5366.2 lumens
Efficiency: N/A
Efficacy: 117.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 45.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFLL

Luminous Intensity Polar Plot

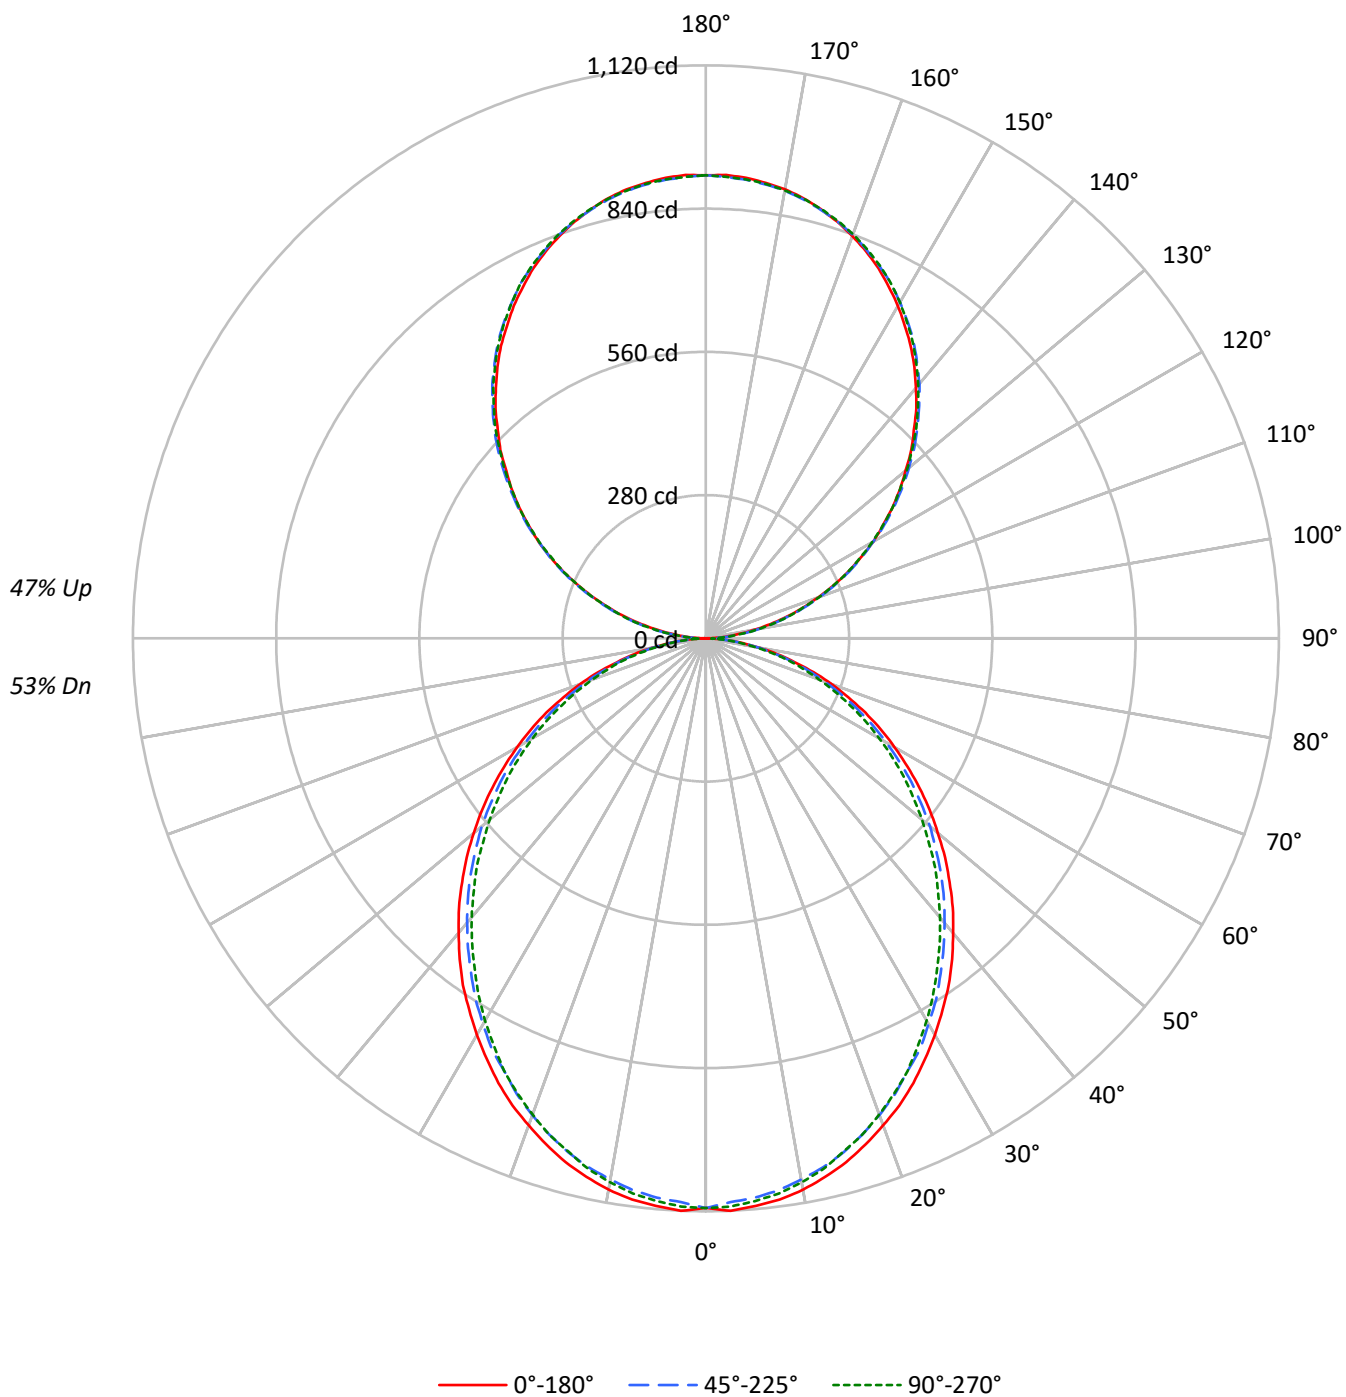

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2449	2449	2449
5°	2448	2409	2427
10°	2424	2372	2391
15°	2384	2327	2336
20°	2332	2268	2280
25°	2280	2197	2216
30°	2215	2132	2136
35°	2154	2055	2051
40°	2079	1978	1970
45°	2004	1900	1886
50°	1922	1818	1790
55°	1836	1723	1701
60°	1738	1611	1599
65°	1631	1494	1478
70°	1494	1353	1347
75°	1307	1183	1223
80°	1079	965	993
85°	730	609	624

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2004 cd/sqm

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	104.8	2.0
10°-20°	294.9	5.5
20°-30°	433.4	8.1
30°-40°	503.4	9.4
40°-50°	502.7	9.4
50°-60°	438.4	8.2
60°-70°	324.1	6.0
70°-80°	183.3	3.4
80°-90°	50.9	0.9
90°-100°	56.0	1.0
100°-110°	178.0	3.3
110°-120°	304.6	5.7
120°-130°	400.5	7.5
130°-140°	449.6	8.4
140°-150°	440.9	8.2
150°-160°	369.8	6.9
160°-170°	245.3	4.6
170°-180°	85.7	1.6
0°-30°	833.1	15.5
0°-40°	1336.5	24.9
0°-60°	2277.6	42.4
0°-90°	2836.0	52.8
90°-120°	538.5	10.0
90°-150°	1829.5	34.1
90°-180°	2530.0	47.1
0°-180°	5366.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1114	1114	1114	1114	1114	
5°	1114	1109	1098	1106	1104	106
15°	1060	1054	1040	1044	1039	299
25°	959	951	933	935	933	441
35°	828	817	800	793	788	517
45°	674	666	650	638	634	520
55°	510	503	490	478	472	456
65°	344	337	327	317	312	340
75°	180	178	172	166	168	192
85°	44	43	42	38	38	49
90°	1	10	27	25	26	5
95°	40	48	49	49	48	44
105°	164	166	168	169	169	173
115°	306	310	309	308	306	302
125°	445	451	449	447	446	397
135°	575	583	585	584	582	444
145°	698	704	708	709	706	436
155°	798	800	803	807	804	367
165°	868	868	868	873	869	245
175°	904	901	900	905	900	86
180°	905	905	905	905	905	

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1113.6	1113.6	1113.6	1113.6	1113.6
2.5°	1120.1	1114.7	1102.9	1113.6	1111.6
5°	1113.6	1109.4	1097.6	1106.2	1104.1
7.5°	1106.2	1099.8	1087.9	1096.6	1094.4
10°	1094.4	1086.9	1074.1	1082.6	1079.5
12.5°	1078.3	1071.9	1059.1	1064.4	1062.3
15°	1060.1	1053.8	1039.8	1044.1	1038.7
17.5°	1037.6	1031.3	1017.3	1022.6	1017.3
20°	1013.0	1006.6	991.6	994.7	990.5
22.5°	988.4	978.8	964.8	964.8	962.6
25°	959.4	950.9	932.7	934.8	932.7
27.5°	927.3	919.8	905.9	902.8	897.4
30°	895.2	886.6	870.6	867.4	863.1
32.5°	861.0	854.6	837.4	830.9	826.6
35°	827.8	817.1	799.9	793.4	788.1
37.5°	790.3	780.7	763.5	755.9	750.6
40°	751.8	743.2	726.0	716.5	712.2
42.5°	714.3	705.7	688.6	677.8	671.4
45°	673.6	666.1	650.0	638.2	633.9
47.5°	633.9	626.5	609.3	597.5	591.1
50°	592.1	586.8	571.8	556.8	551.5
52.5°	551.5	544.0	530.1	518.3	510.8
55°	509.8	503.3	490.5	477.7	472.3
57.5°	467.9	462.6	448.7	435.8	431.5
60°	426.2	422.0	407.0	395.1	392.0
62.5°	385.5	378.0	367.3	356.6	352.3
65°	343.8	337.3	326.6	317.0	311.7
67.5°	301.0	295.5	285.9	278.5	274.2
70°	261.3	257.0	247.4	239.8	235.6
72.5°	220.7	216.3	210.9	203.5	200.3
75°	179.8	177.8	172.4	166.0	168.2
77.5°	143.5	139.2	137.0	133.8	130.7
80°	107.1	106.0	103.8	100.6	98.5
82.5°	72.8	72.8	71.8	67.4	67.4
85°	43.9	42.8	41.8	38.5	37.5
87.5°	19.3	17.2	15.0	11.8	10.7
90°	0.9	9.8	26.7	25.1	25.9
92.5°	16.9	22.9	23.8	24.5	24.5
95°	39.9	47.5	48.8	48.8	47.5
97.5°	66.3	73.4	76.4	76.4	76.4
100°	96.8	103.1	105.3	105.3	104.6
102.5°	129.1	133.8	136.7	137.6	136.7
105°	164.3	166.5	168.1	169.4	169.4
107.5°	199.2	202.4	202.4	203.0	199.2
110°	233.1	237.5	237.5	237.5	235.3

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	269.6	274.3	273.4	271.2	269.6
115°	305.7	310.0	308.6	307.9	305.7
117.5°	341.3	347.4	343.5	341.3	339.1
120°	377.4	383.4	377.4	377.4	374.9
122.5°	410.1	417.8	413.9	411.7	410.1
125°	444.6	451.3	449.1	446.7	445.9
127.5°	478.0	486.5	483.6	480.2	478.0
130°	509.4	519.3	517.9	516.3	513.3
132.5°	544.6	552.3	552.8	549.0	546.8
135°	575.0	583.4	585.1	584.2	582.0
137.5°	608.7	615.6	617.0	616.5	613.1
140°	638.5	645.4	649.2	649.2	646.1
142.5°	669.1	675.9	678.1	679.0	675.9
145°	698.0	703.5	707.9	708.6	705.7
147.5°	724.0	730.8	734.0	735.4	732.4
150°	750.7	755.4	758.3	760.8	758.3
152.5°	774.5	779.0	782.9	785.9	782.9
155°	798.2	800.3	802.8	806.6	804.2
157.5°	818.6	820.2	821.7	827.1	823.3
160°	836.9	838.6	839.4	844.0	840.8
162.5°	853.8	853.8	854.7	859.8	856.0
165°	868.3	867.5	867.5	872.9	869.1
167.5°	881.4	878.9	878.9	884.4	880.5
170°	891.2	889.0	888.3	893.7	889.0
172.5°	898.0	895.9	895.0	900.5	895.9
175°	903.5	901.3	899.7	905.2	900.5
177.5°	906.5	904.3	902.7	907.3	902.7
180°	905.2	905.2	905.2	905.2	905.2

TEST NUMBER: P925292

CATALOG NUMBER: DFN2DIP-SQ2F0-030D030US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.53	11.41	11.46	12.36	13.59	10.08	10.97	11.01	11.92	13.15
	3H	12.17	12.97	13.11	13.92	15.18	11.68	12.48	12.62	13.43	14.69
	4H	12.75	13.50	13.70	14.46	15.72	12.25	13.01	13.21	13.97	15.23
	6H	13.13	13.83	14.10	14.79	16.07	12.63	13.33	13.60	14.30	15.57
	8H	13.23	13.89	14.21	14.88	16.15	12.73	13.39	13.70	14.38	15.65
	12H	13.27	13.90	14.25	14.88	16.18	12.76	13.39	13.74	14.37	15.67
4H	2H	10.98	11.73	11.94	12.70	13.96	10.62	11.38	11.59	12.34	13.60
	3H	12.83	13.45	13.80	14.45	15.72	12.42	13.05	13.39	14.04	15.32
	4H	13.53	14.10	14.51	15.09	16.39	13.10	13.68	14.08	14.66	15.96
	6H	14.02	14.52	15.02	15.53	16.83	13.59	14.09	14.59	15.10	16.40
	8H	14.16	14.63	15.16	15.63	16.94	13.73	14.19	14.72	15.19	16.51
	12H	14.23	14.65	15.24	15.67	16.99	13.78	14.20	14.80	15.22	16.54
8H	4H	13.71	14.18	14.71	15.18	16.49	13.33	13.80	14.33	14.80	16.11
	6H	14.32	14.70	15.34	15.75	17.06	13.94	14.32	14.96	15.36	16.67
	8H	14.53	14.87	15.56	15.90	17.23	14.13	14.47	15.16	15.50	16.83
	12H	14.65	14.95	15.68	15.97	17.35	14.24	14.53	15.27	15.56	16.93
12H	4H	13.70	14.11	14.71	15.13	16.45	13.33	13.74	14.34	14.76	16.08
	6H	14.35	14.68	15.38	15.72	17.05	13.97	14.31	15.00	15.34	16.67
	8H	14.57	14.87	15.61	15.90	17.27	14.19	14.49	15.22	15.52	16.89

END OF REPORT