

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925348

Luminaire Tested: DFN2DIP-SQ2F0-050D050US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925348
REPORT IS A COMBINATION OF REPORTS P899799 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US950-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8943.7 lumens
Efficiency: N/A
Efficacy: 109.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFLL

Luminous Intensity Polar Plot

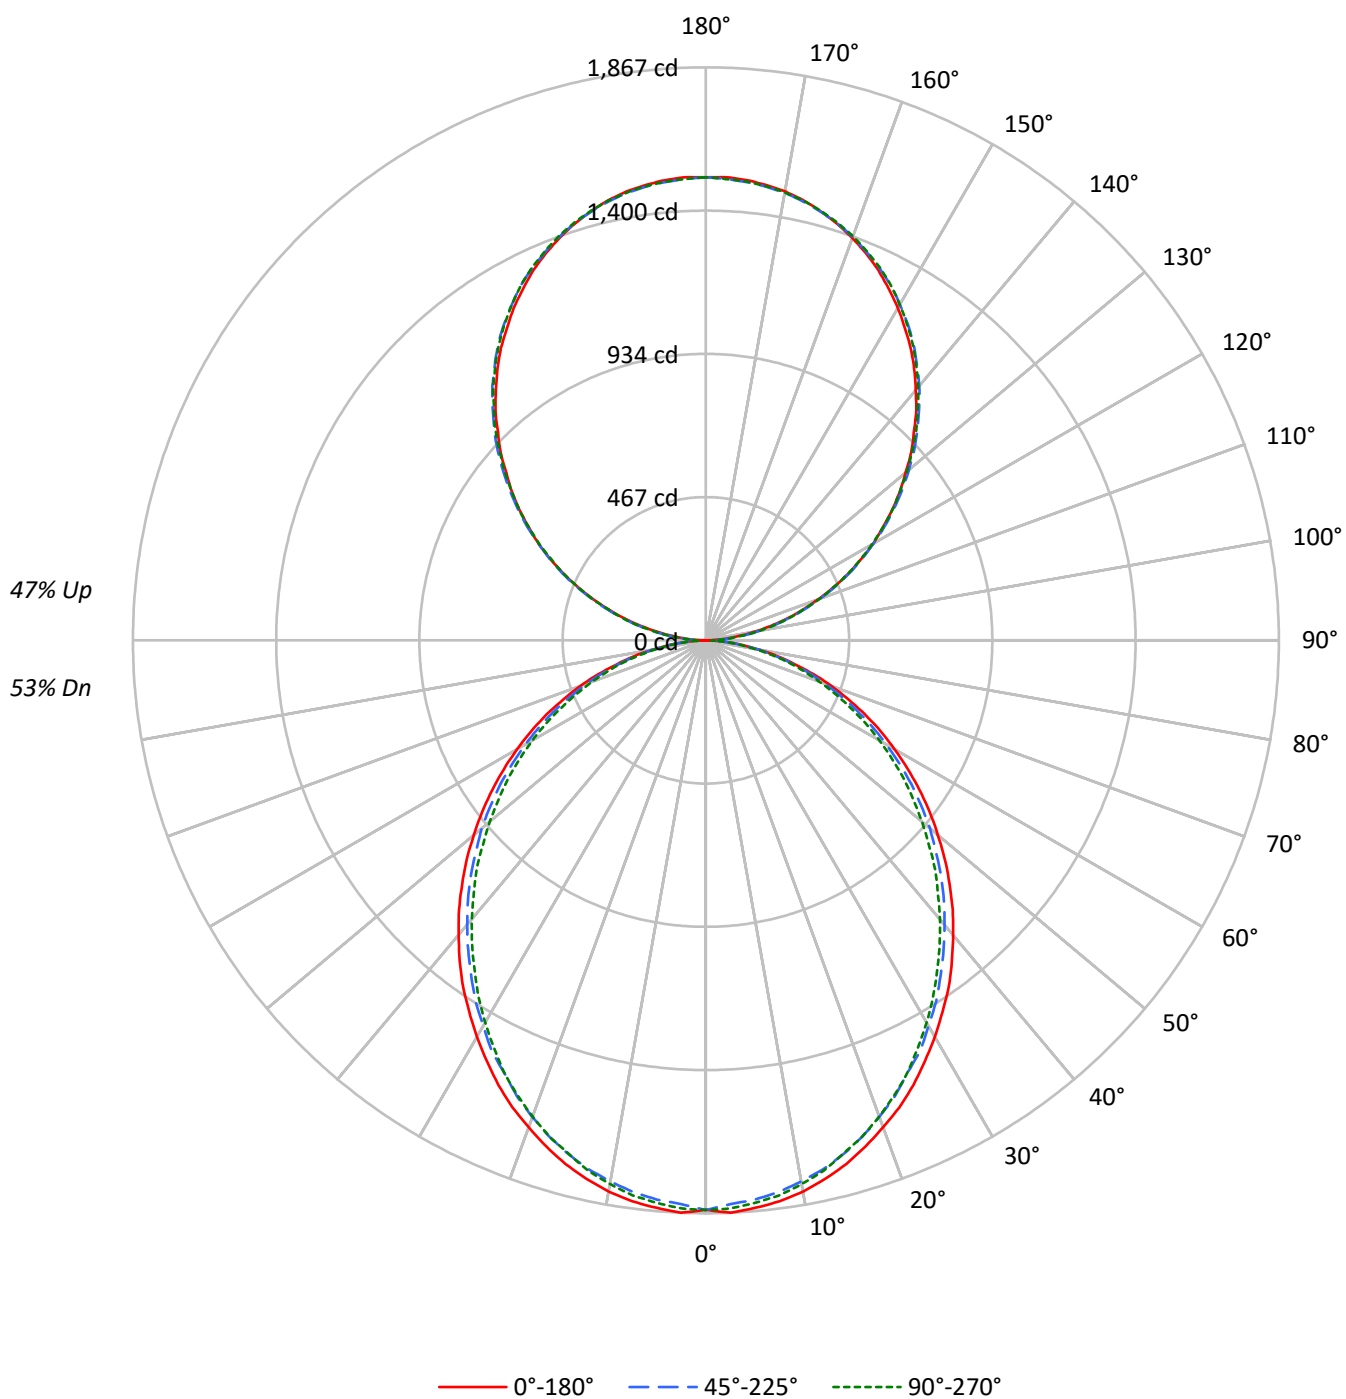

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4081	4081	4081
5°	4081	4015	4046
10°	4040	3953	3985
15°	3974	3878	3894
20°	3887	3779	3801
25°	3800	3662	3694
30°	3692	3553	3560
35°	3590	3425	3418
40°	3465	3296	3282
45°	3340	3166	3144
50°	3203	3029	2983
55°	3060	2871	2835
60°	2897	2686	2664
65°	2718	2491	2464
70°	2491	2254	2246
75°	2179	1970	2038
80°	1800	1609	1655
85°	1216	1015	1040

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3340 cd/sqm

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.7	2.0
10°-20°	491.5	5.5
20°-30°	722.3	8.1
30°-40°	838.9	9.4
40°-50°	837.9	9.4
50°-60°	730.6	8.2
60°-70°	540.1	6.0
70°-80°	305.6	3.4
80°-90°	84.9	0.9
90°-100°	93.4	1.0
100°-110°	296.6	3.3
110°-120°	507.6	5.7
120°-130°	667.5	7.5
130°-140°	749.3	8.4
140°-150°	734.8	8.2
150°-160°	616.4	6.9
160°-170°	408.8	4.6
170°-180°	142.9	1.6
0°-30°	1388.5	15.5
0°-40°	2227.5	24.9
0°-60°	3796.0	42.4
0°-90°	4726.6	52.8
90°-120°	897.5	10.0
90°-150°	3049.2	34.1
90°-180°	4217.0	47.2
0°-180°	8943.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1856	1856	1856	1856	1856	
5°	1856	1849	1829	1844	1840	176
15°	1767	1756	1733	1740	1731	498
25°	1599	1585	1554	1558	1554	736
35°	1380	1362	1333	1322	1314	862
45°	1123	1110	1083	1064	1057	866
55°	850	839	817	796	787	760
65°	573	562	544	528	519	567
75°	300	296	287	277	280	320
85°	73	71	70	64	62	82
90°	1	16	45	42	43	9
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1856.0	1856.0	1856.0	1856.0	1856.0
2.5°	1866.8	1857.9	1838.3	1856.0	1852.7
5°	1856.0	1849.0	1829.3	1843.5	1840.2
7.5°	1843.5	1832.9	1813.3	1827.7	1824.0
10°	1824.0	1811.6	1790.2	1804.3	1799.1
12.5°	1797.1	1786.6	1765.2	1774.1	1770.4
15°	1766.8	1756.2	1732.9	1740.2	1731.2
17.5°	1729.3	1718.7	1695.4	1704.3	1695.4
20°	1688.3	1677.7	1652.7	1658.0	1651.0
22.5°	1647.4	1631.2	1608.0	1608.0	1604.3
25°	1599.1	1584.9	1554.5	1558.0	1554.5
27.5°	1545.5	1533.0	1509.9	1504.6	1495.7
30°	1492.1	1477.7	1451.0	1445.7	1438.5
32.5°	1434.9	1424.3	1395.7	1384.9	1377.8
35°	1379.6	1361.8	1333.2	1322.4	1313.6
37.5°	1317.1	1301.1	1272.4	1259.9	1251.1
40°	1253.0	1238.6	1210.0	1194.0	1186.9
42.5°	1190.5	1176.1	1147.7	1129.6	1119.0
45°	1122.7	1110.2	1083.3	1063.8	1056.6
47.5°	1056.6	1044.1	1015.5	995.8	985.2
50°	986.9	978.0	953.0	928.1	919.1
52.5°	919.1	906.6	883.5	863.8	851.3
55°	849.6	838.9	817.4	796.0	787.1
57.5°	779.9	771.0	747.7	726.4	719.1
60°	710.3	703.3	678.3	658.5	653.3
62.5°	642.5	630.0	612.2	594.3	587.2
65°	573.0	562.2	544.4	528.3	519.4
67.5°	501.6	492.6	476.6	464.1	456.9
70°	435.5	428.3	412.2	399.7	392.8
72.5°	367.8	360.5	351.6	339.1	333.8
75°	299.7	296.3	287.2	276.7	280.3
77.5°	239.2	231.9	228.4	223.0	217.8
80°	178.6	176.7	173.1	167.8	164.2
82.5°	121.3	121.3	119.6	112.5	112.5
85°	73.1	71.4	69.6	64.2	62.5
87.5°	32.1	28.6	25.0	19.7	17.8
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P925348

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.30	13.19	13.23	14.14	15.37	11.86	12.74	12.79	13.69	14.92
	3H	13.94	14.74	14.89	15.70	16.95	13.45	14.25	14.40	15.21	16.46
	4H	14.52	15.27	15.48	16.24	17.50	14.03	14.78	14.98	15.74	17.01
	6H	14.91	15.60	15.88	16.57	17.84	14.41	15.10	15.38	16.07	17.35
	8H	15.00	15.67	15.98	16.65	17.92	14.50	15.16	15.48	16.15	17.42
	12H	15.05	15.68	16.03	16.66	17.95	14.54	15.17	15.52	16.15	17.45
4H	2H	12.75	13.51	13.72	14.47	15.73	12.40	13.15	13.36	14.12	15.38
	3H	14.60	15.23	15.57	16.22	17.50	14.19	14.82	15.17	15.81	17.09
	4H	15.30	15.87	16.28	16.86	18.16	14.88	15.45	15.86	16.44	17.74
	6H	15.80	16.29	16.79	17.30	18.60	15.37	15.86	16.36	16.87	18.17
	8H	15.94	16.40	16.93	17.41	18.72	15.50	15.96	16.50	16.97	18.28
	12H	16.00	16.42	17.02	17.44	18.76	15.56	15.97	16.57	16.99	18.31
8H	4H	15.49	15.95	16.48	16.95	18.27	15.11	15.57	16.11	16.58	17.89
	6H	16.10	16.48	17.12	17.52	18.83	15.71	16.09	16.73	17.14	18.45
	8H	16.30	16.64	17.33	17.67	19.00	15.91	16.25	16.94	17.28	18.61
	12H	16.42	16.72	17.46	17.75	19.12	16.01	16.31	17.05	17.34	18.71
12H	4H	15.47	15.89	16.49	16.91	18.23	15.10	15.52	16.12	16.54	17.86
	6H	16.12	16.46	17.15	17.49	18.82	15.75	16.09	16.78	17.12	18.45
	8H	16.35	16.65	17.38	17.67	19.05	15.97	16.26	17.00	17.29	18.66