

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925349

Luminaire Tested: DFN2DIP-SQ2F0-050D050US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925349
REPORT IS A COMBINATION OF REPORTS P901319 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US950-FLLONL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9444.6 lumens
Efficiency: N/A
Efficacy: 115.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

Luminous Intensity Polar Plot

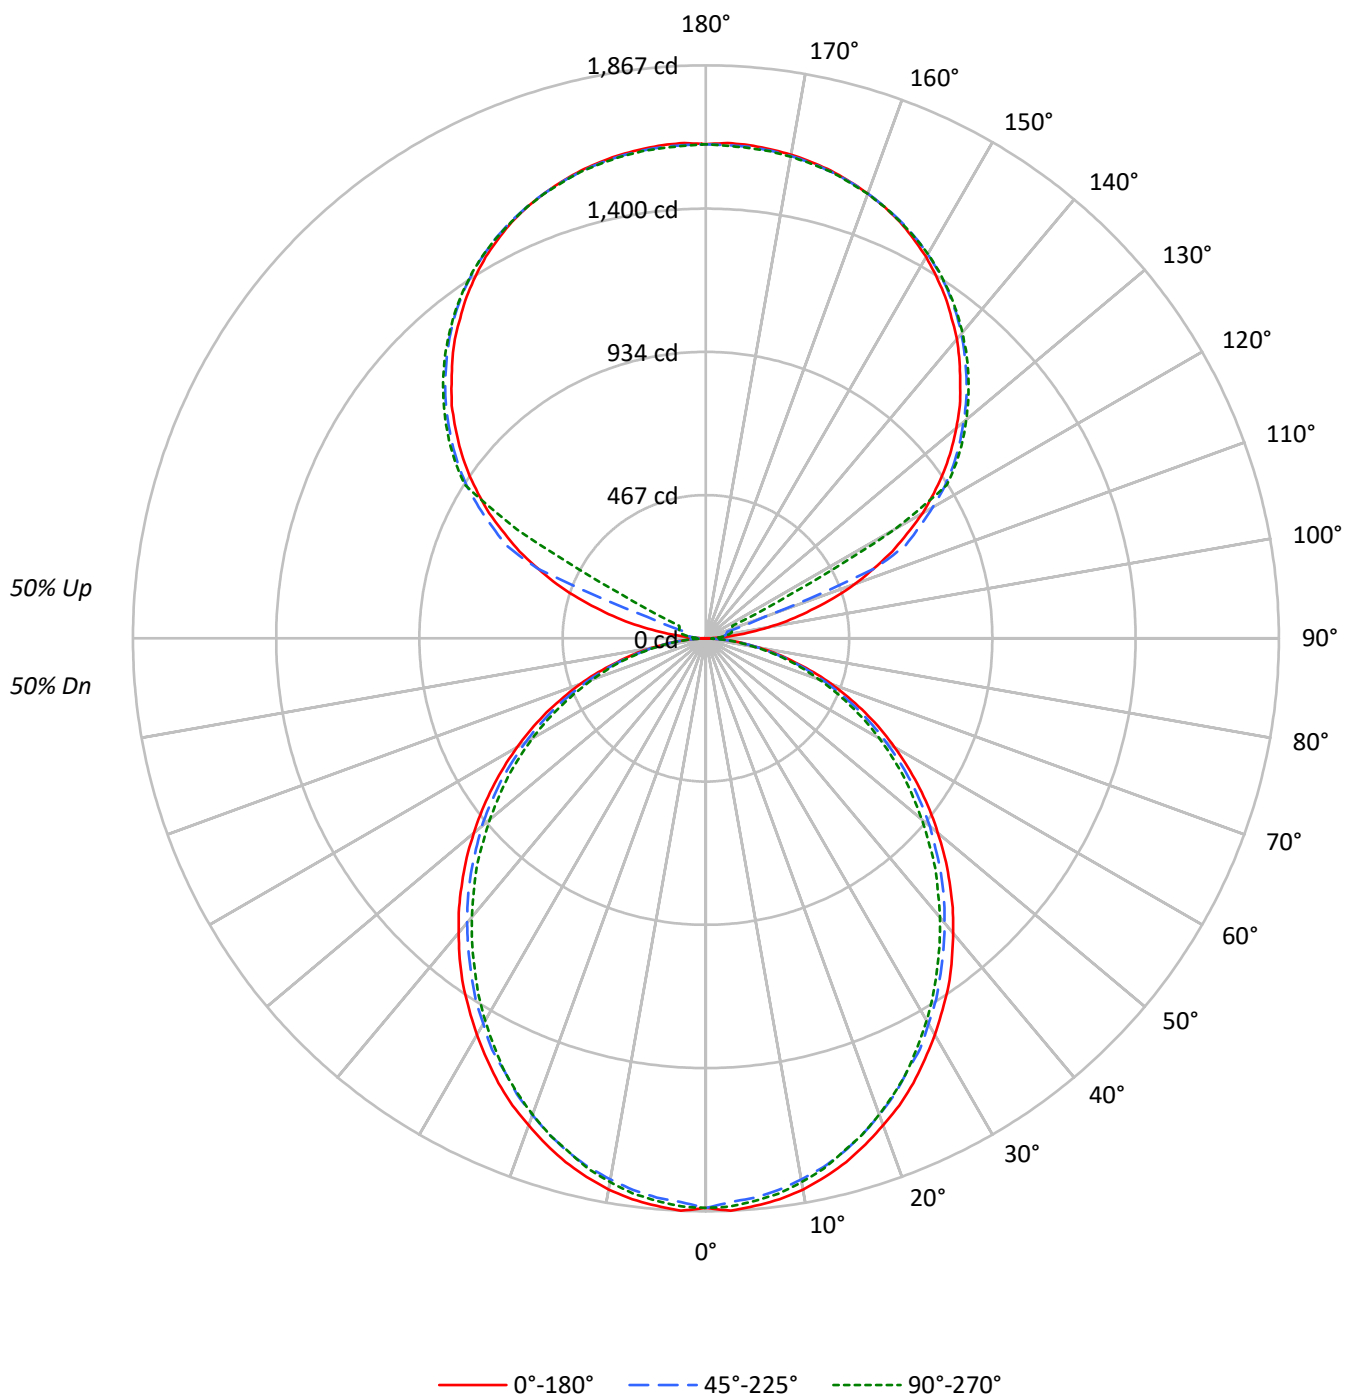

TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4081	4081	4081
5°	4081	4015	4046
10°	4040	3953	3985
15°	3974	3878	3894
20°	3887	3779	3801
25°	3800	3662	3694
30°	3692	3553	3560
35°	3590	3425	3418
40°	3465	3296	3282
45°	3340	3166	3144
50°	3203	3029	2983
55°	3060	2871	2835
60°	2897	2686	2664
65°	2718	2491	2464
70°	2491	2254	2246
75°	2179	1970	2038
80°	1800	1609	1655
85°	1216	1015	1040

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3340 cd/sqm

TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.7	1.8
10°-20°	491.5	5.2
20°-30°	722.3	7.6
30°-40°	838.9	8.9
40°-50°	837.9	8.9
50°-60°	730.6	7.7
60°-70°	540.1	5.7
70°-80°	305.6	3.2
80°-90°	83.5	0.9
90°-100°	53.1	0.6
100°-110°	197.9	2.1
110°-120°	524.8	5.6
120°-130°	870.4	9.2
130°-140°	924.6	9.8
140°-150°	859.3	9.1
150°-160°	690.9	7.3
160°-170°	445.2	4.7
170°-180°	153.2	1.6
0°-30°	1388.5	14.7
0°-40°	2227.5	23.6
0°-60°	3796.0	40.2
0°-90°	4725.1	50.0
90°-120°	775.8	8.2
90°-150°	3430.2	36.3
90°-180°	4719.0	50.0
0°-180°	9444.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1856	1856	1856	1856	1856	
5°	1856	1849	1829	1844	1840	176
15°	1767	1756	1733	1740	1731	498
25°	1599	1585	1554	1558	1554	736
35°	1380	1362	1333	1322	1314	862
45°	1123	1110	1083	1064	1057	866
55°	850	839	817	796	787	760
65°	573	562	544	528	519	567
75°	300	296	287	277	280	320
85°	73	71	70	64	62	82
90°	1	14	23	29	31	9
95°	76	37	45	51	50	90
105°	354	389	71	84	88	378
115°	670	690	719	179	96	659
125°	947	962	984	992	996	845
135°	1172	1191	1201	1213	1210	905
145°	1359	1358	1378	1386	1380	850
155°	1497	1486	1500	1507	1498	690
165°	1577	1570	1574	1582	1574	446
175°	1613	1605	1608	1616	1604	154
180°	1610	1610	1610	1610	1610	



TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1856.0	1856.0	1856.0	1856.0	1856.0
2.5°	1866.8	1857.9	1838.3	1856.0	1852.7
5°	1856.0	1849.0	1829.3	1843.5	1840.2
7.5°	1843.5	1832.9	1813.3	1827.7	1824.0
10°	1824.0	1811.6	1790.2	1804.3	1799.1
12.5°	1797.1	1786.6	1765.2	1774.1	1770.4
15°	1766.8	1756.2	1732.9	1740.2	1731.2
17.5°	1729.3	1718.7	1695.4	1704.3	1695.4
20°	1688.3	1677.7	1652.7	1658.0	1651.0
22.5°	1647.4	1631.2	1608.0	1608.0	1604.3
25°	1599.1	1584.9	1554.5	1558.0	1554.5
27.5°	1545.5	1533.0	1509.9	1504.6	1495.7
30°	1492.1	1477.7	1451.0	1445.7	1438.5
32.5°	1434.9	1424.3	1395.7	1384.9	1377.8
35°	1379.6	1361.8	1333.2	1322.4	1313.6
37.5°	1317.1	1301.1	1272.4	1259.9	1251.1
40°	1253.0	1238.6	1210.0	1194.0	1186.9
42.5°	1190.5	1176.1	1147.7	1129.6	1119.0
45°	1122.7	1110.2	1083.3	1063.8	1056.6
47.5°	1056.6	1044.1	1015.5	995.8	985.2
50°	986.9	978.0	953.0	928.1	919.1
52.5°	919.1	906.6	883.5	863.8	851.3
55°	849.6	838.9	817.4	796.0	787.1
57.5°	779.9	771.0	747.7	726.4	719.1
60°	710.3	703.3	678.3	658.5	653.3
62.5°	642.5	630.0	612.2	594.3	587.2
65°	573.0	562.2	544.4	528.3	519.4
67.5°	501.6	492.6	476.6	464.1	456.9
70°	435.5	428.3	412.2	399.7	392.8
72.5°	367.8	360.5	351.6	339.1	333.8
75°	299.7	296.3	287.2	276.7	280.3
77.5°	239.2	231.9	228.4	223.0	217.8
80°	178.6	176.7	173.1	167.8	164.2
82.5°	121.3	121.3	119.6	112.5	112.5
85°	73.1	71.4	69.6	64.2	62.5
87.5°	32.1	28.6	25.0	19.7	17.8
90°	1.1	13.9	23.3	29.2	31.4
92.5°	29.2	24.5	28.0	30.3	31.4
95°	75.7	37.2	45.4	51.3	50.1
97.5°	136.2	40.8	59.3	63.0	64.0
100°	206.3	46.7	66.4	75.7	78.0
102.5°	283.1	280.8	68.8	81.5	85.1
105°	354.1	389.1	71.1	83.9	88.5
107.5°	436.8	465.8	73.5	86.1	90.9
110°	516.1	540.4	203.9	87.4	92.0



TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	590.6	611.5	591.8	89.7	93.2
115°	669.8	689.6	718.7	179.4	95.6
117.5°	738.5	761.8	781.7	614.9	309.9
120°	815.4	832.8	853.8	867.9	710.5
122.5°	880.5	899.2	922.6	929.6	930.8
125°	946.9	962.2	984.3	992.4	996.0
127.5°	1007.5	1023.8	1041.5	1053.0	1054.2
130°	1064.7	1083.4	1096.1	1108.9	1107.9
132.5°	1123.0	1138.1	1150.8	1161.4	1160.3
135°	1171.9	1190.6	1200.9	1212.7	1210.3
137.5°	1223.0	1237.1	1248.8	1260.4	1257.0
140°	1273.1	1282.6	1295.2	1305.7	1300.0
142.5°	1315.2	1323.4	1338.5	1347.7	1341.9
145°	1359.4	1358.2	1378.0	1386.2	1380.3
147.5°	1397.8	1394.3	1414.1	1419.9	1415.4
150°	1435.1	1427.0	1445.6	1452.6	1446.7
152.5°	1466.5	1457.2	1474.7	1481.8	1473.5
155°	1496.8	1486.4	1500.4	1507.3	1498.1
157.5°	1521.2	1512.0	1522.5	1530.7	1521.2
160°	1542.3	1535.3	1542.3	1549.2	1541.1
162.5°	1560.8	1554.0	1559.7	1567.9	1557.4
165°	1577.2	1570.3	1573.7	1581.8	1573.7
167.5°	1590.0	1583.0	1586.6	1594.7	1584.2
170°	1600.5	1593.5	1595.9	1604.0	1593.5
172.5°	1607.5	1600.5	1602.9	1611.0	1600.5
175°	1613.3	1605.1	1607.5	1615.6	1604.0
177.5°	1615.6	1607.5	1608.7	1616.8	1606.3
180°	1609.8	1609.8	1609.8	1609.8	1609.8

TEST NUMBER: P925349

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.05	12.91	13.00	13.88	15.15	11.60	12.46	12.56	13.44	14.71
	3H	13.69	14.46	14.66	15.44	16.73	13.20	13.97	14.17	14.95	16.24
	4H	14.26	14.99	15.24	15.98	17.28	13.77	14.50	14.75	15.49	16.79
	6H	14.65	15.32	15.64	16.31	17.63	14.15	14.82	15.14	15.81	17.13
	8H	14.74	15.39	15.74	16.39	17.70	14.24	14.88	15.24	15.89	17.20
	12H	14.79	15.40	15.79	16.40	17.73	14.28	14.89	15.28	15.89	17.22
4H	2H	12.50	13.23	13.48	14.21	15.51	12.14	12.87	13.13	13.86	15.16
	3H	14.34	14.95	15.34	15.96	17.28	13.93	14.54	14.93	15.56	16.87
	4H	15.04	15.60	16.04	16.60	17.94	14.61	15.17	15.62	16.18	17.52
	6H	15.53	16.02	16.55	17.05	18.38	15.10	15.58	16.12	16.61	17.95
	8H	15.67	16.12	16.69	17.15	18.50	15.24	15.69	16.26	16.71	18.06
	12H	15.74	16.14	16.78	17.18	18.54	15.29	15.70	16.33	16.74	18.09
8H	4H	15.22	15.67	16.24	16.70	18.05	14.85	15.29	15.86	16.32	17.67
	6H	15.83	16.20	16.87	17.27	18.62	15.45	15.82	16.49	16.88	18.23
	8H	16.04	16.36	17.09	17.42	18.78	15.65	15.97	16.70	17.02	18.39
	12H	16.16	16.44	17.21	17.49	18.90	15.75	16.03	16.80	17.08	18.49
12H	4H	15.21	15.61	16.24	16.65	18.01	14.84	15.24	15.87	16.28	17.64
	6H	15.86	16.18	16.91	17.23	18.60	15.48	15.81	16.53	16.86	18.23
	8H	16.08	16.37	17.14	17.42	18.83	15.70	15.99	16.75	17.03	18.44