

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925350

Luminaire Tested: DFN2DIP-SQ2F0-050D050US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925350
REPORT IS A COMBINATION OF REPORTS P899800 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D050US950-RLLFLL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8276.0 lumens
Efficiency: N/A
Efficacy: 101.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLLFLL

Luminous Intensity Polar Plot

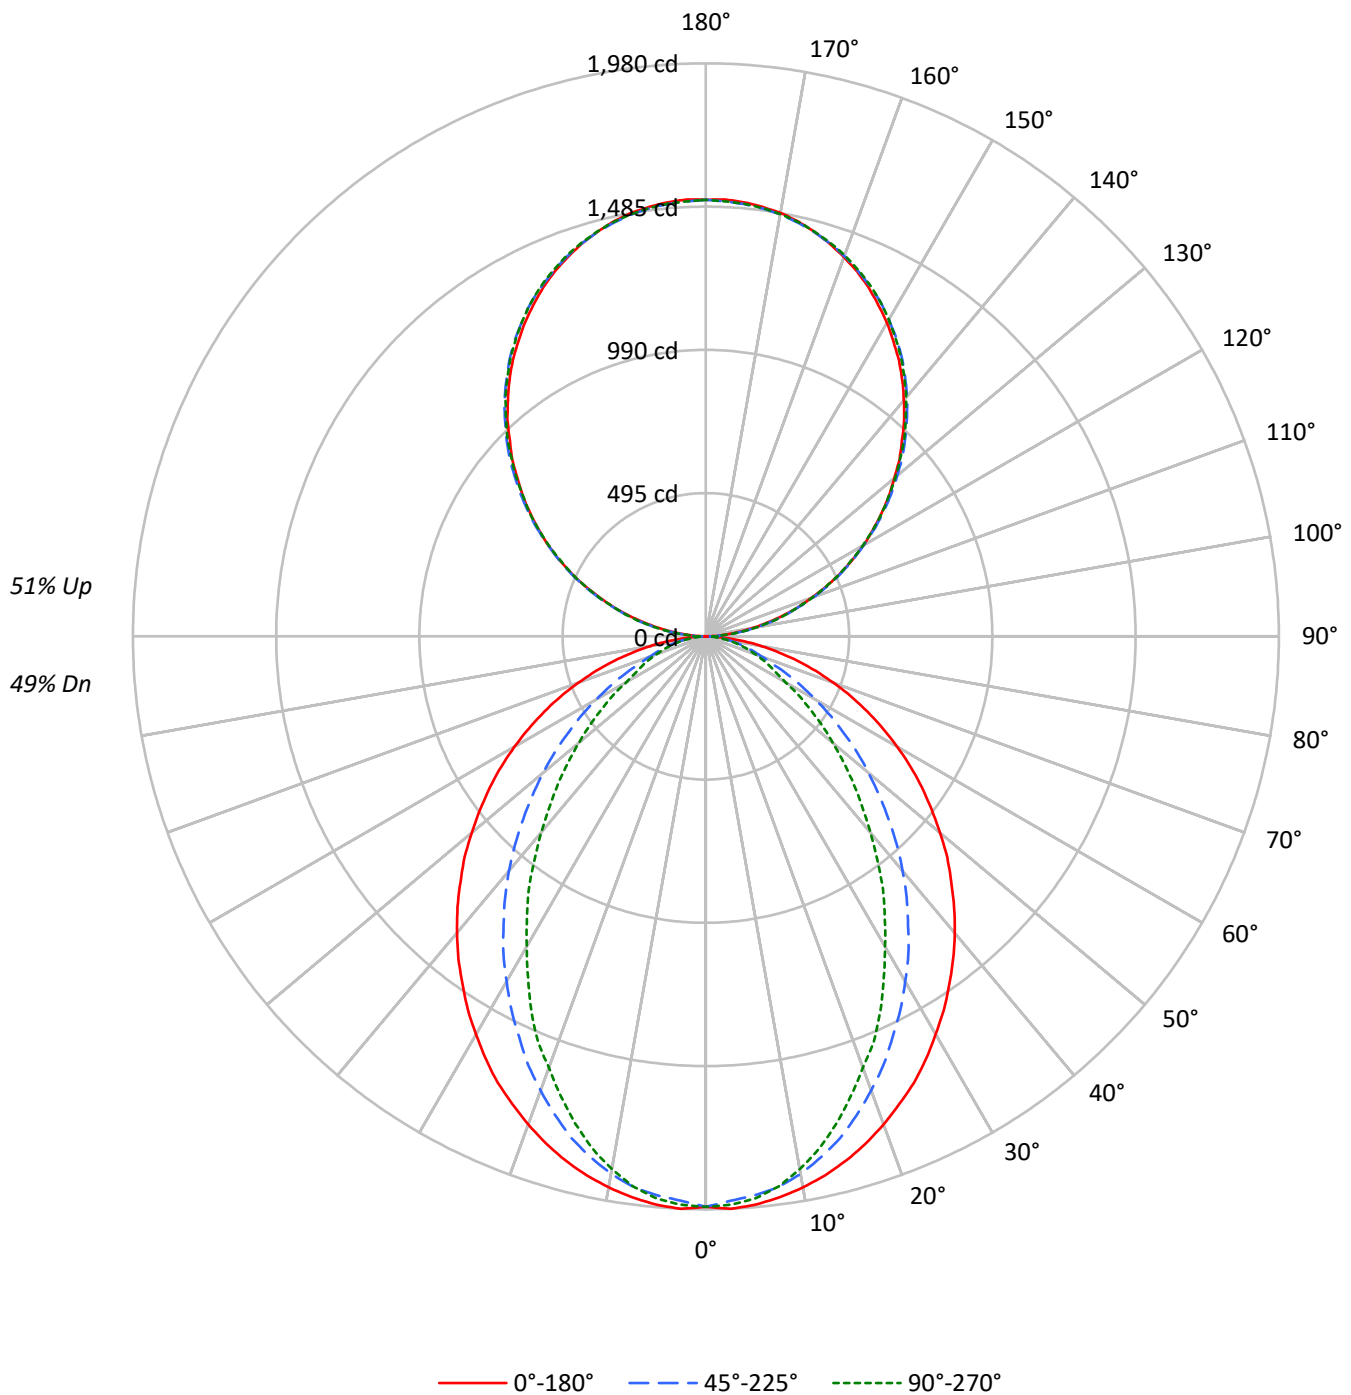

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4335	4335	4335
5°	4334	4257	4287
10°	4284	4164	4142
15°	4218	4017	3921
20°	4132	3819	3651
25°	4044	3598	3391
30°	3929	3373	3064
35°	3816	3131	2776
40°	3701	2882	2447
45°	3567	2607	2150
50°	3429	2331	1859
55°	3283	2036	1581
60°	3114	1730	1295
65°	2919	1420	1159
70°	2684	1131	1040
75°	2387	979	934
80°	1959	796	791
85°	1276	494	564

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3567 cd/sqm

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.2
10°-20°	507.2	6.1
20°-30°	712.1	8.6
30°-40°	776.3	9.4
40°-50°	713.5	8.6
50°-60°	560.3	6.8
60°-70°	364.7	4.4
70°-80°	187.7	2.3
80°-90°	52.2	0.6
90°-100°	93.4	1.1
100°-110°	296.6	3.6
110°-120°	507.6	6.1
120°-130°	667.5	8.1
130°-140°	749.3	9.1
140°-150°	734.8	8.9
150°-160°	616.4	7.4
160°-170°	408.8	4.9
170°-180°	142.9	1.7
0°-30°	1404.1	17.0
0°-40°	2180.4	26.3
0°-60°	3454.1	41.7
0°-90°	4058.8	49.0
90°-120°	897.5	10.8
90°-150°	3049.2	36.8
90°-180°	4217.0	51.0
0°-180°	8276.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	16	45	42	43	8
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P925350

CATALOG NUMBER: DFN2DIP-SQ2F0-050D050US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.04	12.86	13.01	13.84	15.13	8.00	8.82	8.97	9.80	11.09
	3H	13.69	14.43	14.68	15.42	16.73	9.17	9.90	10.15	10.89	12.20
	4H	14.29	14.98	15.29	15.98	17.30	9.60	10.30	10.60	11.29	12.61
	6H	14.69	15.33	15.70	16.33	17.66	9.91	10.55	10.91	11.55	12.88
	8H	14.81	15.42	15.82	16.44	17.76	9.99	10.60	11.00	11.61	12.94
	12H	14.87	15.44	15.88	16.45	17.80	10.02	10.60	11.04	11.61	12.96
4H	2H	12.05	12.74	13.05	13.74	15.06	8.58	9.28	9.58	10.27	11.59
	3H	13.85	14.43	14.87	15.46	16.79	9.91	10.49	10.92	11.51	12.84
	4H	14.53	15.06	15.55	16.08	17.43	10.44	10.97	11.46	11.98	13.34
	6H	15.03	15.48	16.06	16.52	17.87	10.84	11.29	11.87	12.33	13.68
	8H	15.19	15.61	16.22	16.65	18.01	10.96	11.38	11.99	12.41	13.78
	12H	15.27	15.66	16.32	16.70	18.08	11.01	11.39	12.06	12.44	13.81
8H	4H	14.49	14.92	15.52	15.95	17.32	10.71	11.13	11.74	12.16	13.53
	6H	15.04	15.39	16.09	16.46	17.82	11.20	11.55	12.26	12.63	13.99
	8H	15.24	15.55	16.30	16.61	17.99	11.38	11.69	12.44	12.74	14.13
	12H	15.37	15.64	16.43	16.69	18.11	11.48	11.75	12.55	12.81	14.23
12H	4H	14.44	14.83	15.49	15.87	17.24	10.71	11.09	11.76	12.14	13.51
	6H	15.01	15.32	16.07	16.38	17.76	11.25	11.55	12.31	12.61	14.00
	8H	15.22	15.49	16.28	16.54	17.97	11.44	11.71	12.50	12.76	14.19