

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925352

Luminaire Tested: DFN2DIP-SQ2F0-050D060US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925352
REPORT IS A COMBINATION OF REPORTS P899811 AND P896659
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D060US950-FLLFLL
Description: 2 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9788.0 lumens
Efficiency: N/A
Efficacy: 108.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFLL

Luminous Intensity Polar Plot

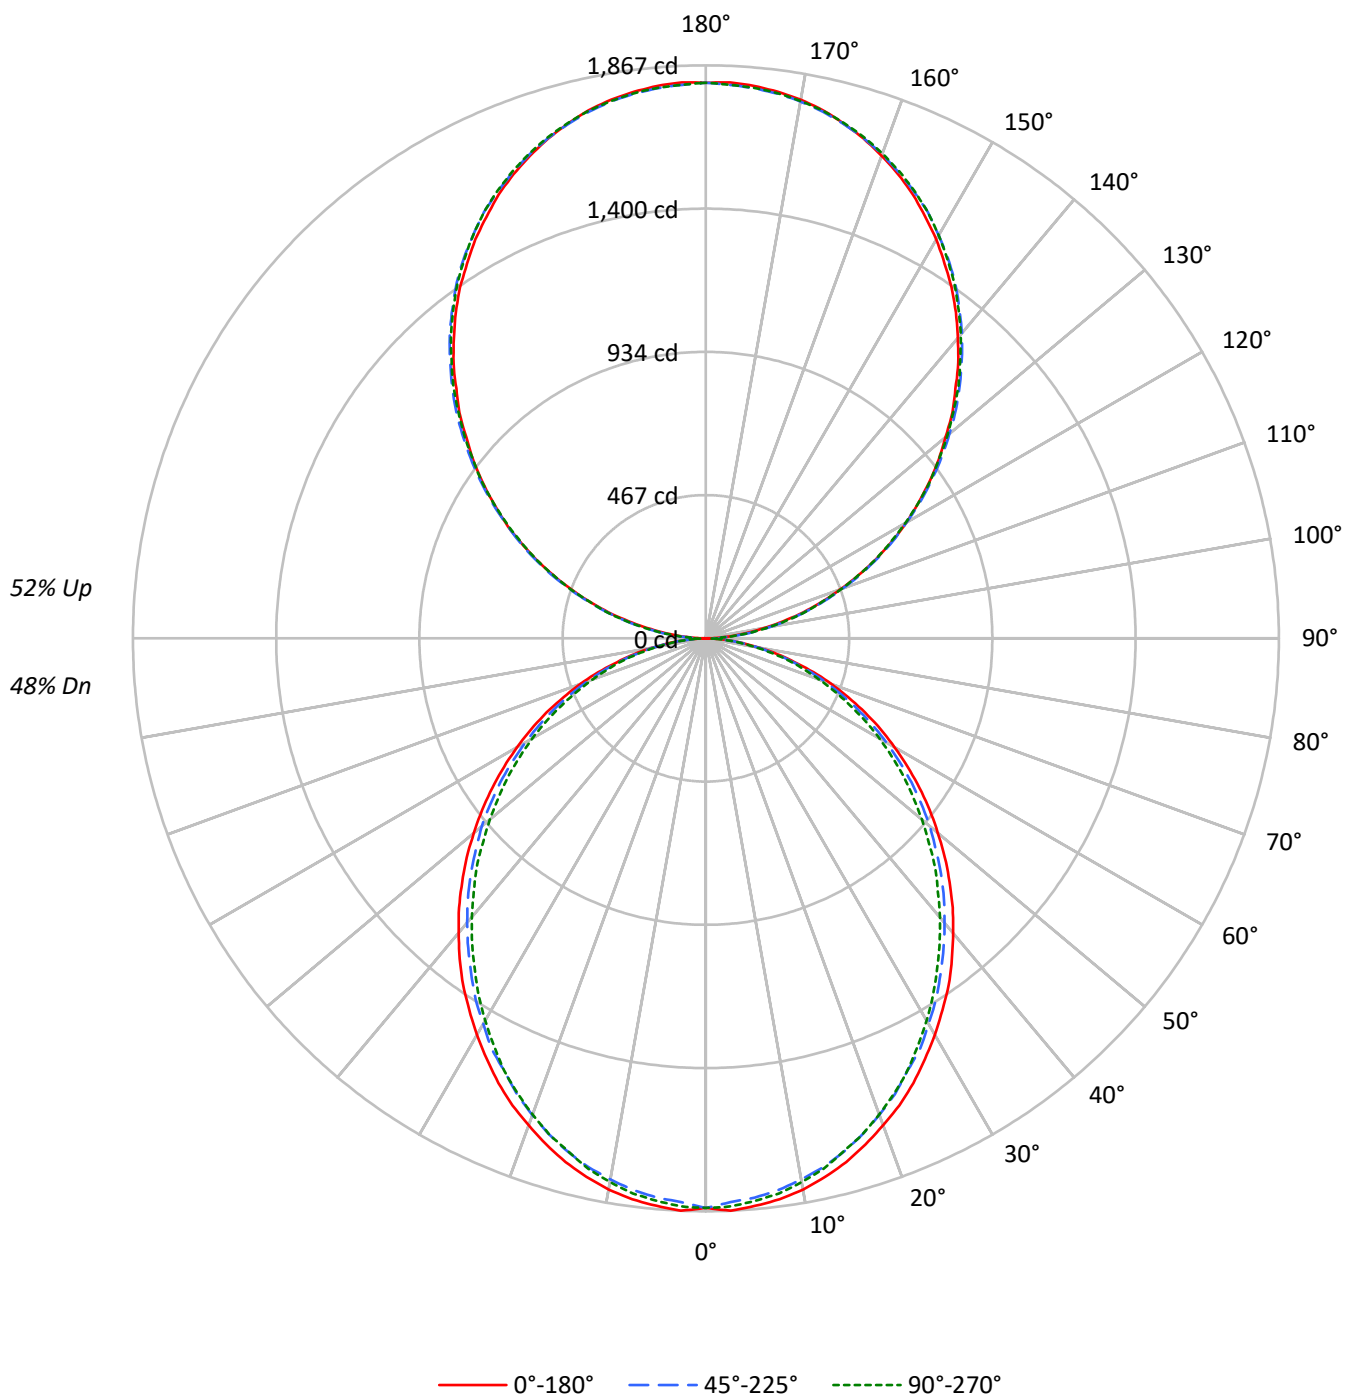

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4081	4081	4081
5°	4081	4015	4046
10°	4040	3953	3985
15°	3974	3878	3894
20°	3887	3779	3801
25°	3800	3662	3694
30°	3692	3553	3560
35°	3590	3425	3418
40°	3465	3296	3282
45°	3340	3166	3144
50°	3203	3029	2983
55°	3060	2871	2835
60°	2897	2686	2664
65°	2718	2491	2464
70°	2491	2254	2246
75°	2179	1970	2038
80°	1800	1609	1655
85°	1216	1015	1040

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3340 cd/sqm

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.7	1.8
10°-20°	491.5	5.0
20°-30°	722.3	7.4
30°-40°	838.9	8.6
40°-50°	837.9	8.6
50°-60°	730.6	7.5
60°-70°	540.1	5.5
70°-80°	305.6	3.1
80°-90°	85.8	0.9
90°-100°	112.0	1.1
100°-110°	355.9	3.6
110°-120°	609.1	6.2
120°-130°	801.1	8.2
130°-140°	899.2	9.2
140°-150°	881.7	9.0
150°-160°	739.6	7.6
160°-170°	490.5	5.0
170°-180°	171.4	1.8
0°-30°	1388.5	14.2
0°-40°	2227.5	22.8
0°-60°	3796.0	38.8
0°-90°	4727.4	48.3
90°-120°	1077.0	11.0
90°-150°	3659.0	37.4
90°-180°	5061.0	51.7
0°-180°	9788.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1856	1856	1856	1856	1856	
5°	1856	1849	1829	1844	1840	176
15°	1767	1756	1733	1740	1731	498
25°	1599	1585	1554	1558	1554	736
35°	1380	1362	1333	1322	1314	862
45°	1123	1110	1083	1064	1057	866
55°	850	839	817	796	787	760
65°	573	562	544	528	519	567
75°	300	296	287	277	280	320
85°	73	71	70	64	62	82
90°	2	20	54	50	52	9
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1856.0	1856.0	1856.0	1856.0	1856.0
2.5°	1866.8	1857.9	1838.3	1856.0	1852.7
5°	1856.0	1849.0	1829.3	1843.5	1840.2
7.5°	1843.5	1832.9	1813.3	1827.7	1824.0
10°	1824.0	1811.6	1790.2	1804.3	1799.1
12.5°	1797.1	1786.6	1765.2	1774.1	1770.4
15°	1766.8	1756.2	1732.9	1740.2	1731.2
17.5°	1729.3	1718.7	1695.4	1704.3	1695.4
20°	1688.3	1677.7	1652.7	1658.0	1651.0
22.5°	1647.4	1631.2	1608.0	1608.0	1604.3
25°	1599.1	1584.9	1554.5	1558.0	1554.5
27.5°	1545.5	1533.0	1509.9	1504.6	1495.7
30°	1492.1	1477.7	1451.0	1445.7	1438.5
32.5°	1434.9	1424.3	1395.7	1384.9	1377.8
35°	1379.6	1361.8	1333.2	1322.4	1313.6
37.5°	1317.1	1301.1	1272.4	1259.9	1251.1
40°	1253.0	1238.6	1210.0	1194.0	1186.9
42.5°	1190.5	1176.1	1147.7	1129.6	1119.0
45°	1122.7	1110.2	1083.3	1063.8	1056.6
47.5°	1056.6	1044.1	1015.5	995.8	985.2
50°	986.9	978.0	953.0	928.1	919.1
52.5°	919.1	906.6	883.5	863.8	851.3
55°	849.6	838.9	817.4	796.0	787.1
57.5°	779.9	771.0	747.7	726.4	719.1
60°	710.3	703.3	678.3	658.5	653.3
62.5°	642.5	630.0	612.2	594.3	587.2
65°	573.0	562.2	544.4	528.3	519.4
67.5°	501.6	492.6	476.6	464.1	456.9
70°	435.5	428.3	412.2	399.7	392.8
72.5°	367.8	360.5	351.6	339.1	333.8
75°	299.7	296.3	287.2	276.7	280.3
77.5°	239.2	231.9	228.4	223.0	217.8
80°	178.6	176.7	173.1	167.8	164.2
82.5°	121.3	121.3	119.6	112.5	112.5
85°	73.1	71.4	69.6	64.2	62.5
87.5°	32.1	28.6	25.0	19.7	17.8
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P925352

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.88	12.73	12.85	13.71	15.01	11.44	12.28	12.41	13.27	14.56
	3H	13.52	14.28	14.50	15.28	16.59	13.03	13.79	14.01	14.79	16.10
	4H	14.10	14.81	15.09	15.81	17.14	13.60	14.32	14.60	15.32	16.64
	6H	14.48	15.14	15.49	16.15	17.48	13.98	14.64	14.99	15.65	16.98
	8H	14.58	15.21	15.59	16.23	17.56	14.08	14.71	15.09	15.73	17.06
	12H	14.62	15.22	15.64	16.23	17.59	14.11	14.71	15.13	15.72	17.08
4H	2H	12.33	13.05	13.33	14.05	15.37	11.97	12.69	12.98	13.69	15.02
	3H	14.17	14.77	15.18	15.80	17.14	13.76	14.36	14.77	15.39	16.73
	4H	14.87	15.42	15.89	16.44	17.80	14.45	14.99	15.46	16.01	17.38
	6H	15.37	15.84	16.40	16.88	18.24	14.93	15.41	15.96	16.45	17.81
	8H	15.51	15.95	16.54	16.98	18.36	15.07	15.51	16.10	16.55	17.92
	12H	15.57	15.97	16.62	17.02	18.40	15.12	15.52	16.17	16.57	17.95
8H	4H	15.05	15.49	16.08	16.53	17.90	14.68	15.12	15.71	16.15	17.53
	6H	15.66	16.03	16.72	17.10	18.47	15.28	15.64	16.33	16.72	18.09
	8H	15.87	16.19	16.93	17.25	18.64	15.47	15.80	16.54	16.86	18.25
	12H	15.99	16.27	17.05	17.33	18.76	15.58	15.86	16.64	16.92	18.35
12H	4H	15.04	15.43	16.09	16.49	17.86	14.67	15.07	15.72	16.12	17.50
	6H	15.69	16.01	16.75	17.07	18.46	15.31	15.63	16.37	16.70	18.09
	8H	15.91	16.19	16.98	17.25	18.68	15.53	15.81	16.60	16.87	18.30