

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925355

Luminaire Tested: DFN2DIP-SQ2F0-050D060US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925355
REPORT IS A COMBINATION OF REPORTS P901332 AND P898215
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ2F0-050D060US950-RLLONL
Description: 2 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9721.3 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.21' x L: 2.21' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLLONL

Luminous Intensity Polar Plot

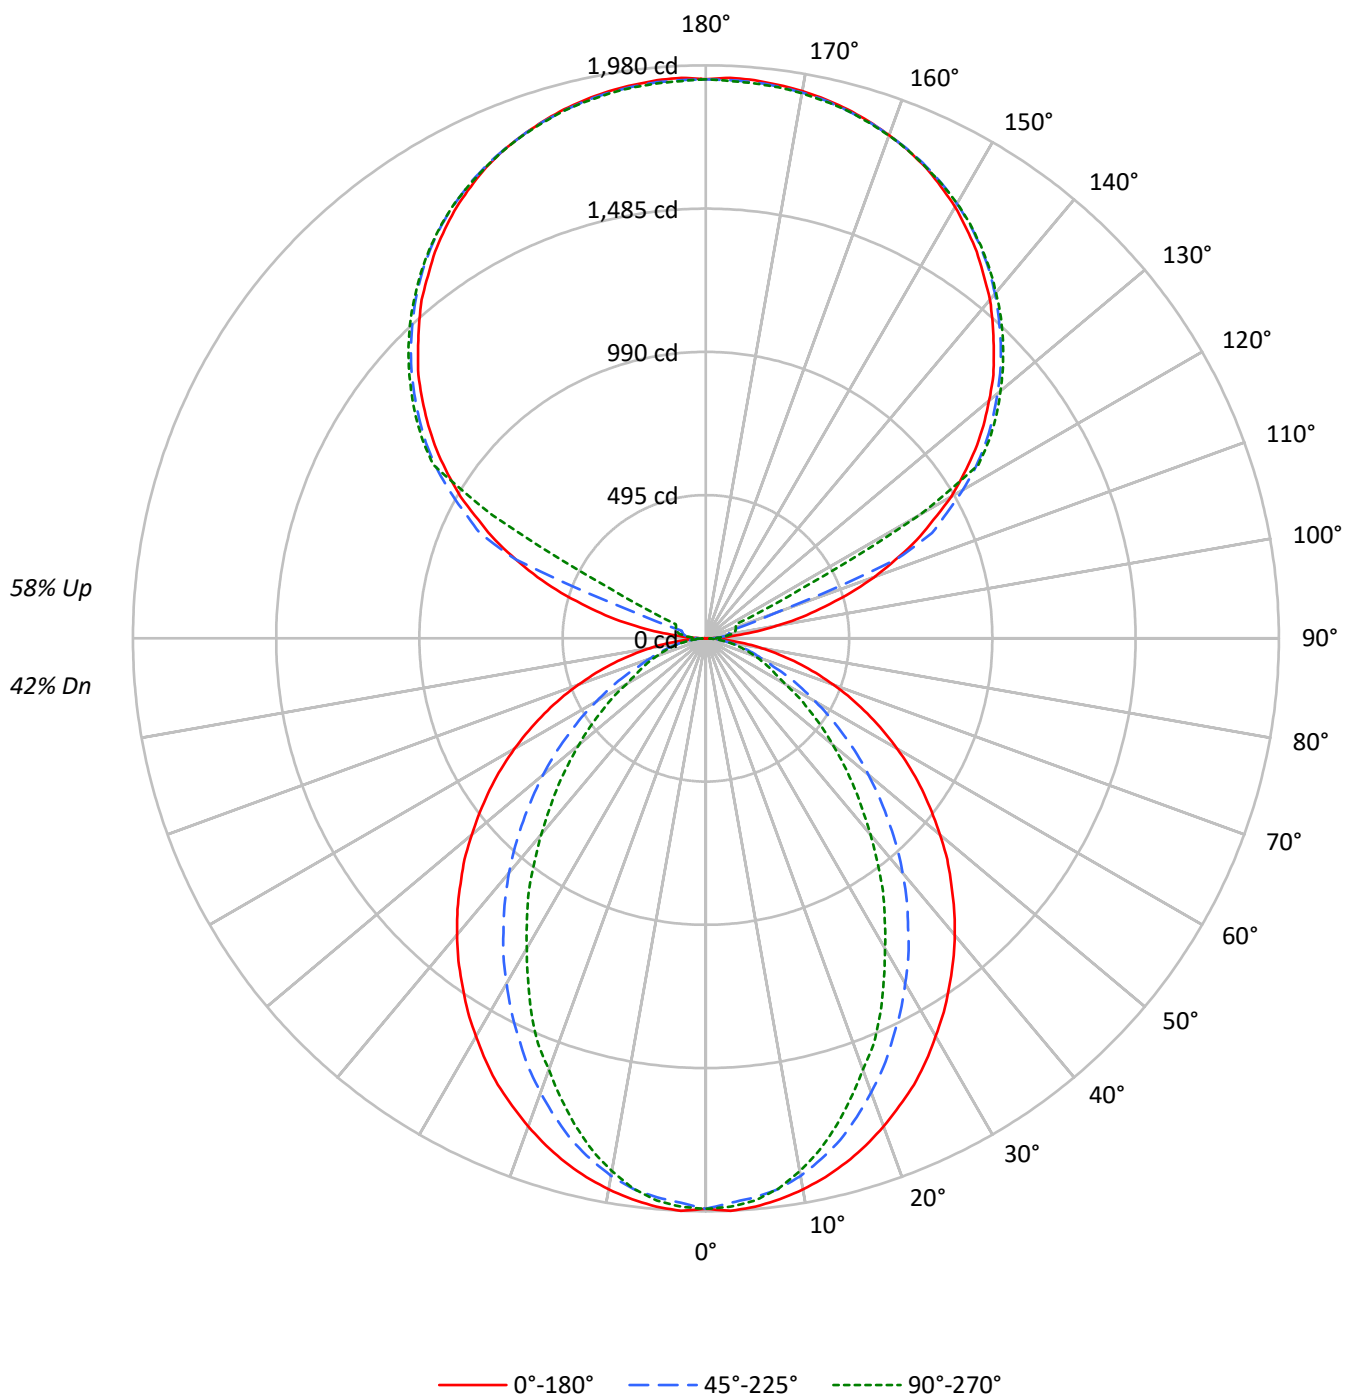

TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4335	4335	4335
5°	4334	4257	4287
10°	4284	4164	4142
15°	4218	4017	3921
20°	4132	3819	3651
25°	4044	3598	3391
30°	3929	3373	3064
35°	3816	3131	2776
40°	3701	2882	2447
45°	3567	2607	2150
50°	3429	2331	1859
55°	3283	2036	1581
60°	3114	1730	1295
65°	2919	1420	1159
70°	2684	1131	1040
75°	2387	979	934
80°	1959	796	791
85°	1276	494	564

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3567 cd/sqm

TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.9
10°-20°	507.2	5.2
20°-30°	712.1	7.3
30°-40°	776.3	8.0
40°-50°	713.5	7.3
50°-60°	560.3	5.8
60°-70°	364.7	3.8
70°-80°	187.7	1.9
80°-90°	51.3	0.5
90°-100°	63.7	0.7
100°-110°	237.5	2.4
110°-120°	629.8	6.5
120°-130°	1044.5	10.7
130°-140°	1109.5	11.4
140°-150°	1031.2	10.6
150°-160°	829.1	8.5
160°-170°	534.2	5.5
170°-180°	183.9	1.9
0°-30°	1404.1	14.4
0°-40°	2180.4	22.4
0°-60°	3454.1	35.5
0°-90°	4057.9	41.7
90°-120°	930.9	9.6
90°-150°	4116.2	42.3
90°-180°	5663.0	58.3
0°-180°	9721.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	17	28	35	38	9
95°	91	45	54	62	60	108
105°	425	467	85	101	106	454
115°	804	828	862	215	115	791
125°	1136	1155	1181	1191	1195	1014
135°	1406	1429	1441	1455	1452	1086
145°	1631	1630	1654	1663	1656	1020
155°	1796	1784	1800	1809	1798	828
165°	1893	1884	1888	1898	1888	535
175°	1936	1926	1929	1939	1925	184
180°	1932	1932	1932	1932	1932	

TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.3	16.8	27.9	35.0	37.7
92.5°	35.0	29.4	33.5	36.3	37.7
95°	90.8	44.6	54.5	61.6	60.1
97.5°	163.5	48.9	71.2	75.6	76.9
100°	247.5	55.9	79.7	90.8	93.6
102.5°	339.6	337.0	82.5	97.8	102.1
105°	424.9	466.9	85.3	100.6	106.3
107.5°	524.2	559.0	88.1	103.4	109.0
110°	619.3	648.5	244.7	104.9	110.4



TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	708.7	733.8	710.1	107.5	111.9
115°	803.7	827.5	862.5	215.3	114.7
117.5°	886.2	914.1	938.0	738.0	371.8
120°	978.5	999.4	1024.7	1041.4	852.7
122.5°	1056.7	1079.1	1107.1	1115.4	1116.9
125°	1136.4	1154.6	1181.1	1191.0	1195.1
127.5°	1209.1	1228.7	1249.7	1263.7	1265.0
130°	1277.6	1300.0	1315.3	1330.7	1329.4
132.5°	1347.5	1365.7	1381.0	1393.6	1392.3
135°	1406.3	1428.7	1441.1	1455.2	1452.4
137.5°	1467.6	1484.4	1498.5	1512.5	1508.4
140°	1527.7	1539.1	1554.4	1566.9	1560.0
142.5°	1578.2	1588.0	1606.2	1617.2	1610.3
145°	1631.3	1629.8	1653.6	1663.4	1656.4
147.5°	1677.3	1673.1	1696.9	1703.8	1698.4
150°	1722.2	1712.3	1734.8	1743.1	1736.1
152.5°	1759.8	1748.7	1769.6	1778.1	1768.2
155°	1796.2	1783.7	1800.5	1808.8	1797.6
157.5°	1825.6	1814.4	1827.0	1836.8	1825.6
160°	1850.8	1842.3	1850.8	1859.1	1849.3
162.5°	1873.0	1864.7	1871.7	1881.5	1868.9
165°	1892.6	1884.3	1888.4	1898.3	1888.4
167.5°	1908.0	1899.6	1903.9	1913.7	1901.0
170°	1920.7	1912.2	1915.1	1924.8	1912.2
172.5°	1929.0	1920.7	1923.5	1933.3	1920.7
175°	1936.0	1926.1	1929.0	1938.7	1924.8
177.5°	1938.7	1929.0	1930.4	1940.2	1927.7
180°	1931.8	1931.8	1931.8	1931.8	1931.8

TEST NUMBER: P925355

CATALOG NUMBER: DFN2DIP-SQ2F0-050D060US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.31	12.07	12.34	13.11	14.49	7.27	8.03	8.30	9.07	10.45
	3H	12.96	13.64	14.00	14.69	16.09	8.43	9.12	9.47	10.16	11.57
	4H	13.55	14.20	14.60	15.25	16.66	8.87	9.52	9.92	10.56	11.97
	6H	13.95	14.55	15.02	15.60	17.03	9.17	9.76	10.23	10.81	12.24
	8H	14.07	14.64	15.14	15.70	17.12	9.25	9.82	10.31	10.88	12.30
	12H	14.12	14.66	15.19	15.72	17.16	9.28	9.82	10.35	10.88	12.32
4H	2H	11.31	11.96	12.37	13.01	14.42	7.84	8.49	8.90	9.54	10.95
	3H	13.11	13.65	14.18	14.72	16.15	9.17	9.71	10.23	10.78	12.21
	4H	13.79	14.28	14.86	15.34	16.79	9.70	10.19	10.77	11.25	12.70
	6H	14.28	14.70	15.36	15.79	17.23	10.09	10.52	11.17	11.60	13.05
	8H	14.44	14.84	15.52	15.92	17.38	10.21	10.60	11.29	11.68	13.14
	12H	14.52	14.88	15.62	15.97	17.44	10.26	10.62	11.36	11.71	13.17
8H	4H	13.75	14.14	14.83	15.22	16.68	9.96	10.36	11.04	11.44	12.89
	6H	14.29	14.61	15.39	15.74	17.19	10.45	10.78	11.56	11.90	13.35
	8H	14.49	14.78	15.60	15.88	17.36	10.63	10.91	11.74	12.02	13.49
	12H	14.61	14.86	15.73	15.96	17.48	10.73	10.98	11.84	12.08	13.59
12H	4H	13.69	14.05	14.79	15.14	16.61	9.96	10.32	11.06	11.41	12.87
	6H	14.26	14.55	15.37	15.65	17.13	10.49	10.78	11.61	11.89	13.36
	8H	14.46	14.72	15.58	15.82	17.33	10.69	10.94	11.80	12.04	13.55